

November 2007

 No. OCS03
 REVISED EDITION-B

TECHNICAL DATA BOOK **R410A** **INVERTER**

<Indoor unit>

[Model names]

MFZ-KA-VA
SLZ-KA-VA(L)
SEZ-KC-VA
SEZ-KA-VA
SEZ-KD-VA(L)
PLA-RP-BA
PLA-RP-AA
PCA-RP-GA(2)
PEAD-RP-EA(2)
PEAD-RP-GA
PEA-RP-EA

Revision:

- SEZ-KD-VA(L) are added in REVISED EDITION-B.
- Some descriptions have been modified.
- Please void OCS03 REVISED EDITION-A.

<Outdoor unit>

[Model names]

SUZ-KA25/35/50/60/71VA
SUZ-KA25/35VAH

CONTENTS

| | |
|---|----|
| 1. REFERENCE SERVICE MANUAL | 2 |
| 2. SPECIFICATIONS | 3 |
| 3. OUTLINES AND DIMENSIONS | 13 |
| 4. WIRING DIAGRAM | 30 |
| 5. REFRIGERANT SYSTEM DIAGRAM | 45 |
| 6. PERFORMANCE CURVES | 48 |
| 7. APPLICABLE EXTENSION PIPE FOR EACH MODEL | 52 |
| 8. AIR FLOW DATA | 54 |
| 9. NOISE CRITERION CURVES | 75 |
| 10. OPTIONAL PARTS | 89 |

kW Model


1

REFERENCE SERVICE MANUAL

For information on service, please refer to the service manual as follows.

1-1. Indoor Unit

| Model name | Service Ref. | Service Manual No. |
|---|---|--------------------|
| SLZ-KA25/35/50VA SLZ-KA25/35/50VAL | SLZ-KA25/35/50VA ⁽¹⁾ .TH SLZ-KA25/35/50VAL ⁽¹⁾ .TH | OC320 |
| SEZ-KA35/50/60/71VA | SEZ-KA35/50/60/71VA.TH | OC321 |
| SEZ-KC25VA | SEZ-KC25VA.W | MEE04K350 |
| SEZ-KD25/35/50/60/71VA SEZ-KD25/35/50/60/71VAL | SEZ-KD25/35/50/60/71VA.TH SEZ-KD25/35/50/60/71VAL.TH | HWE07110 |
| MFZ-KA25/35/50VA-E1 | MFZ-KA25/35/50VA-E1 | OB409 |
| MFZ-KA25/35/50VA-A1 | MFZ-KA25/35/50VA-A1 | OB410 |
| PLA-RP35/50/60/71BA | PLA-RP35/50/60/71BA.UK PLA-RP35/50/60/71BA ¹ .UK | OCH412 OCB412 |
| | PLA-RP35/50/60/71BA | OCH416 OCB416 |
| PLA-RP35/50/60/71AA | PLA-RP35/50/60/71AA.UK | OC335 |
| | PLA-RP35/50/60/71AA | OC327 |
| PCA-RP50/60/71GA PCA-RP50GA2 | PCA-RP50/60/71GA PCA-RP50GA2 | OC328 |
| PEAD-RP50/60/71EA PEAD-RP35EA2 | PEAD-RP50/60/71EA.UK PEAD-RP35EA2.UK | HWE05210 |
| PEAD-RP60/71GA | PEAD-RP60/71GA.UK | HWE05060 |
| PEA-RP71EA | PEA-RP71EA.TH-A | OC326 |

1-2. Outdoor Unit

| Model name | Service Ref. | Service Manual No. |
|--|--|--------------------|
| SUZ-KA25/35/50/60/71VA SUZ-KA25/35VAH | SUZ-KA25/35/50/60/71VA ⁽¹⁾ .TH SUZ-KA25/35VAH.TH | OC322 |
| SUZ-KA25/35/50/60/71VA | SUZ-KA25/35/50/60/71VA ⁽¹⁾ .TH-A | OC323 |

(Note)

When you connect P series indoor units with SUZ, always make sure to follow the piping size of SUZ. Never use bigger sized pipings in order to ensure not only the system performance but also for your safety.

2-1. FLOOR STANDING TYPE

| Model name | Indoor unit | | MFZ-KA25VA | MFZ-KA35VA | MFZ-KA50VA | |
|-------------------------|--|----------|----------------------------|-----------------------|------------------------|-------------------|
| | Outdoor unit | | SUZ-KA25VA(H) | SUZ-KA35VA(H) | SUZ-KA50VA | |
| Cooling | Capacity | Btu/h | 8,500 | 11,900 | 16,400 | |
| | | kW | 2.5(0.9-3.4) | 3.5(0.9-3.9) | 4.8(0.9-5.4) | |
| | Total input | kW | 0.58 | 1.09 | 1.55 | |
| | EER | | 4.31 | 3.21 | 3.1 | |
| | Energy label class | | A | A | B | |
| | SHF | | 0.66 | 0.65 | 0.63 | |
| Heating | Capacity | Btu/h | 11,600 | 13,600 | 20,500 | |
| | | kW | 3.4(0.9-5.1) | 4.0(0.9-6.2) | 6.0(0.9-7.9) | |
| | Total input | kW | 0.835 | 1.10 | 1.86 | |
| | COP | | 4.07 | 3.64 | 3.23 | |
| | Energy label class | | A | A | C | |
| | Booster heater | kW | - | - | - | |
| Power supply | Phase | φ | 1 | 1 | 1 | |
| | Cycle | Hz | 50 | 50 | 50 | |
| | Voltage | V | 230 | 230 | 230 | |
| | Breaker size | A | 10 | 10 | 20 | |
| Indoor unit | Air flow at cooling (Low-Medium-High-Super High) | CMM | 4.8 - 5.8 - 7.1 - 8.7 | 5.0 - 6.1 - 7.4 - 9.1 | 7.1 - 7.9 - 9.2 - 10.7 | |
| | | CFM | 170 - 205 - 250 - 310 | 180 - 215 - 260 - 320 | 250 - 280 - 325 - 380 | |
| | Air flow at heating (Low-Medium-High-Super High) | CMM | 5.0 - 6.2 - 7.6 - 9.1 | 5.2 - 6.2 - 7.8 - 9.5 | 7.4 - 8.8 - 9.8 - 11.8 | |
| | | CFM | 180 - 220 - 270 - 320 | 185 - 220 - 275 - 335 | 260 - 310 - 345 - 415 | |
| | External static pressure | Pa | 0 | 0 | 0 | |
| | Sound level at cooling (Low-Medium-High-Super High) | dB(A) | | 22 - 27 - 32 - 37 | 23 - 28 - 33 - 38 | 32 - 35 - 39 - 43 |
| | | | | 22 - 27 - 32 - 37 | 25 - 28 - 33 - 38 | 32 - 35 - 39 - 44 |
| | External finish (Panel) | | White Munsell 1.0Y 9.2/0.2 | | | |
| | Dimension Unit (Panel) | W : mm | | 700 | | |
| | | D : mm | | 200 | | |
| | | H : mm | | 600 | | |
| | | W : inch | | 27 - 5/8 | | |
| | | D : inch | | 7 - 7/8 | | |
| | | H : inch | | 23 - 5/8 | | |
| Weight Unit (Panel) | kg | | 14 | | | |
| | lbs | | 31 | | | |
| Outdoor unit | Air flow at cooling (Low - High) | CMM | 34.3 | 33.4 | 27.5 - 49 | |
| | | CFM | 1,210 | 1,180 | 970 - 1,730 | |
| | Air flow at heating (Low - High) | CMM | 32.3 | 33.4 | 36.8 - 49 | |
| | | CFM | 1,140 | 1,180 | 1,300 - 1,730 | |
| | Sound level at cooling (Low - High) | dB(A) | 46 | 47 | 51 - 53 | |
| | Sound level at heating (Low - High) | dB(A) | 46 | 48 | 53 - 55 | |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 | | | |
| | Dimension | W : mm | 800 | 800 | 840 | |
| | | D : mm | 285 | 285 | 330 | |
| | | H : mm | 550 | 550 | 850 | |
| | | W : inch | 31 - 1/2 | 31 - 1/2 | 33 - 1/16 | |
| | | D : inch | 11 - 1/4 | 11 - 1/4 | 13 | |
| | | H : inch | 21 - 5/8 | 21 - 5/8 | 33 - 7/16 | |
| | Weight | kg | 33 | 37 | 53 | |
| lbs | | 73 | 82 | 117 | | |
| Refrigerant pipe size | Gas side O.D. | mm | 9.52 | 9.52 | 12.7 | |
| | | inch | 3/8 | 3/8 | 1/2 | |
| | Liquid side . | mm | 6.35 | 6.35 | 6.35 | |
| | | inch | 1/4 | 1/4 | 1/4 | |
| Refrigerant pipe length | Height difference | m | Max. 12 | Max. 12 | Max. 30 | |
| | Length | m | Max. 20 | Max. 20 | Max. 30 | |

- NOTE:** 1. Rating conditions (ISO T1)
Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)
Heating Indoor : D.B. 20°C (68°F) Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)
Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

| | | Indoor | | Outdoor | |
|---------|-------------|----------------------|------------------------|------------------------|------------|
| | | KA25, KA35VA | KA50 | KA25,KA35VAH | KA50 |
| Cooling | Upper limit | 32°C D.B., 23°C W.B. | 46°C D.B. | 43°C D.B. | 46°C D.B. |
| | Lower limit | 21°C D.B., 15°C W.B. | -10°C D.B. | -15°C D.B. | -10°C D.B. |
| Heating | Upper limit | 27°C D.B. | 24°C D.B. | 18°C W.B. | |
| | Lower limit | 20°C D.B. | -10°C D.B., -11°C W.B. | -20°C D.B., -21°C W.B. | |

3. Guaranteed voltage
198-264V, 50Hz

4. Above data are based on the indicated voltage.
Indoor unit Single phase, 230V 50Hz
Outdoor unit Single phase, 230V 50Hz

2-2. CEILING CASSETTE TYPE

| Model name | Indoor unit | | SLZ-KA25VA(L) | SLZ-KA35VA(L) | SLZ-KA50VA(L) |
|-------------------------|--|----------|----------------------------|-----------------|-----------------|
| | Outdoor unit | | SUZ-KA25VA | SUZ-KA35VA | SUZ-KA50VA |
| Cooling | Capacity | Btu/h | 8,500 | 11,900 | 15,700 |
| | | kW | 2.5(0.9 - 3.2) | 3.5(1.0 - 3.9) | 4.6(1.1 - 5.2) |
| | Total input | kW | 0.69 | 1.06 | 1.63 |
| | EER | | 3.62 | 3.30 | 2.82 |
| | Energy label class | | A | A | C |
| | SHF | | 0.86 | 0.77 | 0.68 |
| Heating | Capacity | Btu/h | 10,200 | 13,600 | 17,100 |
| | | kW | 3.0(0.9 - 4.5) | 4.0(0.9 - 5.0) | 5.0(0.9 - 6.5) |
| | Total input | kW | 0.83 | 1.10 | 1.55 |
| | COP | | 3.61 | 3.64 | 3.23 |
| | Energy label class | | A | A | C |
| | Booster heater | kW | - | - | - |
| Power supply | Phase | φ | 1 | 1 | 1 |
| | Cycle | Hz | 50 | 50 | 50 |
| | Voltage | V | 230 | 230 | 230 |
| | Breaker size | A | 10 | 10 | 20 |
| Indoor unit | Air flow (Low - Medium - High) | CMM | 8 - 9 - 10 | 8 - 9 - 11 | 8 - 9 - 11 |
| | | CFM | 280 - 320 - 355 | 280 - 320 - 390 | 280 - 320 - 390 |
| | External static pressure | Pa | 0 | 0 | 0 |
| | Sound level (Low - Medium - High) | dB(A) | 28 - 31 - 37 | 29 - 33 - 38 | 30 - 34 - 39 |
| | External finish (Panel) | | White Munsell 6.4Y 8.9/0.4 | | |
| | Dimension Unit(Panel) | W : mm | 570(650) | | |
| | | D : mm | 570(650) | | |
| | | H : mm | 208(20) | | |
| | | W : inch | 22 - 7/16(25 - 9/16) | | |
| | | D : inch | 22 - 7/16(25 - 9/16) | | |
| | | H : inch | 8-3/16(13/16) | | |
| | Weight | kg | 16.5(3) | | |
| | Unit (Panel) | lbs | 36(7) | | |
| Field drain pipe O.D. | mm | 32 | | | |
| | inch | 1 - 1/4 | | | |
| Outdoor unit | Air flow at cooling (Low - High) | CMM | 34.3 | 33.4 | 27.5 - 49 |
| | | CFM | 1,210 | 1,180 | 970 - 1,730 |
| | Air flow at heating (Low - High) | CMM | 32.3 | 33.4 | 36.8 - 49 |
| | | CFM | 1,140 | 1,180 | 1,300 - 1,730 |
| | Sound level at cooling (Low - High) | dB(A) | 46 | 47 | 51 - 53 |
| | Sound level at heating (Low - High) | dB(A) | 46 | 48 | 53 - 55 |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 | | |
| | Dimension | W : mm | 800 | 800 | 840 |
| | | D : mm | 285 | 285 | 330 |
| | | H : mm | 550 | 550 | 850 |
| | | W : inch | 31 - 1/2 | 31 - 1/2 | 33 - 1/16 |
| | | D : inch | 11 - 1/4 | 11 - 1/4 | 13 |
| | | H : inch | 21 - 5/8 | 21 - 5/8 | 33 - 7/16 |
| Weight | kg | 33 | 37 | 53 | |
| | lbs | 73 | 82 | 117 | |
| Refrigerant pipe size | Gas side O.D. | mm | 9.52 | 9.52 | 12.7 |
| | | inch | 3/8 | 3/8 | 1/2 |
| | Liquid side O.D. | mm | 6.35 | 6.35 | 6.35 |
| | | inch | 1/4 | 1/4 | 1/4 |
| Refrigerant pipe length | Height difference | m | Max. 12 | Max. 12 | Max. 30 |
| | Length | m | Max. 20 | Max. 20 | Max. 30 |

NOTE: 1. Rating conditions (ISO T1)

Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F)

Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

| | | Indoor | Outdoor | |
|---------|-------------|-----------------------|-------------------------|------------|
| | | | KA25, KA35VA | KA50 |
| Cooling | Upper limit | 32°C D.B. , 23°C W.B. | 46°C D.B. | 43°C D.B. |
| | Lower limit | 21°C D.B. , 15°C W.B. | -10°C D.B. | -15°C D.B. |
| Heating | Upper limit | 27°C D.B. | 24°C D.B. , 18°C W.B. | |
| | Lower limit | 20°C D.B. | -10°C D.B. , -11°C W.B. | |

3. Guaranteed voltage
198-264V, 50Hz

4. Above data are based on the indicated voltage.

Indoor unit Single phase, 230V 50Hz
Outdoor unit Single phase, 230V 50Hz



| Model name | Indoor unit | | PLA-RP35BA | PLA-RP50BA | PLA-RP60BA | PLA-RP71BA | |
|-------------------------|----------------------------|----------|----------------------------|-----------------------|-----------------------|-----------------------|--|
| | Outdoor unit | | SUZ-KA35VA | SUZ-KA50VA | SUZ-KA60VA | SUZ-KA71VA | |
| Cooling | Capacity | Btu/h | 11,900 | 17,100 | 19,400 | 24,200 | |
| | | kW | 3.5(1.0 - 3.9) | 5.0(1.1 - 5.6) | 5.7(1.1 - 6.3) | 7.1(0.9 - 8.1) | |
| | Total input | kW | 1.09 | 1.78 | 1.94 | 2.53 | |
| | EER | | 3.21 | 2.81 | 2.94 | 2.81 | |
| | Energy label class | | A | C | C | C | |
| | SHF | | 0.84 | 0.81 | 0.76 | 0.73 | |
| Heating | Capacity | Btu/h | 14,000 | 20,500 | 23,500 | 27,300 | |
| | | kW | 4.1(0.9 - 5.0) | 6.0(0.9 - 7.2) | 6.9(0.9 - 8.0) | 8.0(0.9 - 10.2) | |
| | Total input | kW | 1.11 | 1.82 | 2.11 | 2.49 | |
| | COP | | 3.69 | 3.30 | 3.27 | 3.21 | |
| | Energy label class | | A | C | C | C | |
| | Booster heater | kW | - | - | - | - | |
| Power supply | Phase | φ | 1 | 1 | 1 | 1 | |
| | Cycle | Hz | 50 | 50 | 50 | 50 | |
| | Voltage | V | 230 | 230 | 230 | 230 | |
| | Breaker size | A | 10 | 20 | 20 | 20 | |
| Indoor unit | Air flow | CMM | 11 - 12 - 13 - 15 | 12 - 14 - 16 - 18 | 12 - 14 - 16 - 18 | 14 - 16 - 18 - 21 | |
| | (Low-Medium2-Medium1-High) | CFM | 390 - 425 - 460 - 530 | 425 - 495 - 565 - 635 | 425 - 495 - 565 - 635 | 495 - 565 - 635 - 740 | |
| | External static pressure | Pa | 0 | 0 | 0 | 0 | |
| | Sound level | dB(A) | 27 - 28 - 29 - 31 | 28 - 29 - 31 - 32 | 28 - 29 - 31 - 32 | 28 - 30 - 32 - 34 | |
| | (Low-Medium2-Medium1-High) | | | | | | |
| | External finish (Panel) | | White Munsell 6.4Y 8.9/0.4 | | | | |
| | Dimension | W : mm | | 840 (950) | | | |
| | | D : mm | | 840 (950) | | | |
| | | H : mm | | 258 (35) | | | |
| | | W : inch | | 33 - 1/16 (37 - 3/8) | | | |
| | | D : inch | | 33 - 1/16 (37 - 3/8) | | | |
| | Unit (Panel) | H : inch | | 10 - 3/16 (1 - 3/8) | | | |
| | | | | | | | |
| Weight | kg | | 22 (6) | | 23 (6) | | |
| Unit (Panel) | lbs | | 49 (13) | | 51 (13) | | |
| Field drain pipe O.D. | mm | | 32 | | | | |
| | inch | | 1 - 1/4 | | | | |
| Outdoor unit | Air flow at cooling | CMM | 33.4 | 27.5 - 49 | 27.5 - 49 | 27.5 - 49 | |
| | | CFM | 1,180 | 970 - 1,730 | 970 - 1,730 | 970 - 1,730 | |
| | Air flow at heating | CMM | 33.4 | 36.8 - 49 | 36.8 - 49 | 36.8 - 49 | |
| | | CFM | 1,180 | 1,300 - 1,730 | 1,300 - 1,730 | 1,300 - 1,730 | |
| | Sound level at cooling | dB(A) | 47 | 51 - 53 | 51 - 53 | 51 - 53 | |
| | | | | | | | |
| | Sound level at heating | dB(A) | 48 | 53 - 55 | 53 - 55 | 53 - 55 | |
| | | | | | | | |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 | | | | |
| | Dimension | W : mm | 800 | 840 | 840 | 840 | |
| | | D : mm | 285 | 330 | 330 | 330 | |
| | | H : mm | 550 | 850 | 850 | 850 | |
| | | W : inch | 31 - 1/2 | 33 - 1/16 | 33 - 1/16 | 33 - 1/16 | |
| D : inch | | 11 - 1/4 | 13 | 13 | 13 | | |
| Unit (Panel) | H : inch | 21 - 5/8 | 33 - 7/16 | 33 - 7/16 | 33 - 7/16 | | |
| | | | | | | | |
| Weight | kg | 37 | 53 | 53 | 58 | | |
| | lbs | 82 | 117 | 117 | 128 | | |
| Refrigerant pipe size | Gas side O.D. | mm | 9.52 | 12.7 | 15.88 | 15.88 | |
| | | inch | 3/8 | 1/2 | 5/8 | 5/8 | |
| | Liquid side O.D. | mm | 6.35 | 6.35 | 6.35 | 9.52 | |
| | | inch | 1/4 | 1/4 | 1/4 | 3/8 | |
| Refrigerant pipe length | Height difference | m | Max. 12 | Max. 30 | Max. 30 | Max. 30 | |
| | Length | m | Max. 20 | Max. 30 | Max. 30 | Max. 30 | |

NOTE: 1. Rating conditions (ISO T1)
Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)
Heating Indoor : D.B. 20°C (68°F) Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)
Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

| | | Indoor | Outdoor | |
|---------|-------------|-----------------------|-------------------------|------------------|
| | | | KA35VA | KA50, KA60, KA71 |
| Cooling | Upper limit | 32°C D.B. , 23°C W.B. | 46°C D.B. | 43°C D.B. |
| | Lower limit | 21°C D.B. , 15°C W.B. | -10°C D.B. | -15°C D.B. |
| Heating | Upper limit | 27°C D.B. | 24°C D.B. , 18°C W.B. | |
| | Lower limit | 20°C D.B. | -10°C D.B. , -11°C W.B. | |

3. Guaranteed voltage
198~264V, 50Hz

4. Above data are based on the indicated voltage.
Indoor unit Single phase, 230V 50Hz
Outdoor unit Single phase, 230V 50Hz

| Model name | Indoor unit | | PLA-RP35AA | PLA-RP50AA | PLA-RP60AA | PLA-RP71AA |
|-------------------------|---|----------|-------------------------------|-----------------------|-----------------------|-----------------------|
| | Outdoor unit | | SUZ-KA35VA | SUZ-KA50VA | SUZ-KA60VA | SUZ-KA71VA |
| Cooling | Capacity | Btu/h | 11,900 | 17,100 | 19,400 | 24,200 |
| | | kW | 3.5(1.0 - 3.9) | 5.0(1.1 - 5.6) | 5.7(1.1 - 6.3) | 7.1(0.9 - 8.1) |
| | Total input | kW | 1.09 | 1.78 | 1.94 | 2.53 |
| | EER | | 3.21 | 2.81 | 2.94 | 2.81 |
| | Energy label class | | A | C | C | C |
| Heating | Capacity | Btu/h | 14,000 | 20,500 | 23,500 | 27,300 |
| | | kW | 4.1(0.9 - 5.0) | 6.0(0.9 - 7.2) | 6.9(0.9 - 8.0) | 8.0(0.9 - 10.2) |
| | Total input | kW | 1.11 | 1.76 | 2.11 | 2.49 |
| | COP | | 3.69 | 3.41 | 3.27 | 3.21 |
| | Energy label class | | A | B | C | C |
| Power supply | Booster heater | kW | - | - | - | - |
| | Phase | φ | 1 | 1 | 1 | 1 |
| | Cycle | Hz | 50 | 50 | 50 | 50 |
| | Voltage | V | 230 | 230 | 230 | 130 |
| Indoor unit | Air flow (Low-Medium2-Medium1-High) | CMM | 11 - 12 - 13 - 14 | 14 - 15 - 16 - 18 | 14 - 15 - 16 - 18 | 15 - 16 - 18 - 20 |
| | | CFM | 390 - 425 - 460 - 495 | 495 - 530 - 565 - 635 | 495 - 530 - 565 - 635 | 530 - 565 - 635 - 705 |
| | External static pressure | Pa | 0 | 0 | 0 | 0 |
| | Sound level (Low-Medium2-Medium1-High) | dB(A) | 27 - 28 - 29 - 31 | 28 - 29 - 31 - 33 | 28 - 29 - 31 - 33 | 28 - 30 - 32 - 34 |
| | External finish (Panel) | | White Munsell 0.70Y 8.59/0.97 | | | |
| | Dimension Unit (Panel) | W : mm | 840 (950) | | | |
| | | D : mm | 840 (950) | | | |
| | | H : mm | 258 (30) | | | |
| | | W : inch | 33 - 1/16 (37 - 3/8) | | | |
| | | D : inch | 33 - 1/16 (37 - 3/8) | | | |
| | Weight Unit (Panel) | H : inch | 10 - 3/16 (1 - 3/16) | | | |
| kg | | 24 (5) | | | | |
| | lbs | 53 (11) | | | | |
| Field drain pipe O.D. | mm | 32 | | | | |
| | inch | 1 - 1/4 | | | | |
| Outdoor unit | Air flow at cooling (Low - High) | CMM | 33.4 | 27.5 - 49 | 27.5 - 49 | 27.5 - 49 |
| | | CFM | 1,180 | 970 - 1,730 | 970 - 1,730 | 970 - 1,730 |
| | Air flow at heating (Low - High) | CMM | 33.4 | 36.8 - 49 | 36.8 - 49 | 36.8 - 49 |
| | | CFM | 1,180 | 1,300 - 1,730 | 1,300 - 1,730 | 1,300 - 1,730 |
| | Sound level at cooling (Low - High) | dB(A) | 47 | 51 - 53 | 51 - 53 | 51 - 53 |
| | Sound level at heating (Low - High) | dB(A) | 48 | 53 - 55 | 53 - 55 | 53 - 55 |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 | | | |
| | Dimension | W : mm | 800 | 840 | 840 | 840 |
| | | D : mm | 285 | 330 | 330 | 330 |
| | | H : mm | 550 | 850 | 850 | 850 |
| | | W : inch | 31 - 1/2 | 33 - 1/16 | 33 - 1/16 | 33 - 1/16 |
| D : inch | | 11 - 1/4 | 13 | 13 | 13 | |
| Weight | H : inch | 21 - 5/8 | 33 - 7/16 | 33 - 7/16 | 33 - 7/16 | |
| | kg | 37 | 53 | 53 | 58 | |
| | lbs | 82 | 117 | 117 | 128 | |
| Refrigerant pipe size | Gas side O.D. | mm | 9.52 | 12.7 | 15.88 | 15.88 |
| | | inch | 3/8 | 1/2 | 5/8 | 5/8 |
| | Liquid side O.D. | mm | 6.35 | 6.35 | 6.35 | 9.52 |
| | | inch | 1/4 | 1/4 | 1/4 | 3/8 |
| Refrigerant pipe length | Height difference | m | Max. 12 | Max. 30 | Max. 30 | Max. 30 |
| | Length | m | Max. 20 | Max. 30 | Max. 30 | Max. 30 |

NOTE: 1. Rating conditions (ISO T1)
Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)
Heating Indoor : D.B. 20°C (68°F) Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)
Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

| | | Indoor | Outdoor | |
|---------|-------------|-----------------------|-------------------------|------------------|
| | | | KA35VA | KA50, KA60, KA71 |
| Cooling | Upper limit | 32°C D.B. , 23°C W.B. | 46°C D.B. | 43°C D.B. |
| | Lower limit | 21°C D.B. , 15°C W.B. | -10°C D.B. | -15°C D.B. |
| Heating | Upper limit | 27°C D.B. | 24°C D.B. , 18°C W.B. | |
| | Lower limit | 20°C D.B. | -10°C D.B. , -11°C W.B. | |

3. Guaranteed voltage
198-264V, 50Hz

4. Above data are based on the indicated voltage.
Indoor unit Single phase, 230V 50Hz
Outdoor unit Single phase, 230V 50Hz

2-3. CEILING-SUSPENDED TYPE

| Model name | Indoor unit | PCA-RP50GA | PCA-RP50GA2 | PCA-RP60GA | PCA-RP71GA | |
|-------------------------|---|------------|-------------------------------|-----------------------|----------------|-----------------|
| | Outdoor unit | SUZ-KA50VA | SUZ-KA50VA | SUZ-KA60VA | SUZ-KA71VA | |
| Cooling | Capacity | Btu/h | 16,000 | 17,000 | 18,800 | 24,200 |
| | | kW | 4.7(1.1 - 5.4) | 5.0(1.1 - 5.6) | 5.5(1.1 - 6.3) | 7.1(0.9 - 8.1) |
| | Total input | kW | 1.80 | 1.78 | 1.92 | 2.53 |
| | EER | | 2.61 | 2.81 | 2.86 | 2.81 |
| | Energy label class | | D | C | C | C |
| | SHF | | 0.70 | 0.81 | 0.79 | 0.71 |
| Heating | Capacity | Btu/h | 18,800 | 20,500 | 23,500 | 27,300 |
| | | kW | 5.5(0.9 - 6.6) | 6.0(0.9 - 7.2) | 6.9(0.9 - 8.0) | 8.0(0.9 - 10.2) |
| | Total input | kW | 1.92 | 1.76 | 2.05 | 2.49 |
| | COP | | 2.86 | 3.41 | 3.37 | 3.21 |
| | Energy label class | | D | B | C | C |
| | Booster heater | kW | - | - | - | - |
| Power supply | Phase | ϕ | 1 | | | |
| | Cycle | Hz | 50 | | | |
| | Voltage | V | 230 | | | |
| | Breaker size | A | 20 | | | |
| Indoor unit | Air flow (Low-Medium2-Medium1-High) | CMM | 10 - 11 - 12 - 13 | 14 - 15 - 16 - 18 | | |
| | | CFM | 355 - 390 - 425 - 460 | 495 - 530 - 565 - 635 | | |
| | External static pressure | Pa | 0 | | | |
| | Sound level (Low-Medium2-Medium1-High) | dB(A) | 37 - 38 - 40 - 42 | 37 - 39 - 41 - 43 | | |
| | External finish | | White Munsell 0.70Y 8.59/0.97 | | | |
| | Dimension | W : mm | 1000 | 1310 | | |
| | | D : mm | | 680 | | |
| | | H : mm | | 210 | | |
| | | W : inch | 39 - 3/8 | 51 - 9/16 | | |
| | | D : inch | | 26 - 3/4 | | |
| | | H : inch | | 8 - 1/4 | | |
| | Weight | kg | 27 | 34 | | |
| | | lbs | 60 | 75 | | |
| Field drain pipe O.D. | mm | 26 | | | | |
| | inch | 1 | | | | |
| Outdoor unit | Air flow at cooling (Low - High) | CMM | 27.5 - 49 | 27.5 - 49 | 27.5 - 49 | 27.5 - 49 |
| | | CFM | 970 - 1,730 | 970 - 1,730 | 970 - 1,730 | 970 - 1,730 |
| | Air flow at heating (Low - High) | CMM | 36.8 - 49 | 36.8 - 49 | 36.8 - 49 | 36.8 - 49 |
| | | CFM | 1,300 - 1,730 | 970 - 1,730 | 1,300 - 1,730 | 1,300 - 1,730 |
| | Sound level at cooling (Low - High) | dB(A) | 51 - 53 | 51 - 53 | 51 - 53 | 51 - 53 |
| | Sound level at heating (Low - High) | dB(A) | 53 - 55 | 53 - 55 | 53 - 55 | 53 - 55 |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 | | | |
| | Dimension | W : mm | 840 | 840 | 840 | 840 |
| | | D : mm | 330 | 330 | 330 | 330 |
| | | H : mm | 850 | 850 | 850 | 850 |
| | | W : inch | 33 - 1/16 | 33 - 1/16 | 33 - 1/16 | 33 - 1/16 |
| | | D : inch | 13 | 13 | 13 | 13 |
| | | H : inch | 33 - 7/16 | 33 - 7/16 | 33 - 7/16 | 33 - 7/16 |
| Weight | kg | 53 | 53 | 53 | 58 | |
| | lbs | 117 | 117 | 117 | 128 | |
| Refrigerant pipe size | Gas side O.D. | mm | 12.7 | 12.7 | 15.88 | 15.88 |
| | | inch | 1/2 | 1/2 | 5/8 | 5/8 |
| | Liquid side O.D. | mm | 6.35 | 6.35 | 6.35 | 9.52 |
| | | inch | 1/4 | 1/4 | 1/4 | 3/8 |
| Refrigerant pipe length | Height difference | m | Max. 30 | Max. 30 | Max. 30 | Max. 30 |
| | Length | m | Max. 30 | Max. 30 | Max. 30 | Max. 30 |

NOTE: 1. Rating conditions (ISO T1)

Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

| | | Indoor | Outdoor |
|---------|-------------|----------------------|------------------------|
| Cooling | Upper limit | D.B. 32°C, W.B. 23°C | D.B. 43°C |
| | Lower limit | D.B. 21°C, W.B. 15°C | D.B. -15°C |
| Heating | Upper limit | D.B. 27°C | D.B. 24°C, W.B. 18°C |
| | Lower limit | D.B. 20°C | D.B. -10°C, W.B. -11°C |

3. Guaranteed voltage
198-264V, 50Hz

4. Above data are based on the indicated voltage.

Indoor unit Single phase, 230V 50Hz

Outdoor unit Single phase, 230V 50Hz

2-4. CEILING-CONCEALED TYPE

| Model name | Indoor unit | | SEZ-KD25VA(L) | SEZ-KD35VA(L) | SEZ-KD50VA(L) | SEZ-KD60VA(L) | SEZ-KD71VA(L) |
|-------------------------|--|----------|----------------------------|------------------|--------------------|--------------------|--------------------|
| | Outdoor unit | | SUZ-KA25VA | SUZ-KA35VA | SUZ-KA50VA | SUZ-KA60VA | SUZ-KA71VA |
| Cooling | Capacity | Btu/h | 8,500 | 11,900 | 17,100 | 18,800 | 24,200 |
| | | kW | 2.5(0.9 - 3.2) | 3.5(1.0 - 3.9) | 5.0(1.1 - 5.6) | 5.5(1.1 - 6.3) | 7.1(0.9 - 8.3) |
| | Total input | kW | 0.778 | 1.09 | 1.78 | 1.89 | 2.53 |
| | EER | | 3.21 | 3.21 | 2.81 | 2.91 | 2.81 |
| | Energy label class | | A | A | C | C | C |
| | SHF | | 0.80 | 0.78 | 0.76 | 0.79 | 0.74 |
| Heating | Capacity | Btu/h | 10,200 | 13,600 | 20,500 | 23,900 | 27,600 |
| | | kW | 3.0(0.9 - 4.5) | 4.0(0.9 - 5.0) | 6.0(1.1 - 7.2) | 7.0(0.9 - 8.0) | 8.1(0.9 - 10.4) |
| | Total input | kW | 0.83 | 1.108 | 1.87 | 2.05 | 2.37 |
| | COP | | 3.61 | 3.61 | 3.21 | 3.41 | 3.42 |
| | Energy label class | | A | A | C | B | B |
| | Booster heater | kW | - | - | - | - | - |
| Power supply | Phase | φ | 1 | 1 | 1 | 1 | 1 |
| | Cycle | Hz | 50 | 50 | 50 | 50 | 50 |
| | Voltage | V | 230 | 230 | 230 | 230 | 230 |
| | Breaker size | A | 10 | 10 | 20 | 20 | 20 |
| Indoor unit | Air flow (Low - Medium - High) | CMM | 5.5 - 7.0 - 9.0 | 7.0 - 9.0 - 11.0 | 10.0 - 12.5 - 15.0 | 12.0 - 15.0 - 18.0 | 12.0 - 16.0 - 20.0 |
| | | CFM | 190 - 250 - 320 | 250 - 320 - 390 | 350 - 440 - 530 | 420 - 530 - 640 | 420 - 570 - 710 |
| | External static pressure | Pa | 5 - 15 - 35 - 50 | 5 - 15 - 35 - 50 | 5 - 15 - 35 - 50 | 5 - 15 - 35 - 50 | 5 - 15 - 35 - 50 |
| | Sound level (Low - Medium - High) | dB(A) | 23 - 26 - 30 | 23 - 28 - 33 | 30 - 34 - 37 | 30 - 34 - 38 | 30 - 35 - 40 |
| | | | Galvanized sheets | | | | |
| | Dimension | W : mm | 700 | 900 | 900 | 1100 | 1100 |
| | | D : mm | 700 | 700 | 700 | 700 | 700 |
| | | H : mm | 200 | 200 | 200 | 200 | 200 |
| | | W : inch | 27 - 9/16 | 35 - 7/16 | 35 - 7/16 | 43 - 5/16 | 43 - 5/16 |
| | | D : inch | 27 - 9/16 | 27 - 9/16 | 27 - 9/16 | 27 - 9/16 | 27 - 9/16 |
| | | H : inch | 7 - 7/8 | 7 - 7/8 | 7 - 7/8 | 7 - 7/8 | 7 - 7/8 |
| | Weight | kg | 18 | 21 | 23 | 27 | 27 |
| | | lbs | 40 | 47 | 51 | 60 | 60 |
| Field drain pipe O.D. | mm | 32 | | | | | |
| | inch | 1 - 9/32 | | | | | |
| Outdoor unit | Air flow at cooling (Low - High) | CMM | 34.3 | 33.4 | 27.5 - 49 | 27.5 - 49 | 27.5 - 49 |
| | | CFM | 1,210 | 1,180 | 970 - 1,730 | 970 - 1,730 | 970 - 1,730 |
| | Air flow at heating (Low - High) | CMM | 32.3 | 33.4 | 36.8 - 49 | 36.8 - 49 | 36.8 - 49 |
| | | CFM | 1,140 | 1,180 | 1,300 - 1,730 | 1,300 - 1,730 | 1,300 - 1,730 |
| | Sound level at cooling (Low - High) | dB(A) | 46 | 47 | 51 - 53 | 51 - 53 | 51 - 53 |
| | | | | | | | |
| | Sound level at heating (Low - High) | dB(A) | 46 | 48 | 53 - 55 | 53 - 55 | 53 - 55 |
| | | | | | | | |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 | | | | |
| | Dimension | W : mm | 800 | 800 | 840 | 840 | 840 |
| D : mm | | 285 | 285 | 330 | 330 | 330 | |
| H : mm | | 550 | 550 | 850 | 850 | 850 | |
| W : inch | | 31 - 1/2 | 31 - 1/2 | 33 - 1/16 | 33 - 1/16 | 33 - 1/16 | |
| D : inch | | 11 - 1/4 | 11 - 1/4 | 13 | 13 | 13 | |
| H : inch | | 21 - 5/8 | 21 - 5/8 | 33 - 7/16 | 33 - 7/16 | 33 - 7/16 | |
| Weight | kg | 33 | 37 | 53 | 53 | 58 | |
| | lbs | 73 | 82 | 117 | 117 | 128 | |
| Refrigerant pipe size | Gas side O.D. | mm | 9.52 | 9.52 | 12.7 | 15.88 | 15.88 |
| | | inch | 3/8 | 3/8 | 1/2 | 5/8 | 5/8 |
| | Liquid side O.D. | mm | 6.35 | 6.35 | 6.35 | 6.35 | 9.52 |
| | | inch | 1/4 | 1/4 | 1/4 | 1/4 | 3/8 |
| Refrigerant pipe length | Height difference | m | Max. 12 | Max. 12 | Max. 30 | Max. 30 | Max. 30 |
| | Length | m | Max. 20 | Max. 20 | Max. 30 | Max. 30 | Max. 30 |

NOTE: 1. Rating conditions (ISO T1)

Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

| | | Indoor | Outdoor | |
|---------|-------------|----------------------|------------------------|------------------|
| | | | KA25, KA35VA | KA50, KA60, KA71 |
| Cooling | Upper limit | 32°C D.B., 23°C W.B. | 46°C D.B. | 43°C D.B. |
| | Lower limit | 21°C D.B., 15°C W.B. | -10°C D.B. | -15°C D.B. |
| Heating | Upper limit | 27°C D.B. | 24°C D.B., 18°C W.B. | |
| | Lower limit | 20°C D.B. | -10°C D.B., -11°C W.B. | |

3. Guaranteed voltage
198-264V, 50Hz

4. Above data are based on the indicated voltage.
Indoor unit Single phase, 230V 50Hz
Outdoor unit Single phase, 230V 50Hz

| Model name | Indoor unit | SEZ-KC25VA | SEZ-KA35VA | SEZ-KA50VA | SEZ-KA60VA | SEZ-KA71VA | |
|-------------------------|-------------------------------------|---------------------|----------------------------|---------------------|----------------|----------------|-----------------|
| | Outdoor unit | SUZ-KA25VA | SUZ-KA35VA | SUZ-KA50VA | SUZ-KA60VA | SUZ-KA71VA | |
| Cooling | Capacity | Btu/h | 8,500 | 11,900 | 17,100 | 18,800 | 24,200 |
| | | kW | 2.5(0.9 - 3.2) | 3.5(1.0 - 3.9) | 5.0(1.1 - 5.6) | 5.5(1.1 - 6.3) | 7.1(0.9 - 8.3) |
| | Total input | kW | 0.73 | 1.06 | 1.78 | 1.96 | 2.46 |
| | EER | | 3.42 | 3.30 | 2.81 | 2.81 | 2.89 |
| | Energy label class | | A | A | C | C | C |
| | SHF | | 0.74 | 0.77 | 0.75 | 0.75 | 0.74 |
| Heating | Capacity | Btu/h | 10,200 | 13,600 | 20,100 | 23,500 | 27,600 |
| | | kW | 3.0(0.9 - 4.5) | 4.0(0.9 - 5.0) | 5.9(1.1 - 7.2) | 6.9(0.9 - 8.0) | 8.1(0.9 - 10.4) |
| | Total input | kW | 0.83 | 1.10 | 1.84 | 2.45 | 2.36 |
| | COP | | 3.61 | 3.64 | 3.21 | 2.82 | 3.43 |
| | Energy label class | | A | A | C | D | B |
| | Booster heater | kW | - | - | - | - | - |
| Power supply | Phase | φ | 1 | 1 | 1 | 1 | 1 |
| | Cycle | Hz | 50 | 50 | 50 | 50 | 50 |
| | Voltage | V | 230 | 230 | 230 | 230 | 230 |
| | Breaker size | A | 10 | 10 | 20 | 20 | 20 |
| Indoor unit | Air flow (Low - High) | CMM | 4.8 - 7.9 | 10 - 13 | 12 - 17 | 12 - 20 | 12 - 20 |
| | | CFM | 170 - 280 | 355 - 460 | 425 - 600 | 425 - 705 | 425 - 705 |
| | External static pressure | Pa | Std:5 Max:5 | Std:30 Max:50 | Std:30 Max:50 | Std:30 Max:50 | Std:30 Max:50 |
| | Sound level (Low - High) | dB(A) | 25 - 36 | 30 - 35 | 31 - 39 | 32 - 43 | 32 - 43 |
| | External finish | | Galvanized sheets | | | | |
| | Dimension | W : mm | 790 | 1100 | | | |
| | | D : mm | 550 | 700 | | | |
| | | H : mm | 225 | 270 | | | |
| | | W : inch | 31 - 1/8 | 43 - 5/16 | | | |
| | | D : inch | 21 - 5/8 | 27 - 9/16 | | | |
| | | H : inch | 8 - 7/8 | 10 - 5/8 | | | |
| | Weight | kg | 19 | 33.5 | | | 35 |
| | | lbs | 42 | 74 | | | 77 |
| Unit drain pipe | | R1(External thread) | | R1(External thread) | | | |
| Outdoor unit | Air flow at cooling (Low - High) | CMM | 34.3 | 33.4 | 27.5 - 49 | 27.5 - 49 | 27.5 - 49 |
| | | CFM | 1,210 | 1,180 | 970 - 1,730 | 970 - 1,730 | 970 - 1,730 |
| | Air flow at heating (Low - High) | CMM | 32.3 | 33.4 | 36.8 - 49 | 36.8 - 49 | 36.8 - 49 |
| | | CFM | 1,140 | 1,180 | 1,300 - 1,730 | 1,300 - 1,730 | 1,300 - 1,730 |
| | Sound level at cooling (Low - High) | dB(A) | 46 | 47 | 51 - 53 | 51 - 53 | 51 - 53 |
| | Sound level at heating (Low - High) | dB(A) | 46 | 48 | 53 - 55 | 53 - 55 | 53 - 55 |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 | | | | |
| | Dimension | W : mm | 800 | 800 | 840 | 840 | 840 |
| | | D : mm | 285 | 285 | 330 | 330 | 330 |
| | | H : mm | 550 | 550 | 850 | 850 | 850 |
| | | W : inch | 31 - 1/2 | 31 - 1/2 | 33 - 1/16 | 33 - 1/16 | 33 - 1/16 |
| | | D : inch | 11 - 1/4 | 11 - 1/4 | 13 | 13 | 13 |
| | | H : inch | 21 - 5/8 | 21 - 5/8 | 33 - 7/16 | 33 - 7/16 | 33 - 7/16 |
| Weight | kg | 33 | 37 | 53 | 53 | 58 | |
| | lbs | 73 | 82 | 117 | 117 | 128 | |
| Refrigerant pipe size | Gas side O.D. | mm | 9.52 | 9.52 | 12.7 | 15.88 | 15.88 |
| | | inch | 3/8 | 3/8 | 1/2 | 5/8 | 5/8 |
| | Liquid side O.D. | mm | 6.35 | 6.35 | 6.35 | 6.35 | 9.52 |
| | | inch | 1/4 | 1/4 | 1/4 | 1/4 | 3/8 |
| Refrigerant pipe length | Height difference | m | Max. 12 | Max. 12 | Max. 30 | Max. 30 | Max. 30 |
| | Length | m | Max. 20 | Max. 20 | Max. 30 | Max. 30 | Max. 30 |

NOTE: 1. Rating conditions (ISO T1)

Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)


Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

| | | Indoor | | Outdoor | |
|---------|-------------|-----------------------|-------------------------|--------------|------------------|
| | | | | KA25, KA35VA | KA50, KA60, KA71 |
| Cooling | Upper limit | 32°C D.B. , 23°C W.B. | 46°C D.B. | 43°C D.B. | |
| | Lower limit | 21°C D.B. , 15°C W.B. | -10°C D.B. | -15°C D.B. | |
| Heating | Upper limit | 27°C D.B. | 24°C D.B. , 18°C W.B. | | |
| | Lower limit | 20°C D.B. | -10°C D.B. , -11°C W.B. | | |

3. Guaranteed voltage
198~264V, 50Hz

4. Above data are based on the indicated voltage.
Indoor unit Single phase, 230V 50Hz
Outdoor unit Single phase, 230V 50Hz



| | | | | | | | |
|-------------------------|--------------------------|---------------------|----------------------------|---------------------|-------------------|-------------------|------|
| Model name | Indoor unit | | PEAD-RP35EA2 | PEAD-RP50EA | PEAD-RP60EA | PEAD-RP71EA | |
| | Outdoor unit | | SUZ-KA35VA | SUZ-KA50VA | SUZ-KA60VA | SUZ-KA71VA | |
| Cooling | Capacity | Btu/h | 12,300 | 16,700 | 20,500 | 24,200 | |
| | | kW | 3.6(1.0 - 3.9) | 4.9(1.1 - 5.6) | 6.0(1.1 - 6.3) | 7.1(0.9 - 8.1) | |
| | Total input | kW | 1.12 | 1.74 | 2.05 | 2.53 | |
| | EER | | | 3.21 | 2.82 | 2.93 | 2.81 |
| | Energy label class | | | A | C | C | C |
| | SHF | | | 0.90 | 0.79 | 0.80 | 0.81 |
| Heating | Capacity | Btu/h | 14,000 | 20,100 | 23,900 | 27,300 | |
| | | kW | 4.1(0.9 - 5.0) | 5.9(0.9 - 7.2) | 7.0(0.9 - 8.0) | 8.0(0.9 - 10.2) | |
| | Total input | kW | 1.13 | 1.69 | 2.07 | 2.49 | |
| | COP | | | 3.63 | 3.49 | 3.38 | 3.21 |
| | Energy label class | | | A | B | C | C |
| | Booster heater | | kW | - | - | - | - |
| Power supply | Phase | φ | 1 | 1 | 1 | 1 | |
| | Cycle | Hz | 50 | 50 | 50 | 50 | |
| | Voltage | V | 230 | 230 | 230 | 230 | |
| | Breaker size | A | 10 | 20 | 20 | 20 | |
| Indoor unit | Air flow | CMM | 13.5 - 17 | | 17 - 21 | 20 - 25 | |
| | (Low - High) | CFM | 476 - 600 | | 600 - 741 | 706 - 883 | |
| | External static pressure | Pa | 30(70) | | 30(70) | 70(130) | |
| | Sound level | dB(A) | 36 - 40 | | 37 - 41 | 37 - 41 | |
| | (Low - High) | | (70Pa : 38 - 44) | | (70Pa : 39 - 46) | (130Pa : 40 - 45) | |
| | External finish | | Galvanized sheets | | Galvanized sheets | | |
| | Dimension | W : mm | 935 | | 1175 | | |
| | | D : mm | 700 | | 700 | 740 | |
| | | H : mm | 295 | | 295 | 325 | |
| | | W : inch | 36 - 13/16 | | 46 - 1/8 | | |
| | | D : inch | 27 - 5/8 | | 27 - 5/8 | 29 - 1/8 | |
| H : inch | | 11 - 5/8 | | 11 - 5/8 | 12 - 13/16 | | |
| Weight | kg | 33 | 35 | 42 | 44 | | |
| | lbs | 73 | 77 | 92 | 97 | | |
| Unit drain pipe | | R1(External thread) | | R1(External thread) | | | |
| Outdoor unit | Air flow at cooling | CMM | 33.4 | 27.5 - 49 | 27.5 - 49 | 27.5 - 49 | |
| | (Low - High) | CFM | 1,180 | 970 - 1,730 | 970 - 1,730 | 970 - 1,730 | |
| | Air flow at heating | CMM | 33.4 | 36.8 - 49 | 36.8 - 49 | 36.8 - 49 | |
| | (Low - High) | CFM | 1,180 | 1,300 - 1,730 | 1,300 - 1,730 | 1,300 - 1,730 | |
| | Sound level at cooling | dB(A) | 47 | 51 - 53 | 51 - 53 | 51 - 53 | |
| | (Low - High) | | | | | | |
| | Sound level at heating | dB(A) | 48 | 53 - 55 | 53 - 55 | 53 - 55 | |
| | (Low - High) | | | | | | |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 | | | | |
| | Dimension | W : mm | 800 | 840 | 840 | 840 | |
| | | D : mm | 285 | 330 | 330 | 330 | |
| H : mm | | 550 | 850 | 850 | 850 | | |
| W : inch | | 31 - 1/2 | 33 - 1/16 | 33 - 1/16 | 33 - 1/16 | | |
| D : inch | | 11 - 1/4 | 13 | 13 | 13 | | |
| H : inch | | 21 - 5/8 | 33 - 7/16 | 33 - 7/16 | 33 - 7/16 | | |
| Weight | kg | 37 | 53 | 53 | 58 | | |
| | lbs | 82 | 117 | 117 | 128 | | |
| Refrigerant pipe size | Gas side O.D. | mm | 9.52 | 12.7 | 15.88 | 15.88 | |
| | | inch | 3/8 | 1/2 | 5/8 | 5/8 | |
| | Liquid side O.D. | mm | 6.35 | 6.35 | 6.35 | 9.52 | |
| | | inch | 1/4 | 1/4 | 1/4 | 3/8 | |
| Refrigerant pipe length | Height difference | m | Max. 12 | Max. 30 | Max. 30 | Max. 30 | |
| | Length | m | Max. 20 | Max. 30 | Max. 30 | Max. 30 | |

NOTE: 1. Rating conditions (ISO T1)
Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)
Heating Indoor : D.B. 20°C (68°F) Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)
Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

| | | Indoor | Outdoor | |
|---------|-------------|-----------------------|-------------------------|------------------|
| | | | KA25, KA35VA | KA50, KA60, KA71 |
| Cooling | Upper limit | 32°C D.B. , 23°C W.B. | 46°C D.B. | 43°C D.B. |
| | Lower limit | 21°C D.B. , 15°C W.B. | -10°C D.B. | -15°C D.B. |
| Heating | Upper limit | 27°C D.B. | 24°C D.B. , 18°C W.B. | |
| | Lower limit | 20°C D.B. | -10°C D.B. , -11°C W.B. | |

3. Guaranteed voltage
198-264V, 50Hz

4. Above data are based on the indicated voltage.
Indoor unit Single phase, 230V 50Hz
Outdoor unit Single phase, 230V 50Hz

| Model name | Indoor unit | | PEAD-RP60GA | PEAD-RP71GA | |
|-------------------------|--|---------------------|----------------------------|-------------------------|--|
| | Outdoor unit | | SUZ-KA60VA | SUZ-KA71VA | |
| Cooling | Capacity | Btu/h | 19,400 | 24,200 | |
| | | kW | 5.7(1.1 - 6.3) | 7.1(0.9 - 8.1) | |
| | Total input | kW | 2.03 | 2.53 | |
| | EER | | 2.81 | 2.81 | |
| | Energy label class | | C | C | |
| | SHF | | 0.82 | 0.81 | |
| Heating | Capacity | Btu/h | 23,900 | 27,300 | |
| | | kW | 7.0(0.9 - 8.0) | 8.0(0.9 - 10.2) | |
| | Total input | kW | 2.05 | 2.49 | |
| | COP | | 3.41 | 3.21 | |
| | Energy label class | | B | C | |
| | Booster heater | kW | - | - | |
| Power supply | Phase | φ | 1 | | |
| | Cycle | Hz | 50 | | |
| | Voltage | V | 230 | | |
| | Breaker size | A | 20 | | |
| Indoor unit | Air flow (Low - High) | CMM | 16.5 - 21 | 20 - 25 | |
| | | CFM | 582 - 741 | 706 - 883 | |
| | External static pressure | Pa | 10/50/70 | | |
| | Sound level (Low - High) | dB(A) | 33 - 37/35 - 40/36 - 42 | 35 - 38/37 - 41/37 - 43 | |
| | | | (10/50/70Pa) | (10/50/70Pa) | |
| | External finish | | Galvanized sheets | | |
| | Dimension | W : mm | 1171 | | |
| | | D : mm | 740 | | |
| | | H : mm | 275 | | |
| | | W : inch | 46 - 1/8 | | |
| | | D : inch | 29 - 1/8 | | |
| H : inch | | 10 - 13/16 | | | |
| Weight | kg | 42 | | | |
| | lbs | 93 | | | |
| Unit drain pipe | | R1(External thread) | | | |
| Outdoor unit | Air flow at cooling (Low - High) | CMM | 27.5 - 49 | 27.5 - 49 | |
| | | CFM | 970 - 1,730 | 970 - 1,730 | |
| | Air flow at heating (Low - High) | CMM | 36.8 - 49 | 36.8 - 49 | |
| | | CFM | 1,300 - 1,730 | 1,300 - 1,730 | |
| | Sound level at cooling (Low - High) | dB(A) | 51 - 53 | | |
| | | | 51 - 53 | | |
| | Sound level at heating (Low - High) | dB(A) | 53 - 55 | | |
| | | | 53 - 55 | | |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 | | |
| | Dimension | W : mm | 840 | | |
| | | D : mm | 330 | | |
| H : mm | | 850 | | | |
| W : inch | | 33 - 1/16 | | | |
| D : inch | | 13 | | | |
| H : inch | | 33 - 7/16 | | | |
| Weight | kg | 53 | | | |
| | lbs | 117 | | | |
| Refrigerant pipe size | Gas side O.D. | mm | 15.88 | | |
| | | inch | 5/8 | | |
| | Liquid side O.D. | mm | 6.35 | | |
| | | inch | 1/4 | | |
| Refrigerant pipe length | Height difference | m | Max. 30 | | |
| | Length | m | Max. 30 | | |

NOTE: 1. Rating conditions (ISO T1)

Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F)

Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)

Heating Indoor : D.B. 20°C (68°F)

Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)

Refrigerant piping length (one way) : 5m (16ft.)

2. Guaranteed operating range

| | | Indoor | Outdoor |
|---------|-------------|-----------------------|-------------------------|
| Cooling | Upper limit | 32°C D.B. , 23°C W.B. | KA60, KA71 43°C D.B. |
| | Lower limit | 21°C D.B. , 15°C W.B. | -15°C D.B. |
| Heating | Upper limit | 27°C D.B. | 24°C D.B. , 18°C W.B. |
| | Lower limit | 20°C D.B. | -10°C D.B. , -11°C W.B. |

3. Guaranteed voltage
198~264V, 50Hz

4. Above data are based on the indicated voltage.

Indoor unit Single phase, 230V 50Hz
Outdoor unit Single phase, 230V 50Hz

| | | | |
|-------------------------|--|---------------------|----------------------------|
| Model name | Indoor unit | | PEA-RP71EA |
| | Outdoor unit | | SUZ-KA71VA |
| Cooling | Capacity | Btu/h | 23,500 |
| | | kW | 6.9 |
| | Total input | kW | 2.90 |
| | EER | | 2.38 |
| | SHF | | 0.84 |
| Heating | Capacity | Btu/h | 27,300 |
| | | kW | 8.0 |
| | Total input | kW | 2.49 |
| | COP | | 3.21 |
| | Booster heater | kW | - |
| Power supply | Phase | φ | 1 |
| | Cycle | Hz | 50 |
| | Voltage | V | 230 |
| | Breaker size | A | 20 |
| Indoor unit | Air flow | CMM | 22 - 27 |
| | (Low - High) | R/s | 367 - 450 |
| | External static pressure | Pa | 125 |
| | Sound level (Low - High) | dB(A) | 52 - 55 |
| | External finish | | Galvanized sheets |
| | Dimension | W : mm | 785 |
| | | D : mm | 690 |
| | | H : mm | 428 |
| | | W : inch | 31 |
| | | D : inch | 27 - 1/16 |
| | | H : inch | 16 - 7/8 |
| | Weight | kg | 46 |
| | | lbs | 101 |
| Unit drain pipe | | R1(External therad) | |
| Outdoor unit | Air flow at cooling (Low - High) | CMM | 27.5 - 49 |
| | | CFM | 970 - 1,730 |
| | Air flow at heating (Low - High) | CMM | 36.8 - 49 |
| | | CFM | 1,300 - 1,730 |
| | Sound level at cooling (Low - High) | dB(A) | 51 - 53 |
| | Sound level at heating (Low - High) | dB(A) | 53 - 55 |
| | External finish | | Ivory Munsell 3.0Y 7.8/1.1 |
| | Dimension | W : mm | 840 |
| | | D : mm | 330 |
| | | H : mm | 850 |
| | | W : inch | 33 - 1/16 |
| | | D : inch | 13 |
| | | H : inch | 33 - 7/16 |
| Weight | kg | 58 | |
| | lbs | 128 | |
| Refrigerant pipe size | Gas side O.D. | mm | 15.88 |
| | | inch | 5/8 |
| | Liquid side O.D. | mm | 9.52 |
| | | inch | 3/8 |
| Refrigerant pipe length | Height difference | m | Max. 30 |
| | Length | m | Max. 30 |

- NOTE:**
- Rating conditions (ISO T1)
Cooling Indoor : D.B. 27°C (80°F) W.B. 19°C (66°F) Outdoor : D.B. 35°C (95°F) W.B. 24°C (75°F)
Heating Indoor : D.B. 20°C (68°F) Outdoor : D.B. 7°C (45°F) W.B. 6°C (43°F)
Refrigerant piping length (one way) : 5m (16ft.)
 - Guaranteed operating range

| | | Indoor | Outdoor |
|---------|-------------|-----------------------|-------------------------|
| Cooling | Upper limit | 32°C D.B. , 23°C W.B. | 43°C D.B. |
| | Lower limit | 21°C D.B. , 15°C W.B. | -15°C D.B. |
| | | | |
| Heating | Upper limit | 27°C D.B. | 24°C D.B. , 18°C W.B. |
| | Lower limit | 20°C D.B. | -10°C D.B. , -11°C W.B. |

- Guaranteed voltage
198-264V, 50Hz

- Above data are based on the indicated voltage.
Indoor unit Single phase, 230V 50Hz
Outdoor unit Single phase, 230V 50Hz


3

OUTLINES AND DIMENSIONS

INDOOR UNIT


Unit : mm

MFZ-KA25VA
MFZ-KA35VA
MFZ-KA50VA

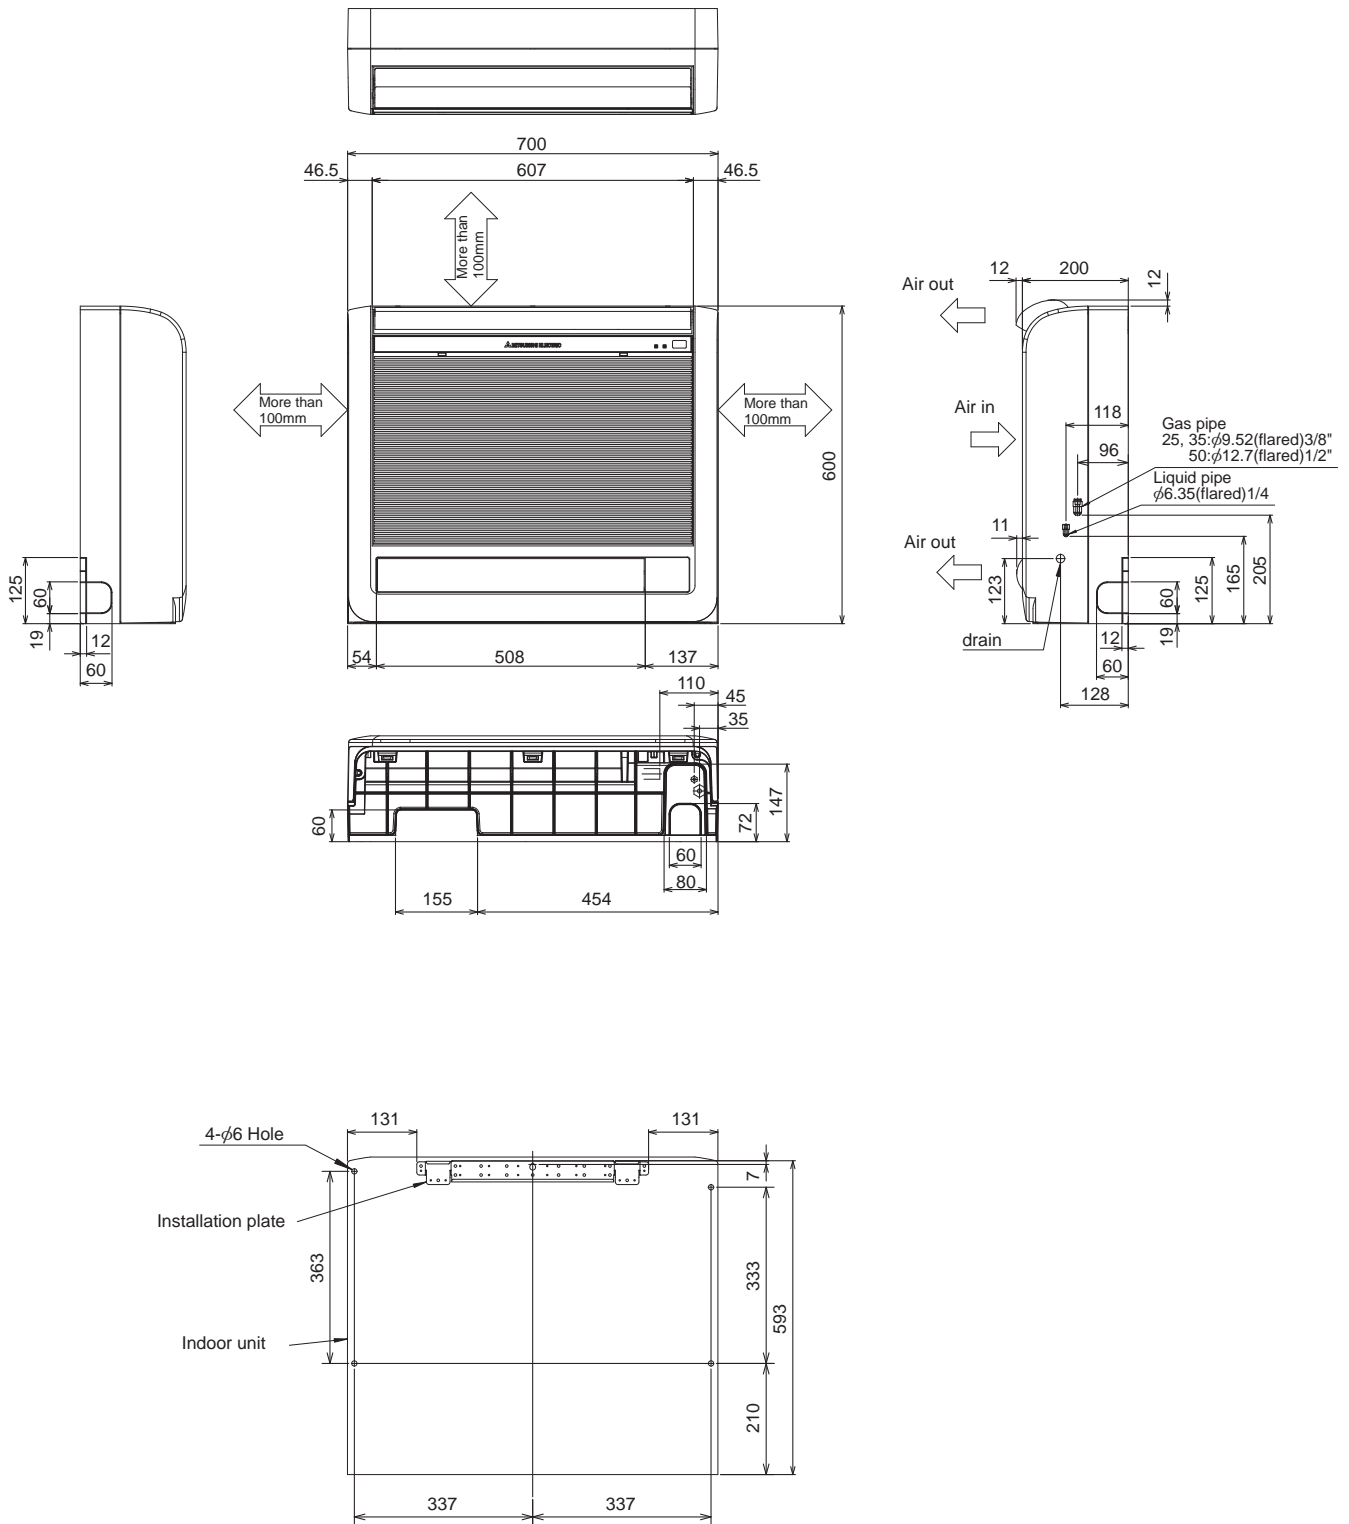

SLZ-KA25VAL
 SLZ-KA35VAL
 SLZ-KA50VAL
 SLZ-KA25VA
 SLZ-KA35VA
 SLZ-KA50VA


Unit : mm

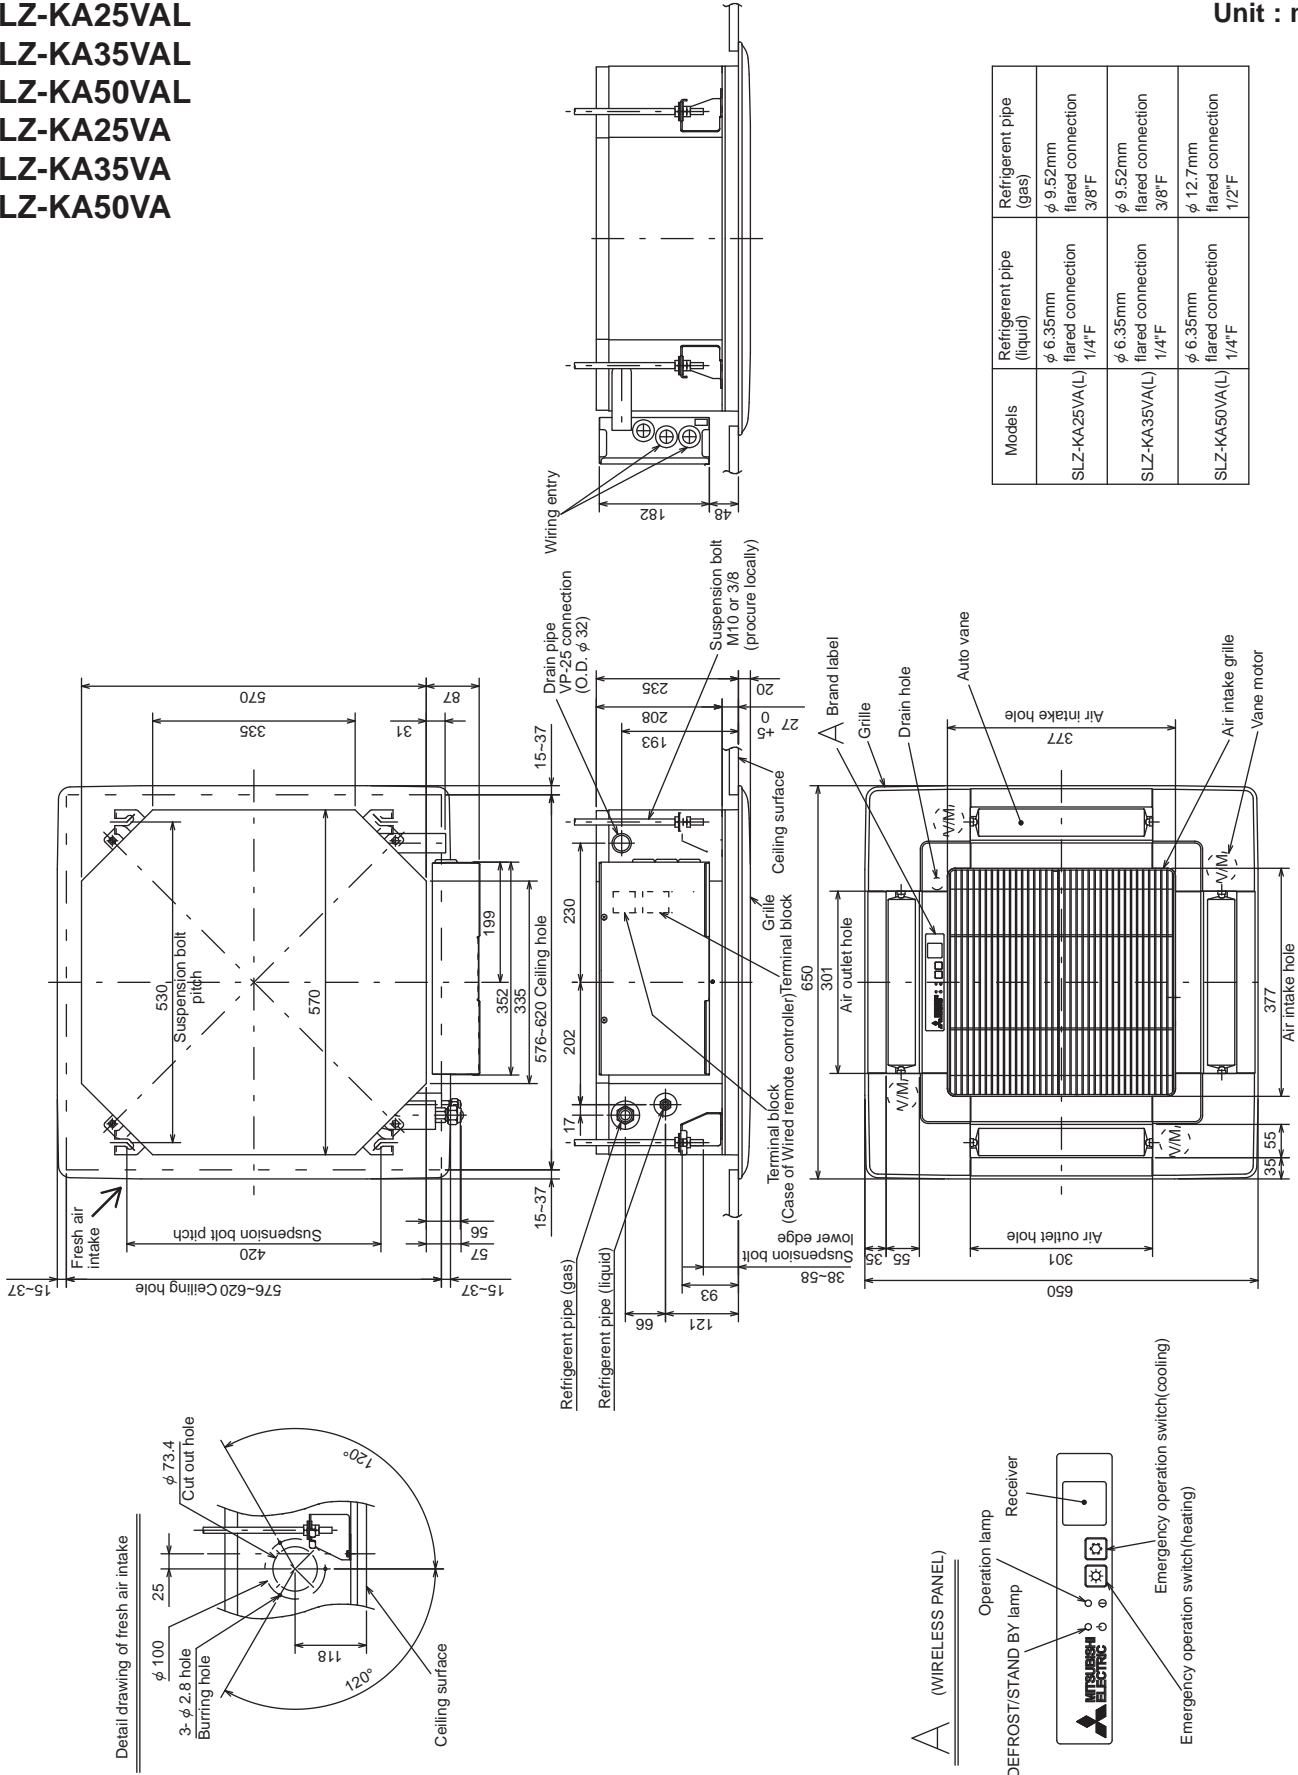

| Models | Refrigerant pipe (liquid) | Refrigerant pipe (gas) |
|----------------|----------------------------------|----------------------------------|
| SLZ-KA25VAL(L) | φ 6.35mm flared connection 1/4"F | φ 9.52mm flared connection 3/8"F |
| SLZ-KA35VAL(L) | φ 6.35mm flared connection 1/4"F | φ 9.52mm flared connection 3/8"F |
| SLZ-KA50VAL(L) | φ 6.35mm flared connection 1/4"F | φ 12.7mm flared connection 1/2"F |

SEZ-KD25VA(L)
SEZ-KD35VA(L)
SEZ-KD50VA(L)
SEZ-KD60VA(L)
SEZ-KD71VA(L)

Unit : mm

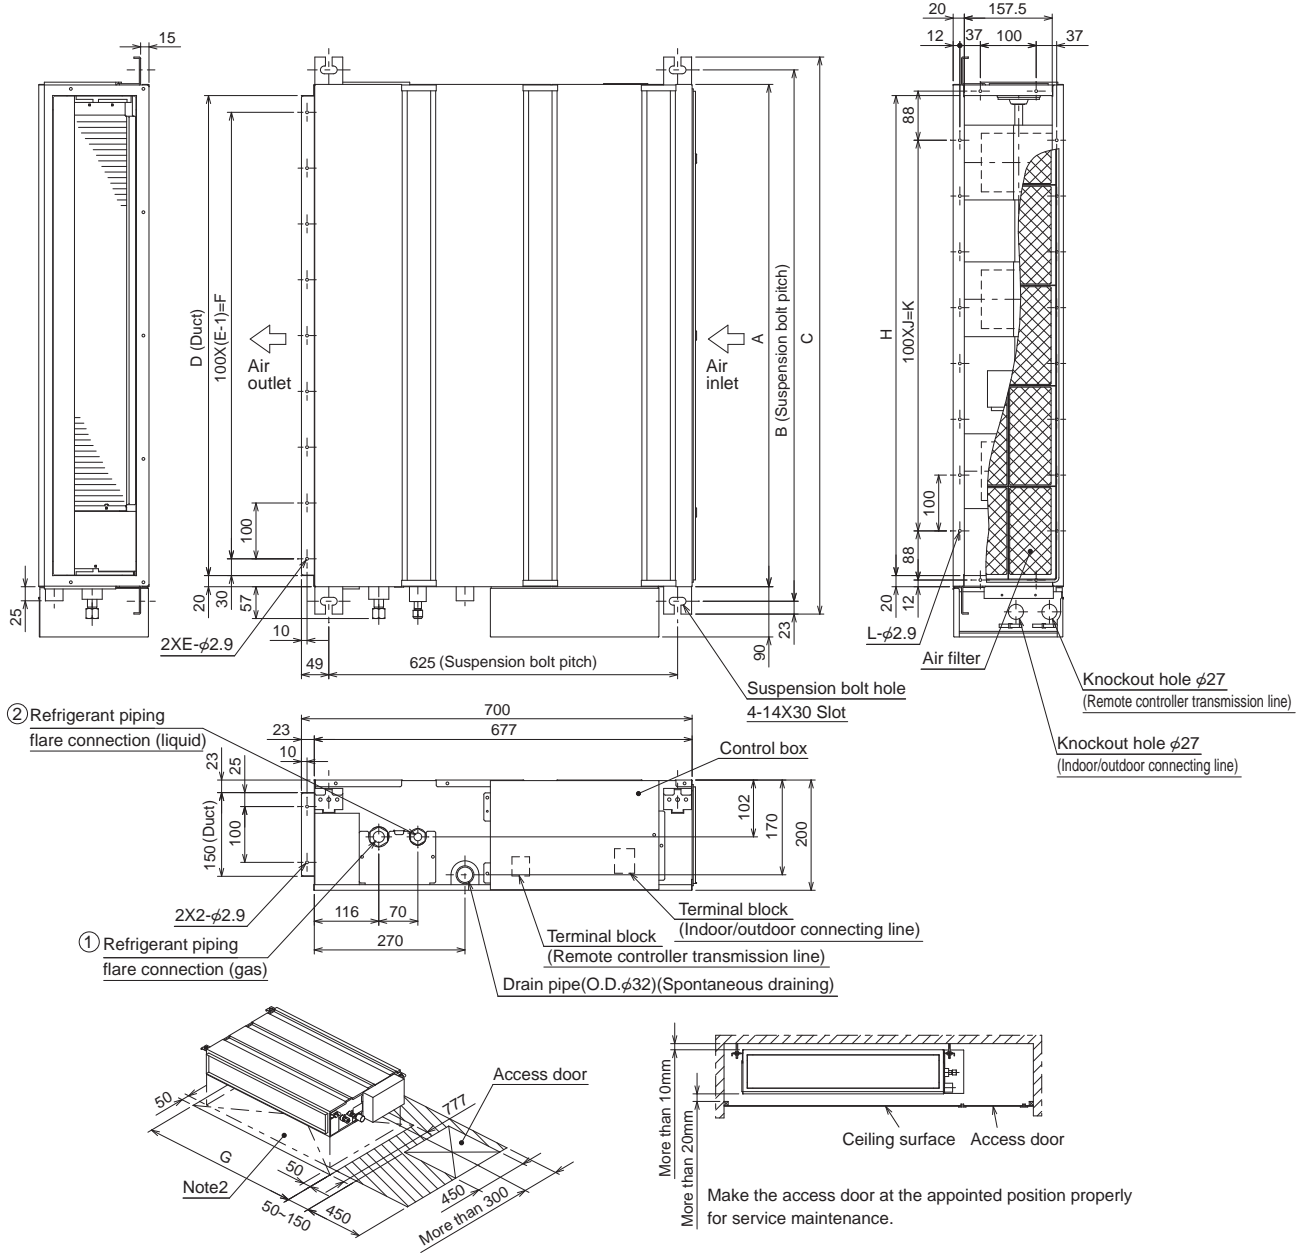

Required space for service and maintenance

| Model | A | B | C | D | E | F | G | H | J | K | L | ① Gas pipe | ② Liquid pipe |
|---------------|------|------|------|------|----|------|------|------|---|-----|----|------------|---------------|
| SEZ-KD25VA(L) | 700 | 752 | 798 | 660 | 7 | 600 | 800 | 660 | 5 | 500 | 16 | φ9.52 | φ6.35 |
| SEZ-KD35VA(L) | 900 | 952 | 998 | 860 | 9 | 800 | 1000 | 860 | 7 | 700 | 20 | | |
| SEZ-KD50VA(L) | | | | | | | | | | | | φ12.7 | |
| SEZ-KD60VA(L) | 1100 | 1152 | 1198 | 1060 | 11 | 1000 | 1200 | 1060 | 9 | 900 | 24 | φ15.88 | φ9.52 |
| SEZ-KD71VA(L) | | | | | | | | | | | | | |




- Note1. Use M10 screw for the suspension bolt (field supply).
 Note2. Keep the service space for the maintenance at the bottom.
 Note3. This chart indicates for SEZ-KD50VA(L) model, which has 3 fans.
 SEZ-KD25,35VA(L) models have 2 fans.
 SEZ-KD60,71VA(L) models have 4 fans.
 Note4. In case an inlet duct is used, remove the air filter (supply with the unit), then install the filter (field supply) at suction side.

SEZ-KC25VA

Unit : mm



- Note**
1. Use M10 screw for the lifting bolt (field supply).
 2. Keep the service space for the maintenance from the bottom when the heat exchanger is cleaned.
 3. The direction of air intake can be changed from the bottom to the rear by attaching the bottom plate to the air intake side.
 4. Drain Pan is changeable from right and left.
 5. The dimension is changed, in case the optional long-life filter is attached.
- Rear Air-Intake spec. : Depth is increased by 30mm(*1)
 Bottom Air-Intake spec. : Height is increased by 30mm(*2)

- Refrigerant piping flare connection
 (gas φ9.52 copper tube):LP①
 Refrigerant piping flare connection
 (liquid φ6.35 copper tube):HP②
 Drain piping connection R1 (External thread)③

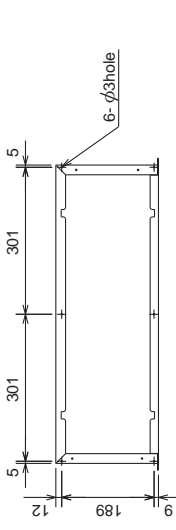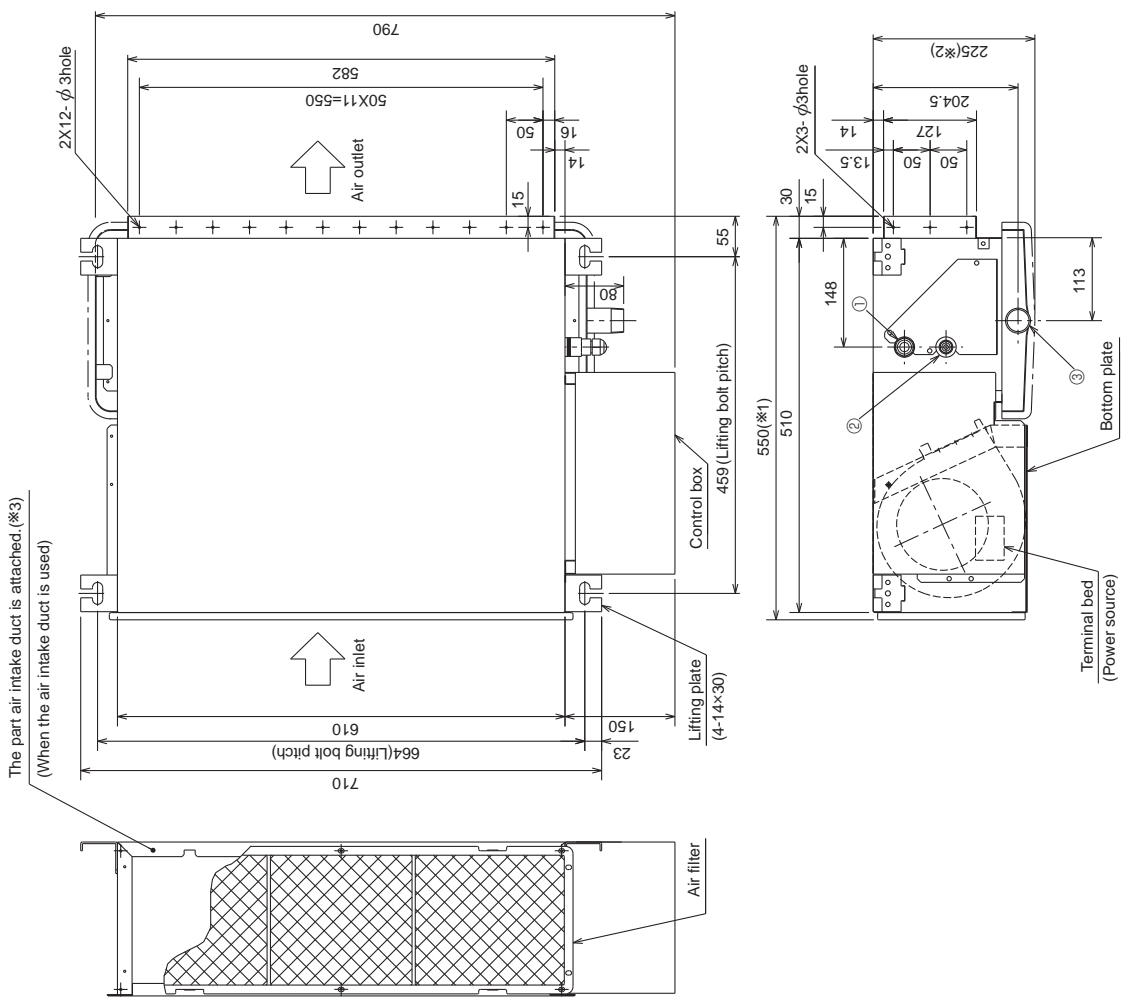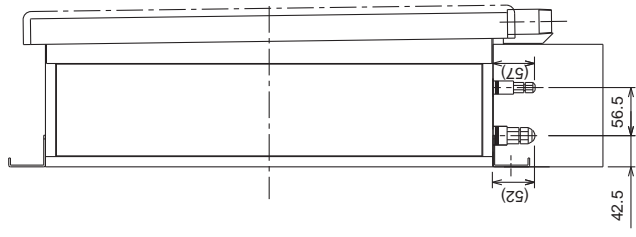

Detailed chart around the air intake duct flange(*3)
 (Duct and flange should be supplied in the field.)


Required space for service and maintenance

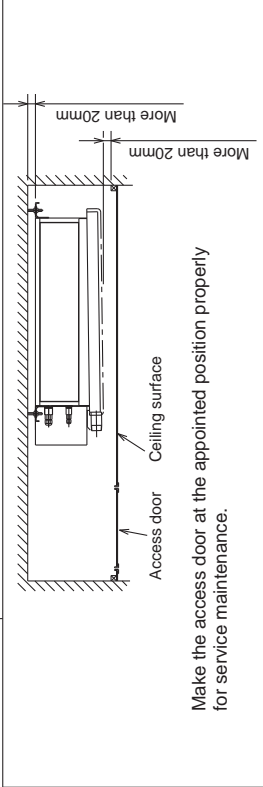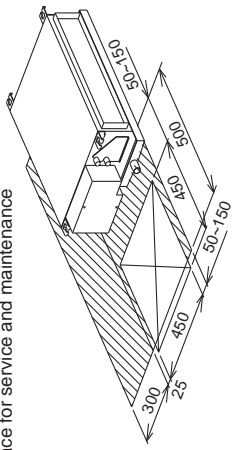


Make the access door at the appointed position properly for service maintenance.

SEZ-KA35VA
SEZ-KA50VA
SEZ-KA60VA
SEZ-KA71VA

Unit : mm

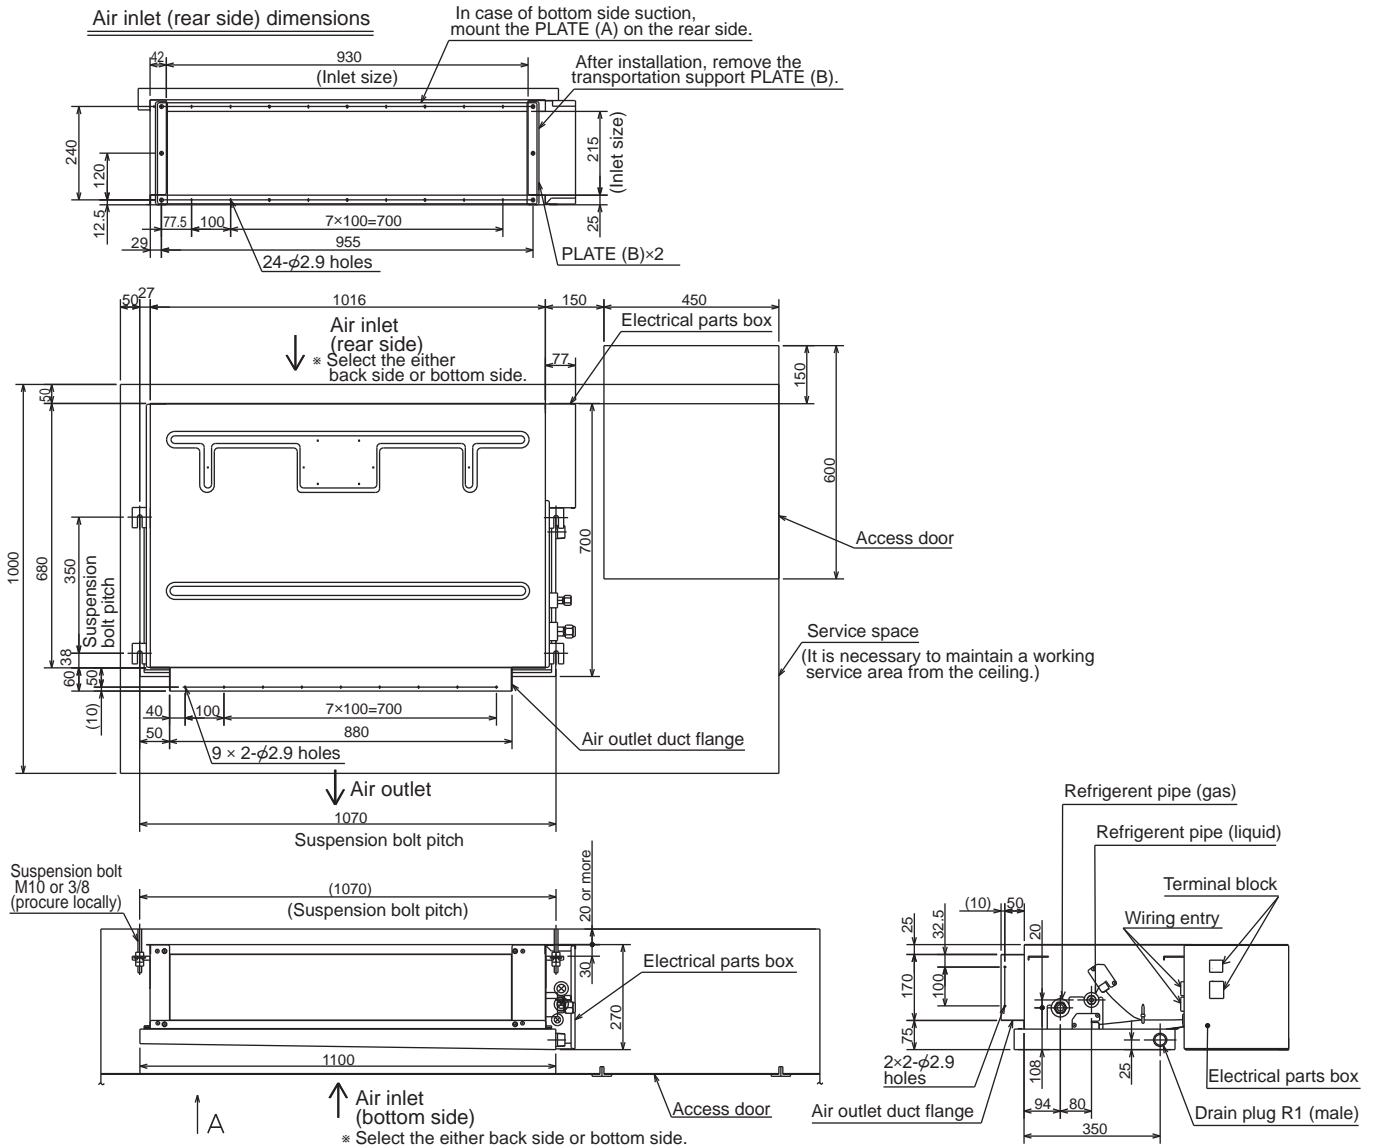


A Air inlet (bottom side) dimensions

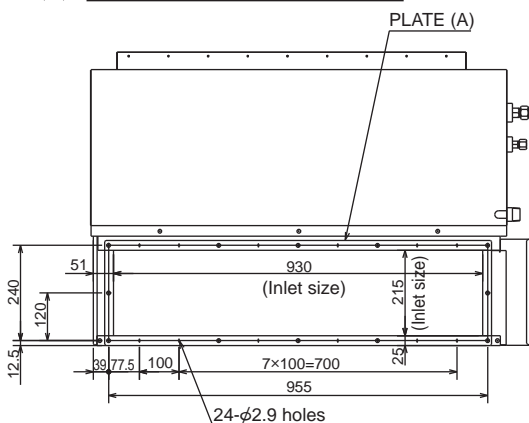


| Models | Refrigerant pipe (liquid) | Refrigerant pipe (gas) |
|------------|----------------------------------|-----------------------------------|
| SEZ-KA35VA | φ6.35mm flared connection 1/4" F | φ9.52mm flared connection 3/8" F |
| SEZ-KA50VA | φ6.35mm flared connection 1/4" F | φ12.7mm flared connection 1/2" F |
| SEZ-KA60VA | φ6.35mm flared connection 1/4" F | φ15.88mm flared connection 5/8" F |
| SEZ-KA71VA | φ9.52mm flared connection 3/8" F | φ15.88mm flared connection 5/8" F |

PLA-RP35BA PLA-RP50BA PLA-RP60BA PLA-RP71BA



Unit : mm

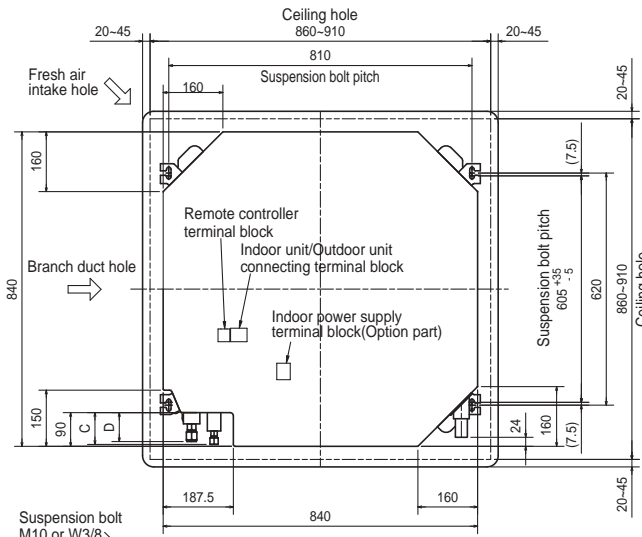

Detail connecting of branch duct(Both aspects)

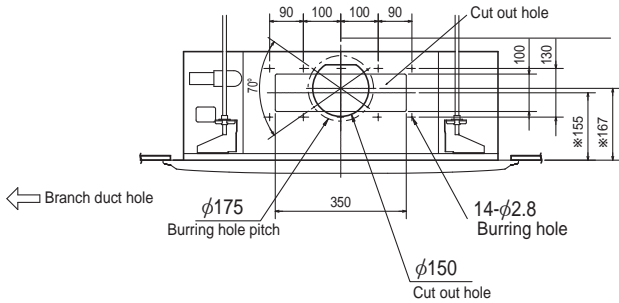

Detail drawing of fresh air intake hole

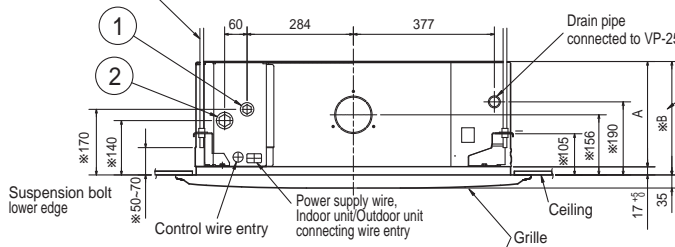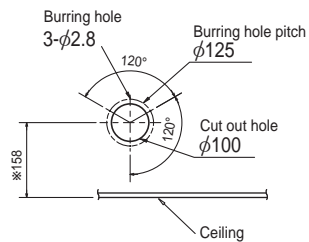


In case of standard grille : PLP-6BA / PLP-6BAMD





In case of Auto-Grille : PLP-6BAJ

In case of wireless remote controller : PLP-6BALM


Emergency operation switch<Cooling>and Emergency Up/Down switch<Up>
Emergency operation switch<Heating>and Emergency Up/Down switch<Down>



Auto Grille
Air intake grille up/down discharge

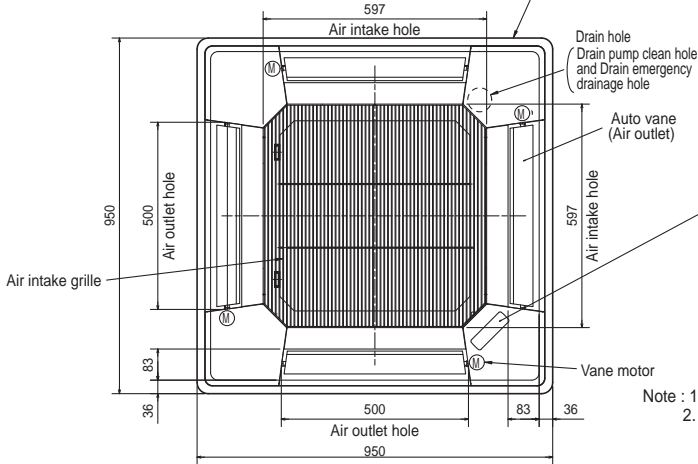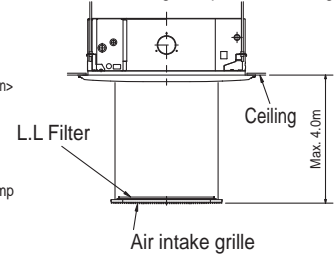


- Note : 1. Please choose the Grille from a standard grille, auto-grille.
 2. As for drain pipe, please use VP-25(O.D. φ32 PVC TUBE). Drain pump is included. Max. lifting height is 850mm from the ceiling.
 3. As for suspension bolt, please use M10 or W3/8. (Procured at local site)
 4. Electrical box may be removed for the service purpose. Make sure to slack the electrical wire little bit for control/ power wires connection.
 5. The height of the indoor unit is able to be adjusted with the grille attached.
 6. For the installation of the optional high efficiency filter or optional multi-functional casement.
 1) Requires E or more space between transom and ceiling for the installation.
 2) Add 135 mm to the dimensions * marked on the figure.
 3) The optional high efficiency filter becomes optional multi-functional casement and concomitant use.
 7. When installing the branch ducts, be sure to insulate adequately. Otherwise condensation and dripping may occur. (It becomes the cause of dew drops/water dew.)
 8. As for necessary installation/service space, please refer to the left figure.

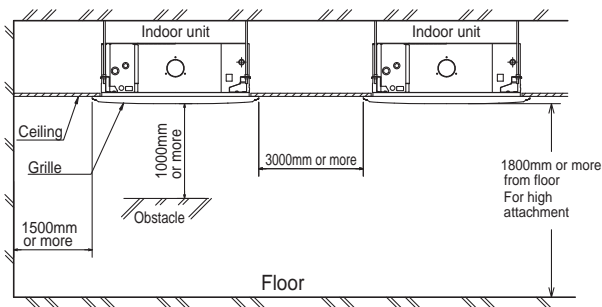



| Models | ① | ② | A | B | C | D | E |
|---------------|--|---|-----|-----|----|----|-----|
| PLA-RP35/50BA | Refrigerant pipe ...φ6.35 Flared connection ...1/4 inch | Refrigerant pipe ...φ12.7 Flared connection ...1/2 inch | 241 | 258 | 80 | 74 | 400 |
| PLA-RP60BA | Refrigerant pipe φ6.35 Flared connection 1/4 inch | Refrigerant pipe ...φ15.88 Flared connection ...5/8 inch | | | | | |
| PLA-RP71BA | Refrigerant pipe ...φ9.52 Flared connection ...3/8 inch | | | | 85 | 77 | |

PLA-RP35AA PLA-RP50AA PLA-RP60AA PLA-RP71AA





Unit : mm

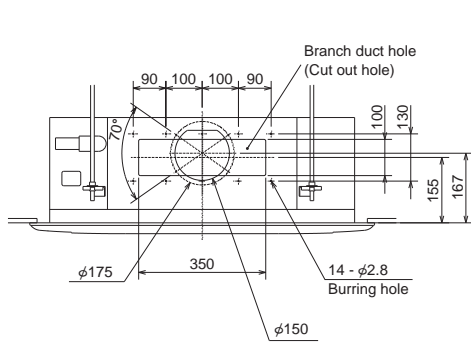

Detail drawing of fresh air intake

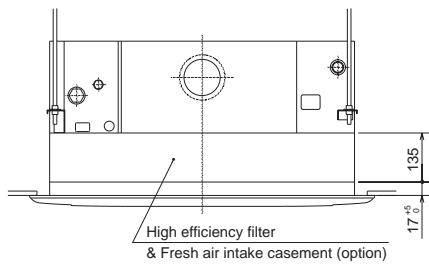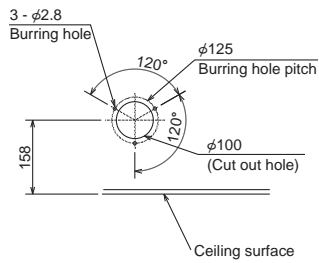

A (WIRELESS PANEL)

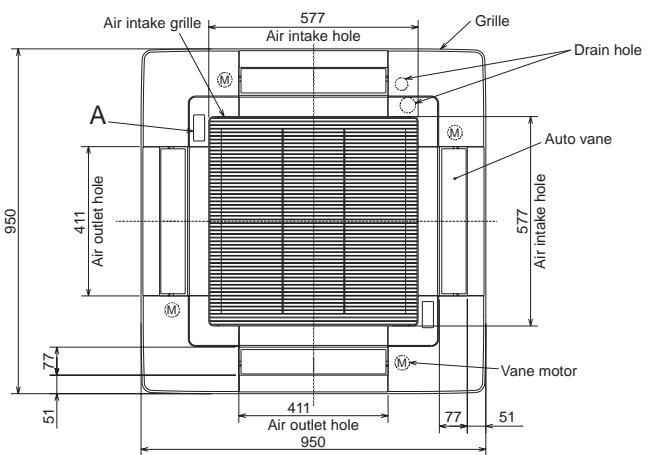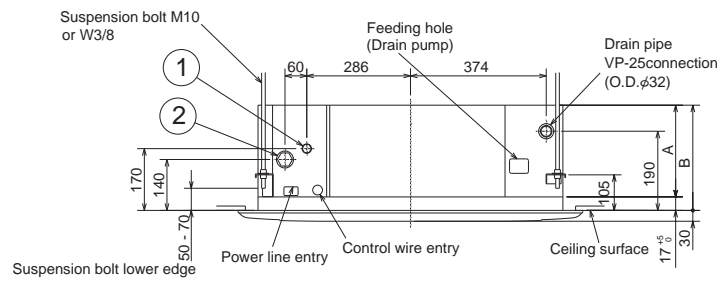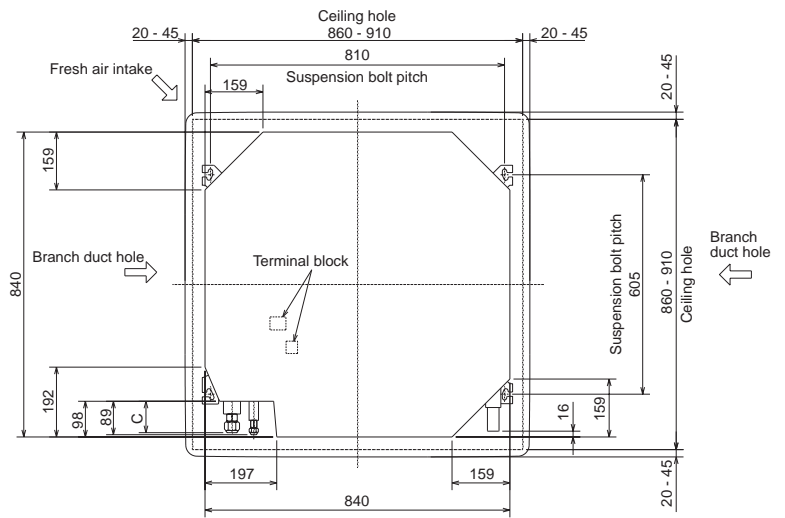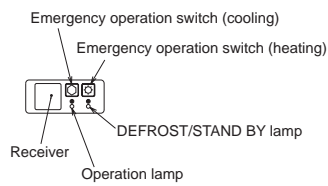

Use the current nuts meeting the pipe size of the outdoor unit.
Available pipe size (Unit : mm)

| | RP35, 50 | RP60 | RP71 |
|---------------|----------|----------|----------|
| ① LIQUID SIDE | φ6.35 ○ | φ6.35 | — |
| | φ9.52 | φ9.52 ○ | φ9.52 ○ |
| ② GAS SIDE | φ12.7 ○ | — | — |
| | φ15.88 | φ15.88 ○ | φ15.88 ○ |

○ : Initial flare nut size

(Unit : mm)



| Models | A | B | C |
|---------------|-----|-----|----|
| PLA-RP35,50AA | 241 | 258 | 80 |
| PLA-RP60,71AA | | | |

PCA-RP50GA

Unit : mm

NOTES:

1. Use M10 or W3/8 screws for anchor bolt.
2. When optional drain lift-up mechanism is installed, always provide upward piping for refrigerant piping.

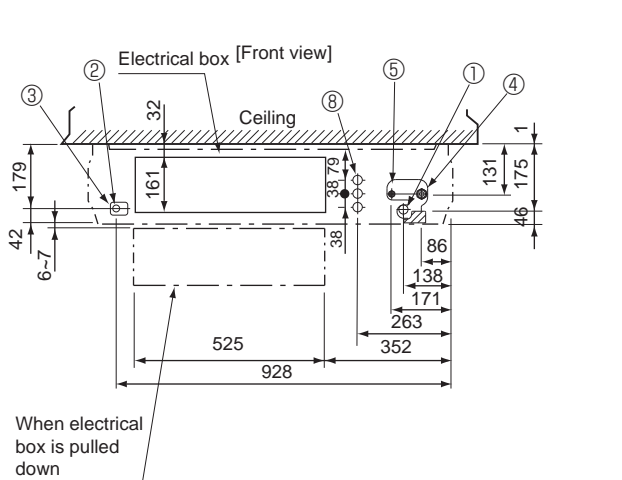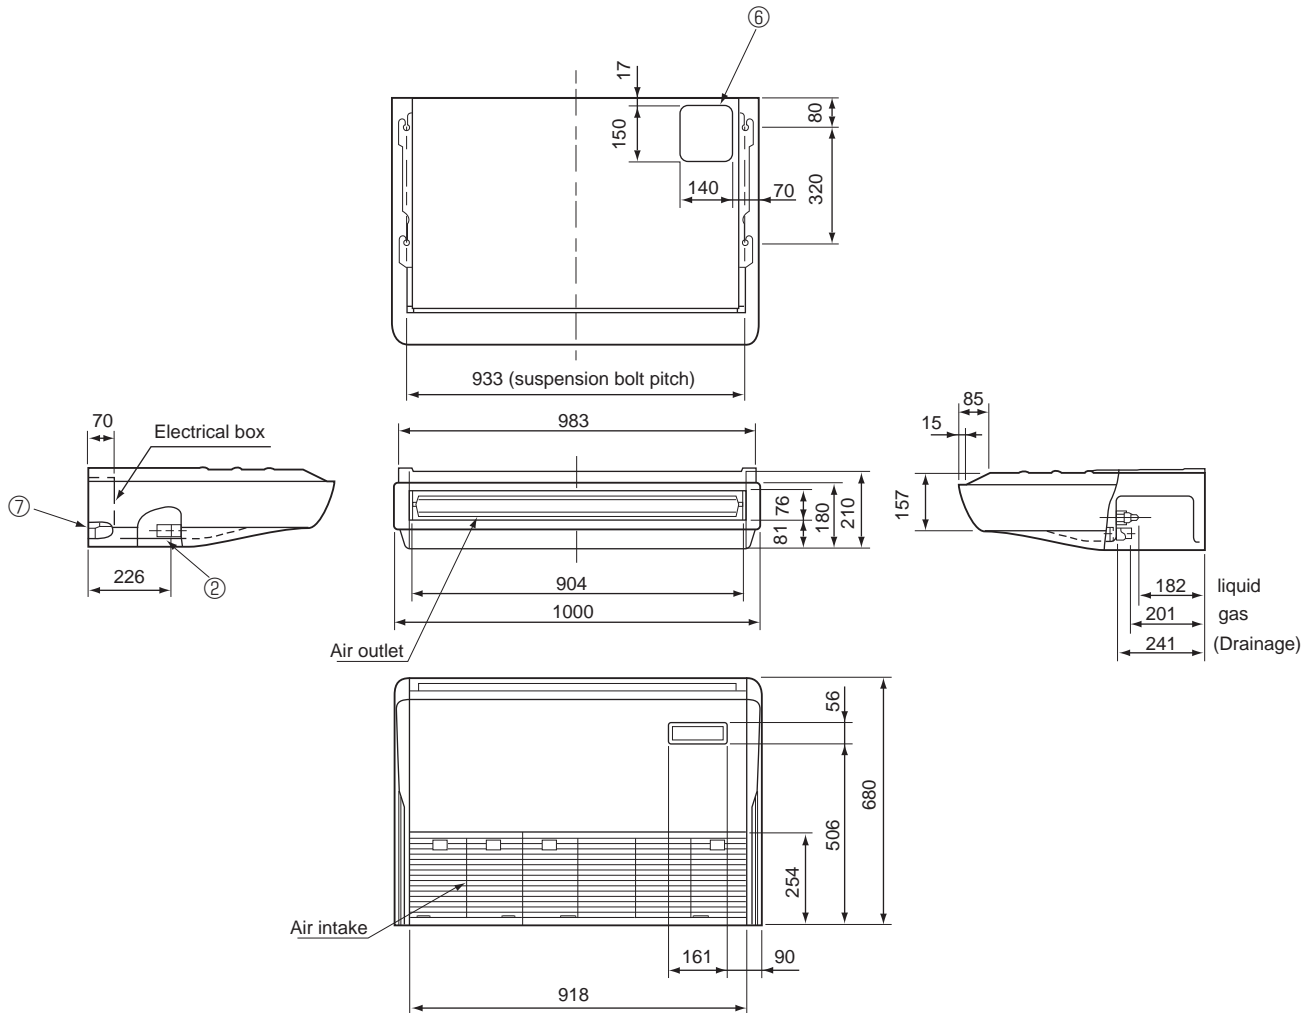

- ① Drainage pipe connection (26mm I.D.)
- ② Drainage pipe connection (for the left arrangement)
- ③ Knock out hole for left drain-piping arrangement
- ④ Refrigerant-pipe connection (gas pipe side/flared connection)
- ⑤ Refrigerant-pipe connection (liquid pipe side/flared connection)
- ⑥ Knockout hole for upper drain pipe arrangement
- ⑦ Knockout hole for left drain pipe arrangement
- ⑧ Knockout hole for wiring arrangement

Use the current nuts meeting the pipe size of the outdoor unit.

Available pipe size (Unit : mm)


| | RP50 |
|---------------|---------|
| ⑤ LIQUID SIDE | φ6.35 ○ |
| | φ9.52 |
| ④ GAS SIDE | φ12.7 ○ |
| | φ15.88 |

○ : Initial flare nut size

**PCA-RP50GA2
PCA-RP60GA
PCA-RP71GA**

Unit : mm

- NOTES:
 1. Use M10 or W3/8 screws for anchor bolt.
 2. When optional drain lift-up mechanism is installed, always provide upward piping for refrigerant piping.

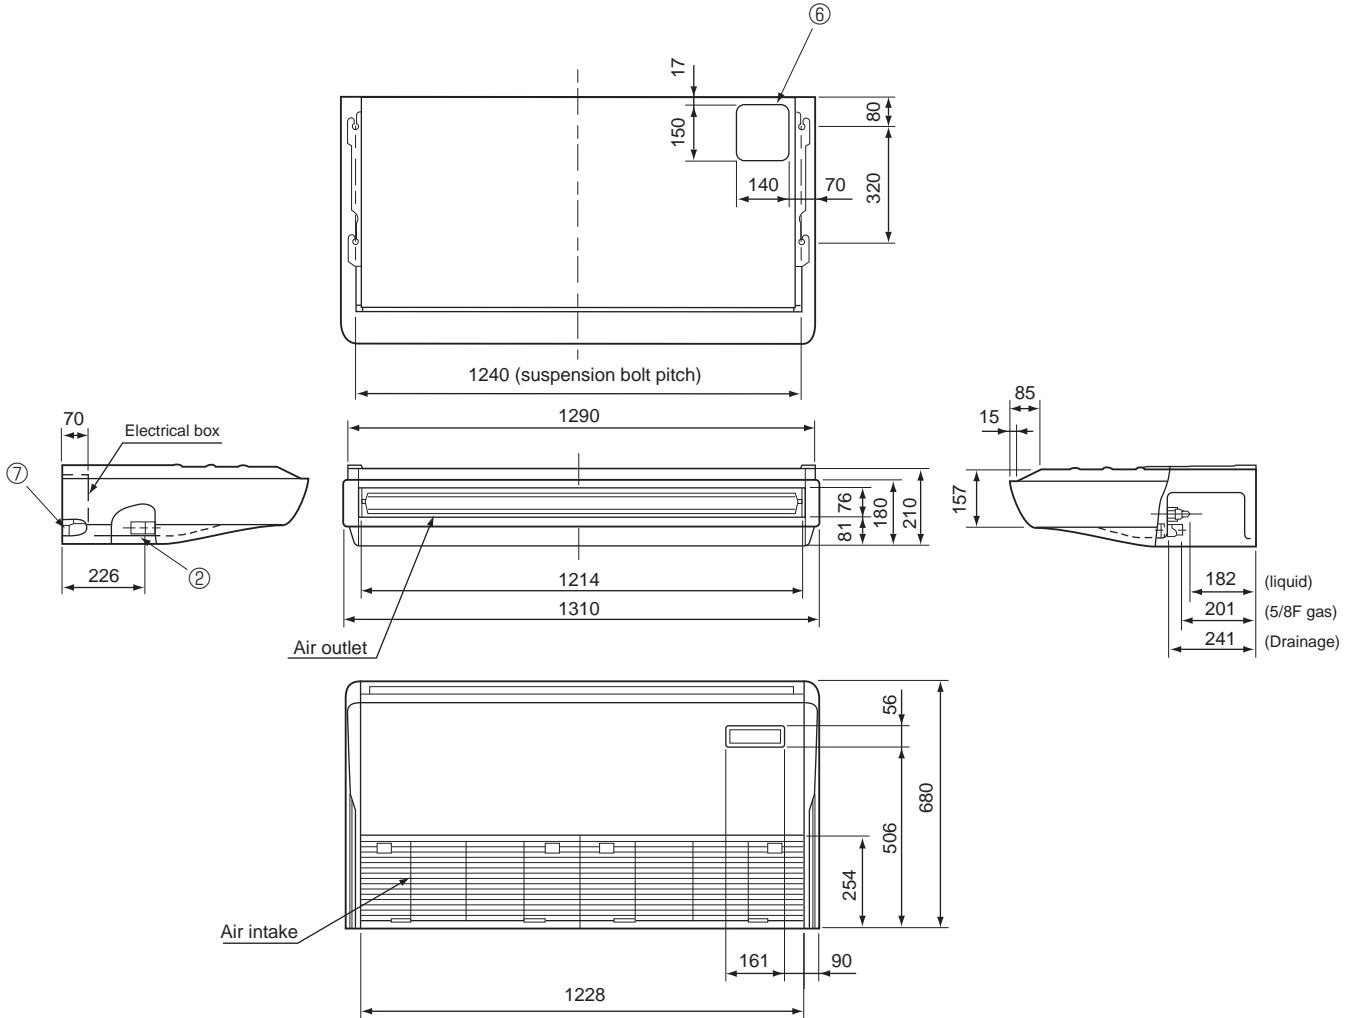

- ① Drainage pipe connection (26mm I.D.)
- ② Drainage pipe connection (for the left arrangement)
- ③ Knock out hole for left drain-piping arrangement
- ④ Refrigerant-pipe connection (gas pipe side/flared connection)
- ⑤ Refrigerant-pipe connection (liquid pipe side/flared connection)
- ⑥ Knockout hole for upper drain pipe arrangement
- ⑦ Knockout hole for left drain pipe arrangement
- ⑧ Knockout hole for wiring arrangement

Use the current nuts meeting the pipe size of the outdoor unit.

Available pipe size (Unit : mm)

| | RP50 | RP60 | RP71 |
|---------------|---------|----------|----------|
| ⑤ LIQUID SIDE | φ6.35 ○ | φ6.35 | — |
| | φ9.52 | φ9.52 ○ | φ9.52 ○ |
| ④ GAS SIDE | φ12.7 ○ | — | — |
| | φ15.88 | φ15.88 ○ | φ15.88 ○ |
| | — | — | — |

○ : Initial flare nut size

PEAD-RP35EA2
PEAD-RP50EA
PEAD-RP60EA


Unit : mm

(Unit : mm)

| Model | A | B | C | D | E | F | G |
|---------|------|-----|-----|------|------|--|---|
| RP35,50 | 772 | 305 | - | 830 | 804 | R410A Outdoor unit : 6.35 * R407C Outdoor unit : 9.52 | R410A Outdoor unit : 12.7 * R407C Outdoor unit : 15.88 |
| RP60 | 1012 | 280 | 290 | 1070 | 1044 | Outdoor unit (SUZ) : 6.35 R407C Outdoor unit : 9.52 * | 15.88 |

* Initial flare nut size

- ① Refrigerant piping flare connection (liquid ϕ F copper tube):HP
- ② Refrigerant piping flare connection (gas ϕ G copper tube):LP
- ③ Drain R1(External thread)
- ④ Electrical parts box
- ⑤ Drain Pump (Option)
- ⑥ Drain Pipe (Option) ... Flexible joint VP-25(I.D. ϕ 32)
- ⑦ Filter

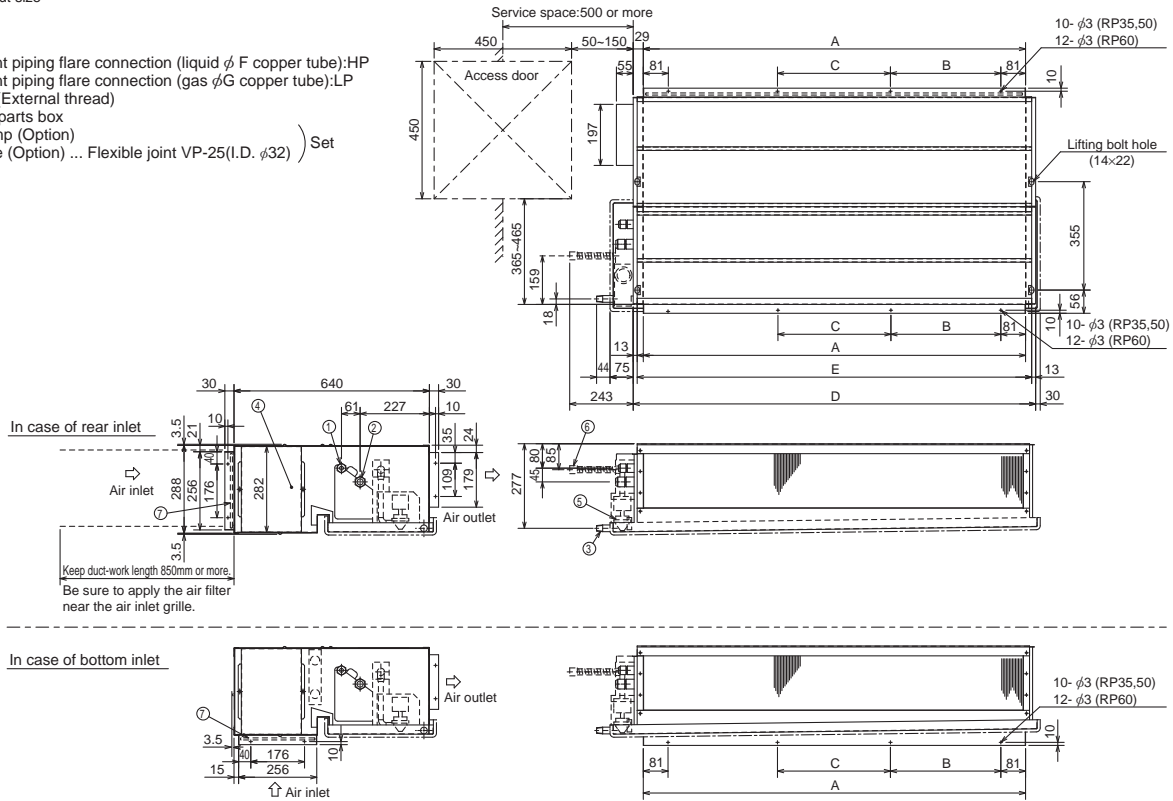


PEAD-RP71EA

(Unit : mm)

| Model | A | B | C | D | E | F |
|-------|------|-----|-----|------|------|-------|
| RP71 | 1012 | 280 | 290 | 1070 | 1044 | 15.88 |

* Initial flare nut size

- ① Refrigerant piping flare connection (liquid ϕ 9.52 copper tube):HP
- ② Refrigerant piping flare connection (gas ϕ F copper tube):LP
- ③ Drain R1 (External thread)
- ④ Electrical parts box
- ⑤ Drain Pump (Option)
- ⑥ Drain Pipe (Option) ... Flexible joint VP25(I.D. ϕ 32)
- ⑦ Filter

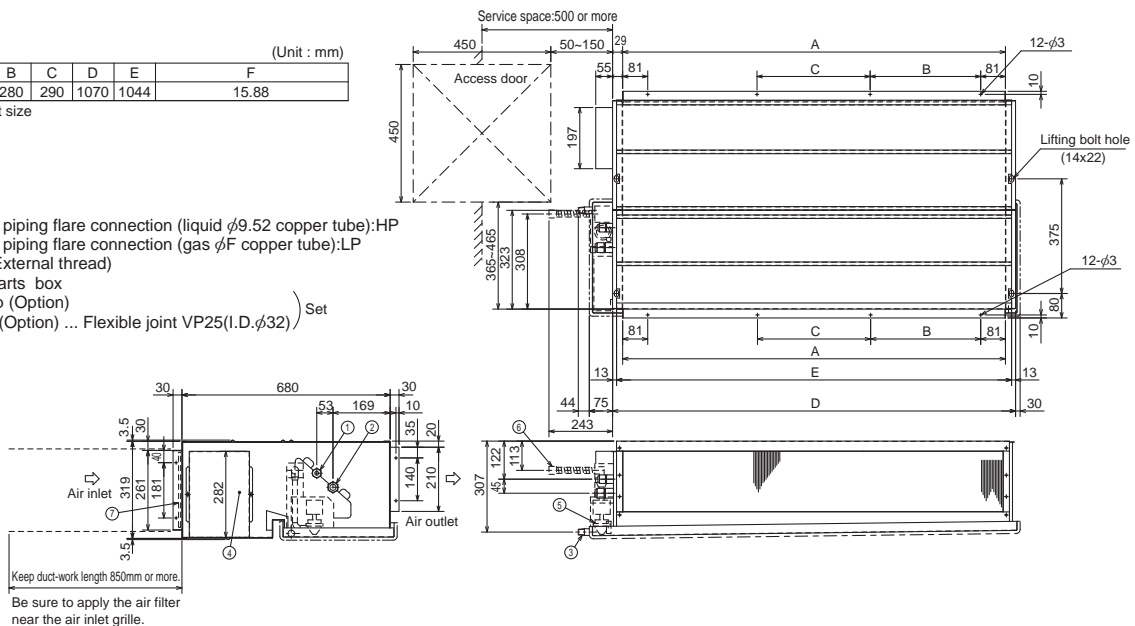


PEAD-RP60GA
PEAD-RP71GA

Unit : mm

- ① Refrigerant piping flare connection(liquid øH copper tube): HP
- ② Refrigerant piping flare connection(gas ø J copper tube): LP
- ③ Electrical parts box *
- ④ Terminal bed : Power source
- ⑤ Terminal bed : Remote control
- ⑥ Filter
- ⑦ Drain pan (R1 External thread: ø34) (*;Fixable to opposition side.)

* NOTE: IT IS NECESSARY TO REMOVE THE CEILING PARTS OR TO KEEP THE MAINTENANCE HOLE OF OVER UNIT SIZE WHEN YOU HAVE A MAINTENANCE OR SERVICE THE FOLLOWING PARTS.
 SERVICE: MOTOR,SIROCCO FAN,HEAT EXCHANGER,DRAIN PAN.
 (EXCHANGE) FILTER(IN CASE OF INDOOR UNIT HAVE INLET DUCT.)
 MAINTENANCE: HEAT EXCHANGER,DRAIN PAN(SURFACE WASHING).
 (WASHING) FILTER(IN CASE OF INDOOR UNIT HAVE INLET DUCT.)

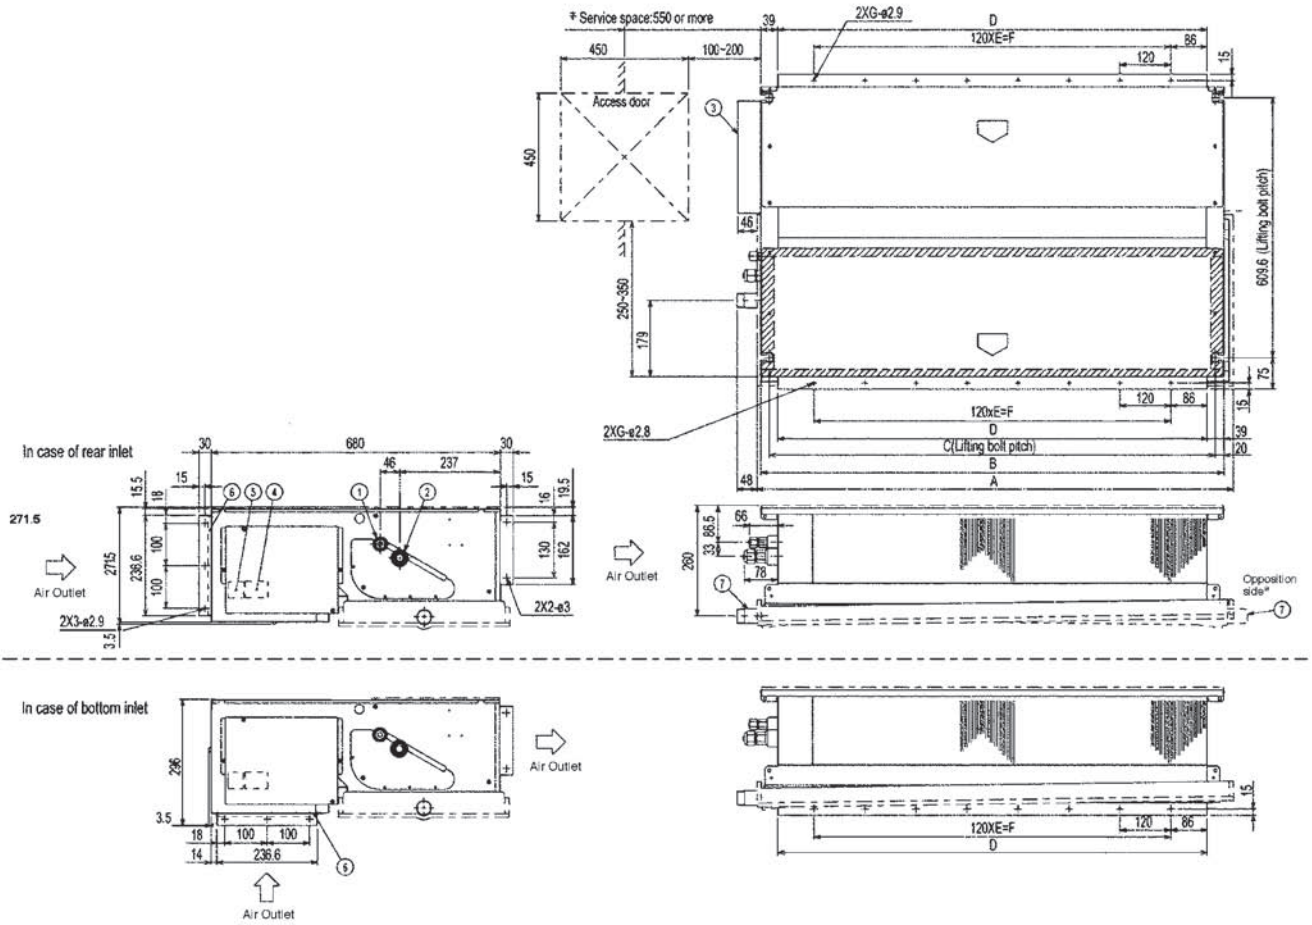


(Unit : mm)

| Model | A | B | C | D | E | F | G | H | J |
|-------|------|------|------|------|---|-----|---|---|-------|
| RP60 | 1125 | 1090 | 1050 | 1012 | 7 | 840 | 8 | Outdoor unit(SUZ) : 6.35 Other outdoor unit : 9.52 * | 15.88 |
| RP71 | 1125 | 1090 | 1050 | 1012 | 7 | 840 | 8 | 9.52 | 15.88 |

* Initial flare nut size

PEA-RP71EA


Unit : mm

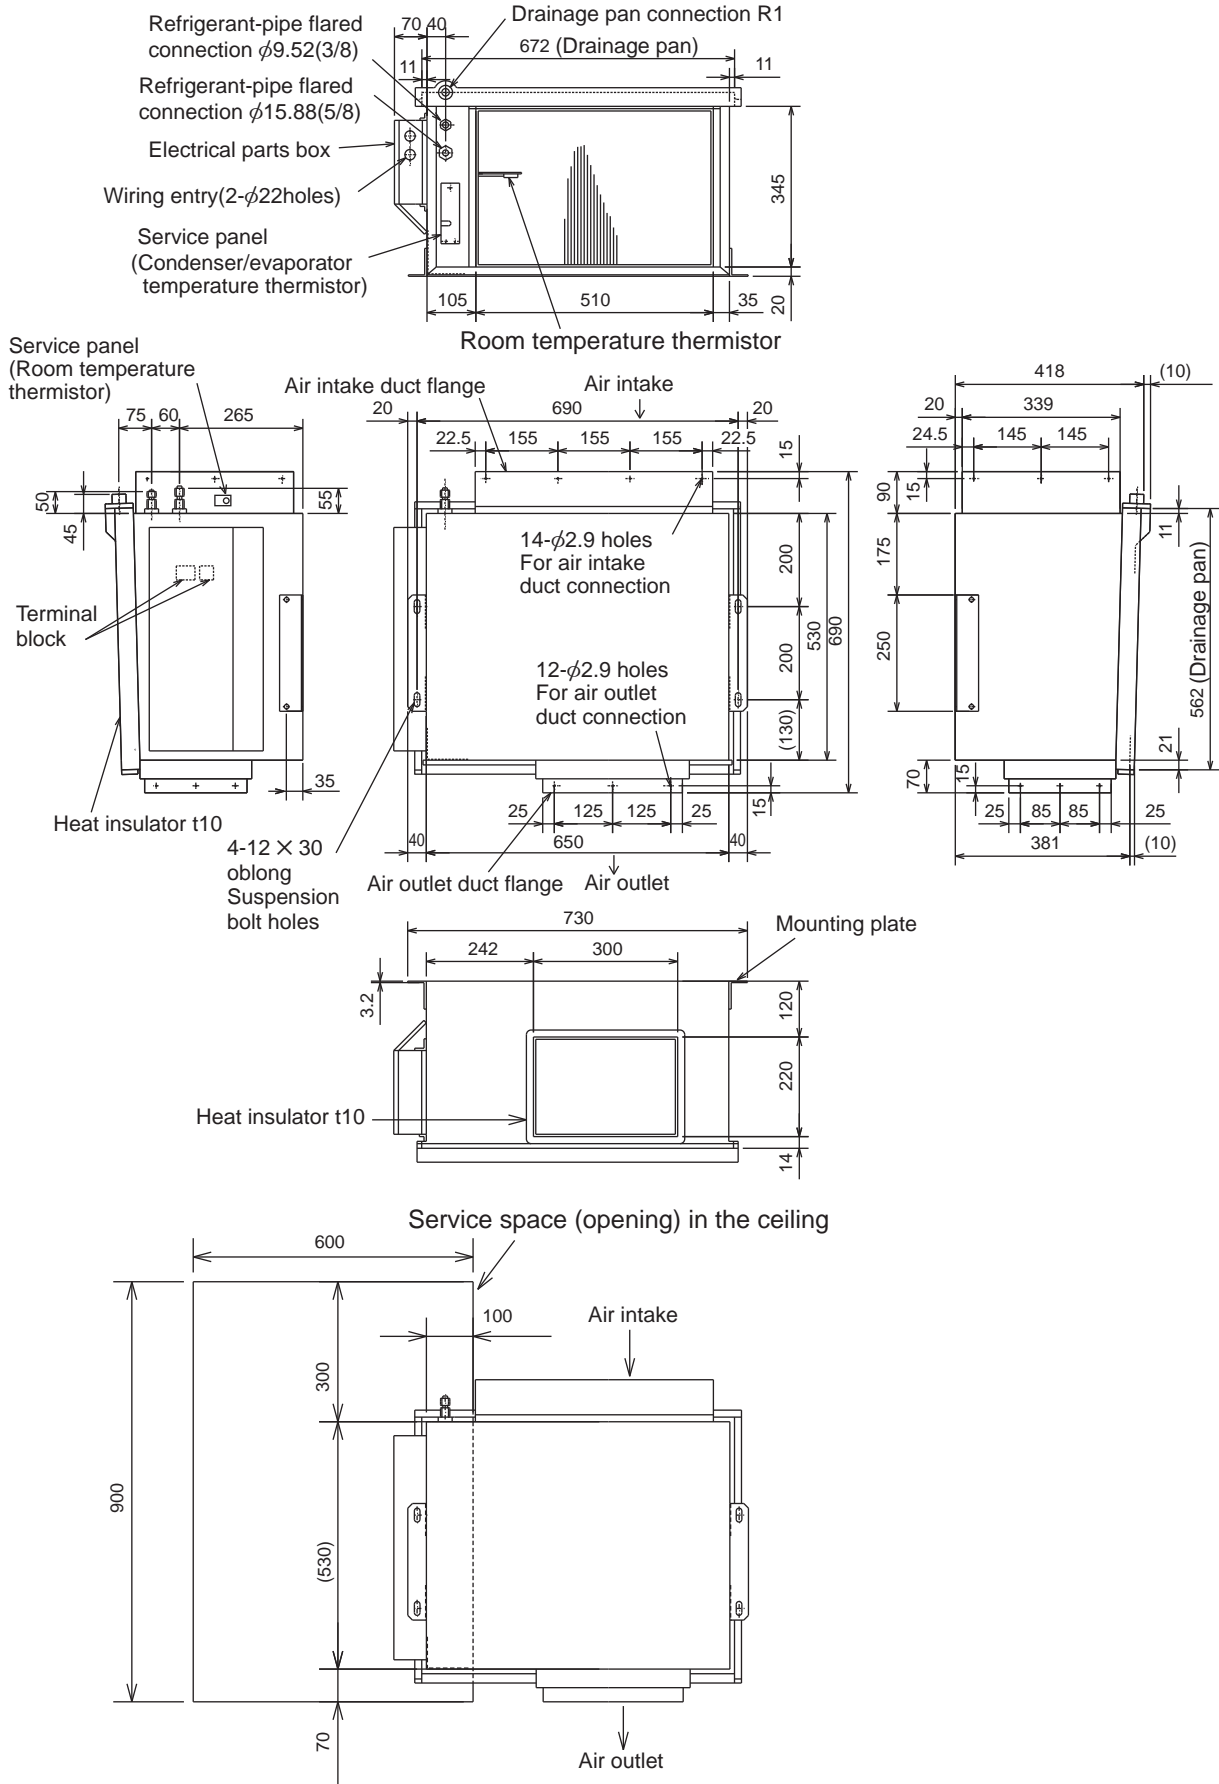


OUTDOOR UNIT

Unit: mm

SUZ-KA25VA SUZ-KA25VAH
SUZ-KA35VA SUZ-KA35VAH


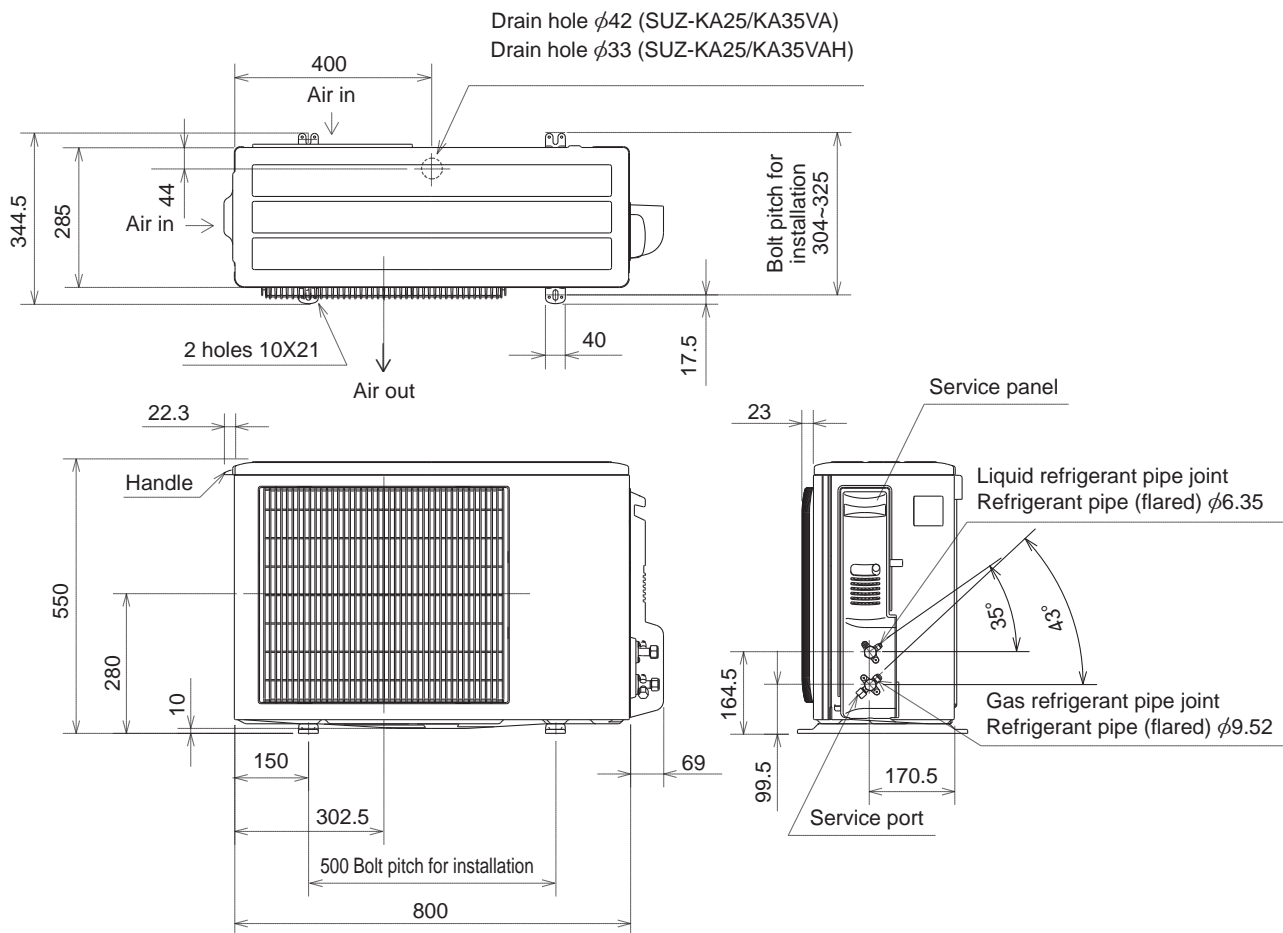


REQUIRED SPACE

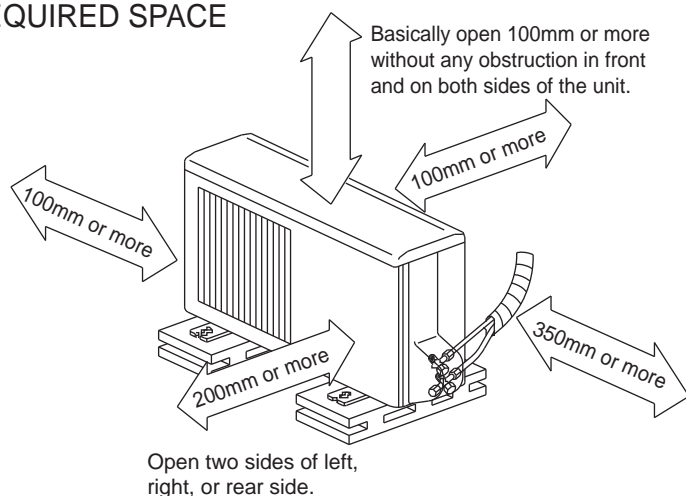


**SUZ-KA50VA
SUZ-KA60VA
SUZ-KA71VA**

Unit: mm

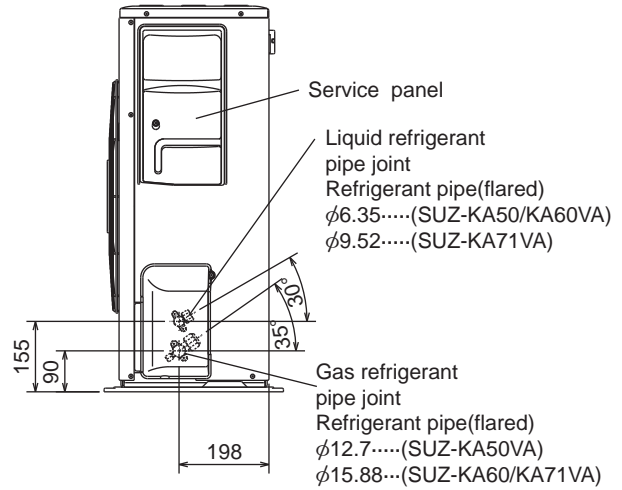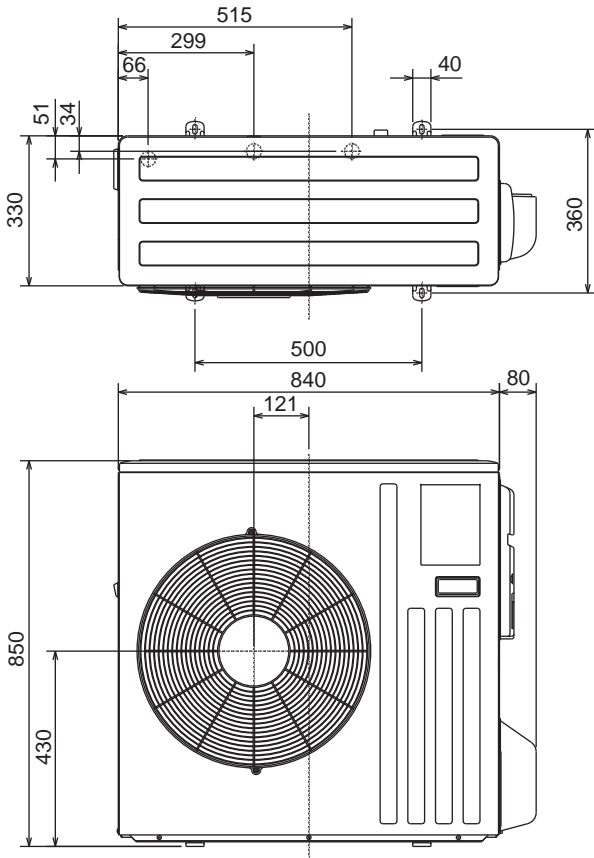



REQUIRED SPACE

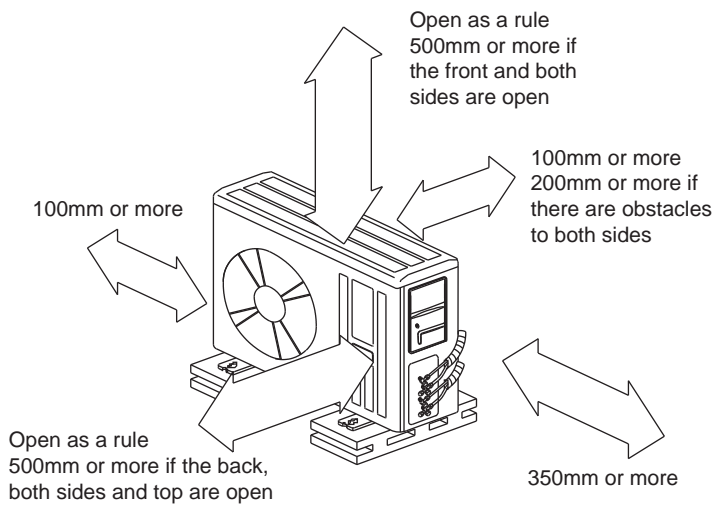



WIRED REMOTE CONTROLLER



Unit : mm

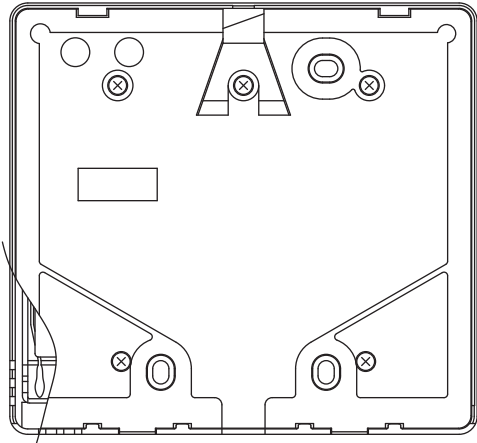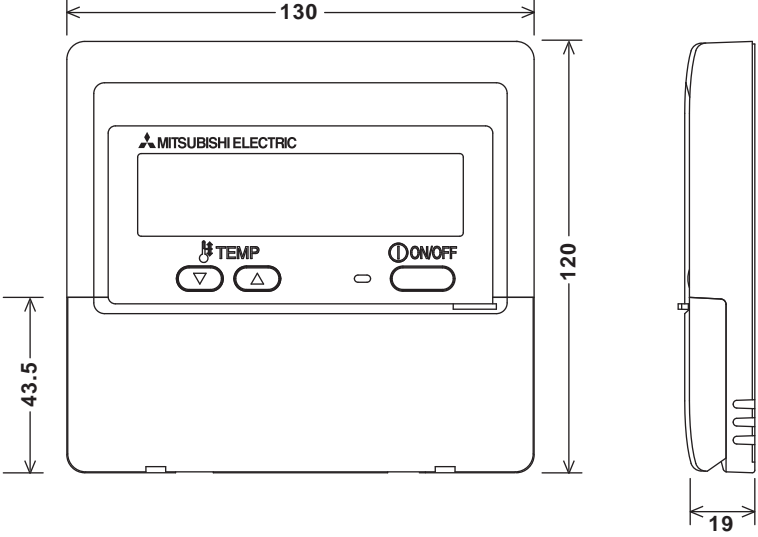

WIRELESS REMOTE CONTROLLER

Unit : mm

SLZ-KA25/35/50VAL SEZ-KC25,KA35/50/60/71VA(Option)

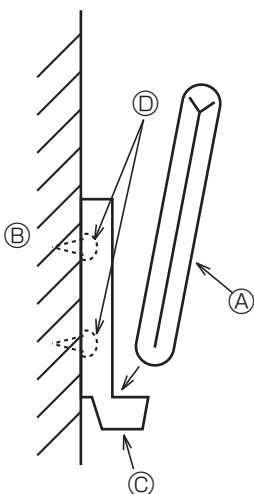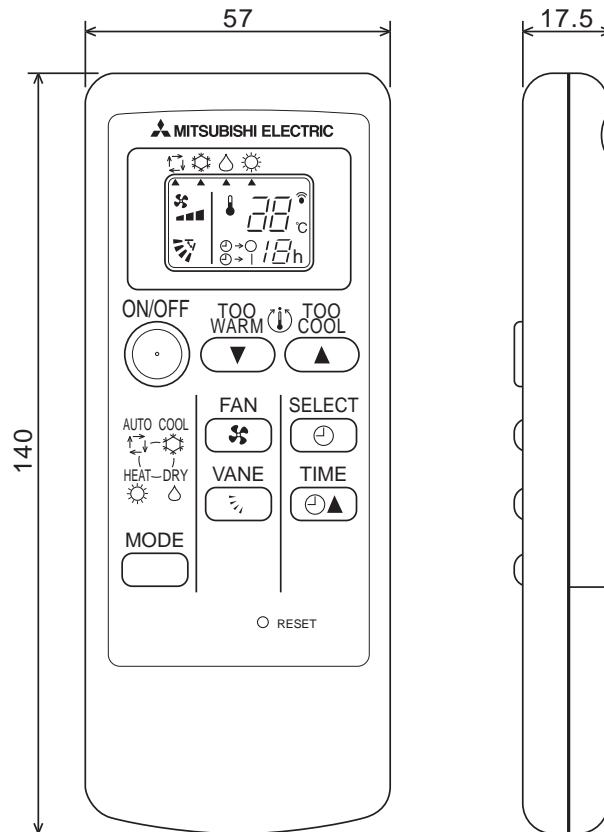

Installation area

- Area in which the remote controller is not exposed to direct sunshine
- Area in which there is no heating source nearby
- Area in which the remote controller is not exposed to cold (or warm) winds
- Area in which the remote controller can be operated easily
- Area in which the remote controller is beyond the reach of children

Installation method

- ① Attach the remote controller holder to the desired location using two tapping screws.
- ② Place the lower end of the controller into the holder.


- Ⓐ Wireless remote controller (Accessory)
- Ⓑ Wall
- Ⓒ Remote controller holder (Accessory)
- Ⓓ Fixing screw (Accessory)

- The signal can travel up to approximately 7 meters (in a straight line) within 45 degrees to both right and left of the center line of the receiver.
In addition, the signal may not be received if there are interferences of fluorescent lights or strong sunlight.



WIRELESS REMOTE CONTROLLER

Unit : mm

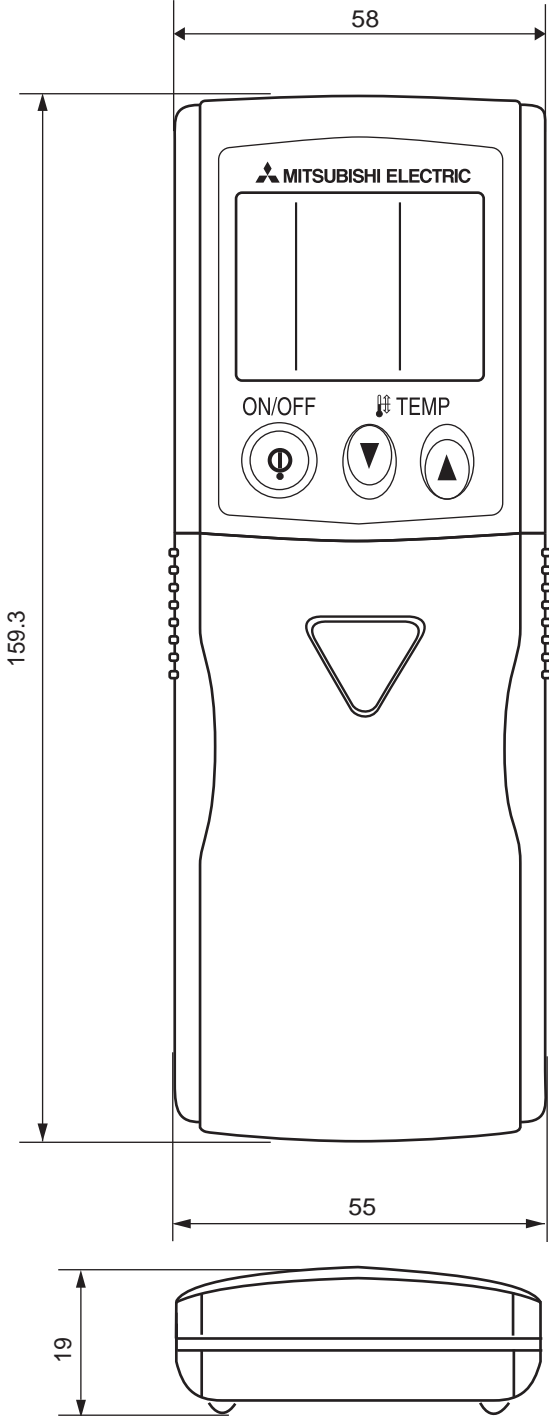


4

WIRING DIAGRAM

MFZ-KA25VA
MFZ-KA35VA
MFZ-KA50VA

INDOOR UNIT

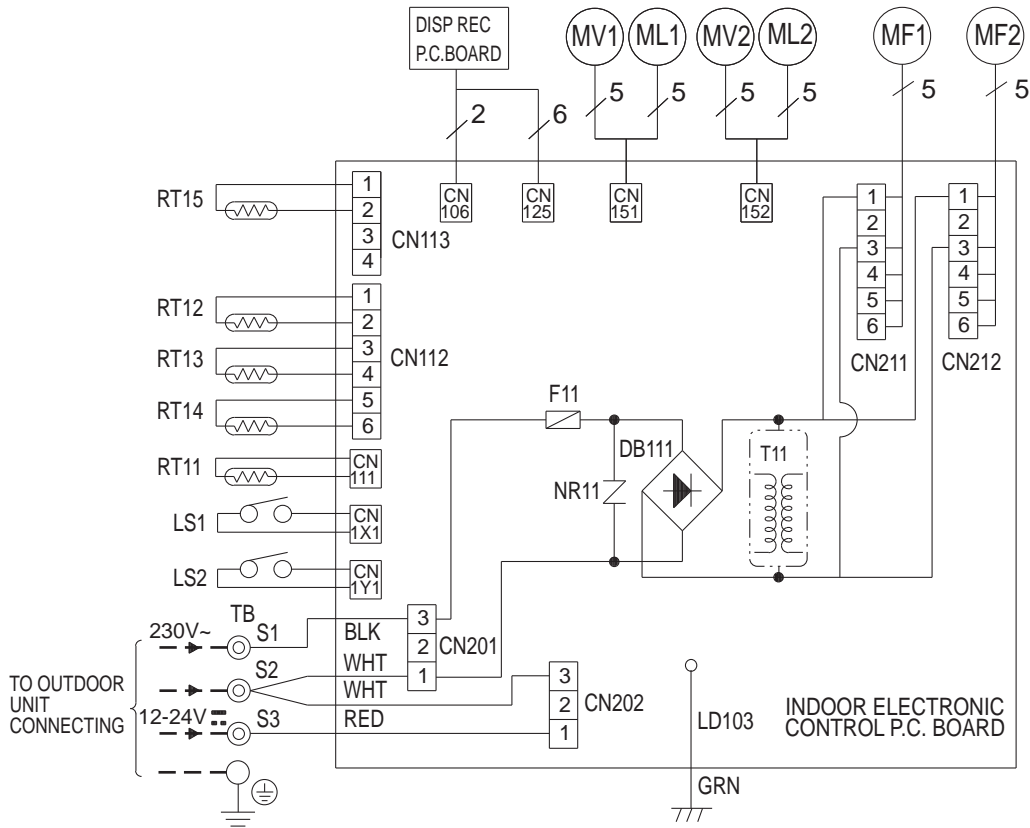


[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|--------|-----------------------------|--------|---------------------------------|--------|---------------------------------|
| DB111 | DIODE STACK | ML2 | DAMPER LOCK MOTOR (LEFT) | RT14 | INDOOR COIL THERMISTOR (MAIN 2) |
| F11 | FUSE (T3.15AL250V) | MV1 | HORIZONTAL VANE MOTOR | TR15 | INDOOR COIL THERMISTOR (MAIN 3) |
| LS1 | DAMPER LIMIT SWITCH (OPEN) | MV2 | DAMPER MOTOR | T11 | TRANSFORMER |
| LS2 | DAMPER LIMIT SWITCH (CLOSE) | NR11 | VARISTOR | | |
| MF1 | UPPER INDOOR FAN MOTOR | RT11 | ROOM TEMPERATURE THERMISTOR | | |
| MF2 | LOWER INDOOR FAN MOTOR | RT12 | INDOOR COIL THERMISTOR (MAIN 1) | | |
| ML1 | DAMPER LOCK MOTOR (RIGHT) | RT13 | INDOOR COIL THERMISTOR (SUB) | | |

NOTE: 1. About the outdoor side electric wiring, refer to the outdoor unit electric wiring diagram for servicing.
2. Use copper conductors only. (For field wiring)
3. Symbols below indicate :
⊙: Terminal block, □□□□: Connector

SLZ-KA25VAL SLZ-KA25VA
SLZ-KA35VAL SLZ-KA35VA
SLZ-KA50VAL SLZ-KA50VA

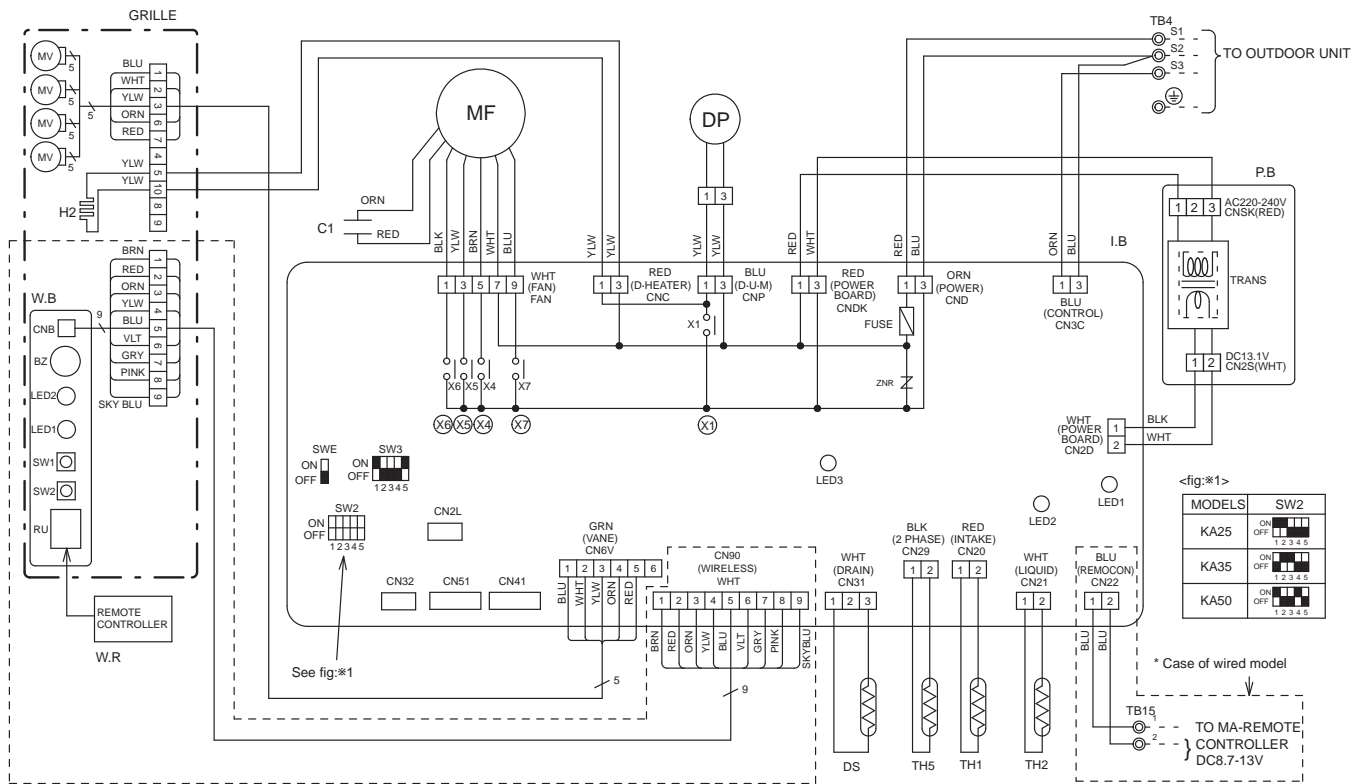

[LEGEND]


| SYMBOL | NAME | SYMBOL | NAME |
|--------|----------------------------------|--------|---|
| P.B | INDOOR POWER BOARD | W.B | WIRELESS REMOTE CONTROLLER BOARD |
| I.B | INDOOR CONTROLLER BOARD | RU | RECEIVING UNIT |
| CN2L | CONNECTOR(LOSSNAY) | BZ | BUZZER |
| CN32 | CONNECTOR(REMOTE SWITCH) | LED1 | LED(RUN INDICATOR) |
| CN41 | CONNECTOR(HA TERMINAL-A) | LED2 | LED(HOT ADJUST) |
| CN51 | CENTRALLY CONTROL | SW1 | SWITCH(HEATING ON/OFF) |
| FUSE | FUSE(T6.3AL250V) | SW2 | SWITCH(COOLING ON/OFF) |
| LED1 | POWER SUPPLY(I.B) | C1 | CAPACITOR(FAN MOTOR) |
| LED2 | POWER SUPPLY(I.B) | DP | DRAIN-UP MACHINE |
| LED3 | TRANSMISSION(INDOOR-OUTDOOR) | DS | DRAIN SENSOR |
| SW2 | SWITCH(CAPACITY CODE) | H2 | DEW PREVENTION HEATER |
| SW3 | SWITCH(MODE SELECTION) | MF | FAN MOTOR |
| SWE | SWITCH(EMERGENCY OPERATION) | TB4 | TERMINAL BLOCK(INDOOR/OUTDOOR CONNECTING LINE) |
| X1 | DRAIN PUMP/DEW PREVENTION HEATER | TB15 | TERMINAL BLOCK(REMOTE CONTROLLER TRANSMISSION LINE) |
| X4 | RELAY(FAN MOTOR LL) | TH1 | ROOM TEMP.THERMISTOR (0°C/15kΩ, 25°C/5.4kΩ DETECT) |
| X5 | RELAY(FAN MOTOR Lo) | TH2 | PIPE TEMP.THERMISTOR/LIQUID (0°C/15kΩ, 25°C/5.4kΩ DETECT) |
| X6 | RELAY(FAN MOTOR Hi) | TH5 | COND./EVA.TEMP.THERMISTOR (0°C/15kΩ, 25°C/5.4kΩ DETECT) |
| X7 | RELAY(FAN MOTOR Me) | | |
| ZNR | VARIATOR | | |

Notes:

1. Symbols used in wiring diagram above are, □ : Connector, ⊙ : Terminal (block).
2. Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers (S1, S2, S3) for correct wirings.
3. Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.

* For details on how to operate self-diagnosis, refer to the service manuals etc.

SEZ-KD25VA(L)
SEZ-KD35VA(L)
SEZ-KD50VA(L)
SEZ-KD60VA(L)
SEZ-KD71VA(L)

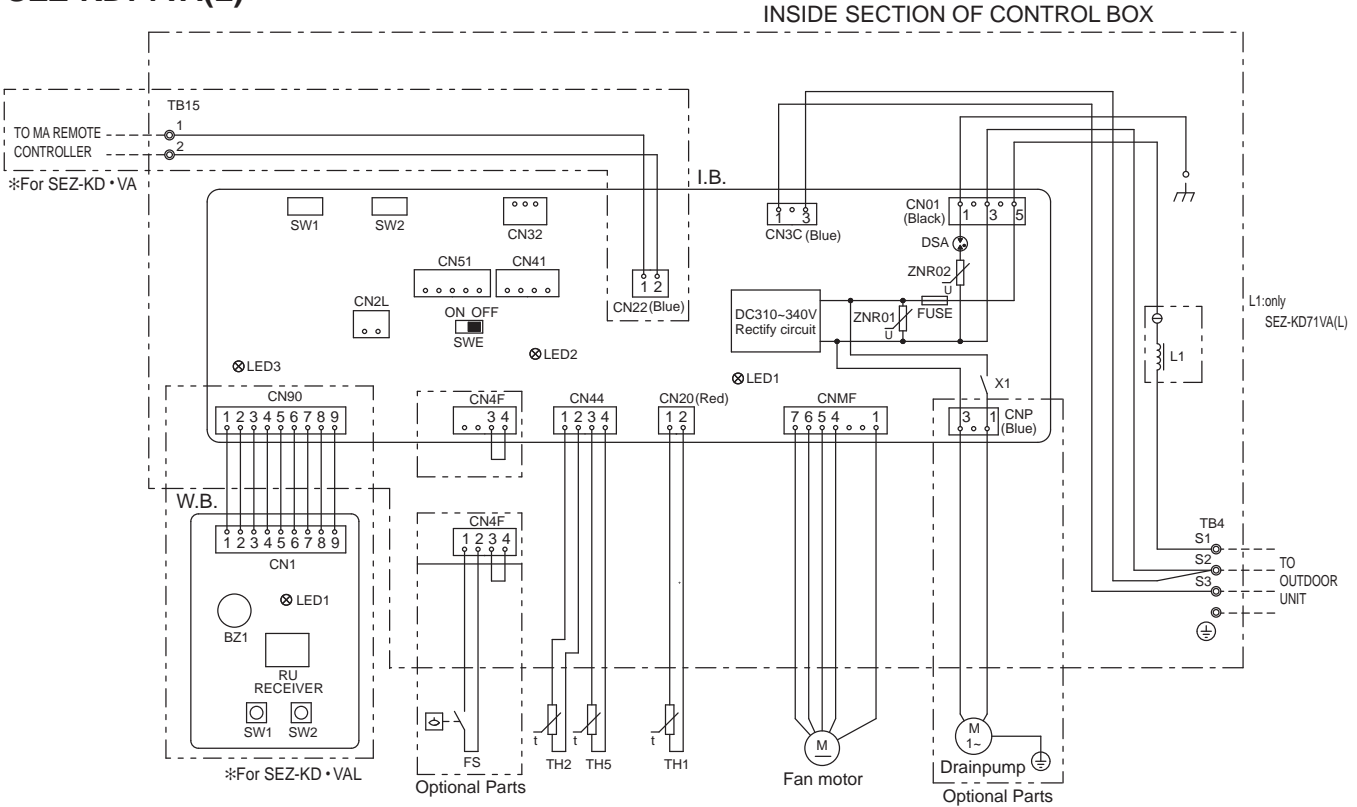


SYMBOL EXPLANATION

| SYMBOL | NAME | SYMBOL | NAME |
|----------|---------------------------------|--------|--|
| I.B. | INDOOR CONTROLLER BOARD | W.B. | WIRELESS REMOTE CONTROLLER BOARD |
| FUSE | FUSE AC250V 6.3A | RU | RECEIVING UNIT |
| ZNR01,02 | VARISTOR | BZ1 | BUZZER |
| DSA | ARRESTER | LED1 | LED (RUN INDICATOR) |
| X1 | AUX. RELAY | SW1 | SWITCH (HEATING ON/OFF) |
| CN2L | CONNECTOR (LOSSNAY) | SW2 | SWITCH (COOLING ON/OFF) |
| CN32 | CONNECTOR (REMOTE SWITCH) | TH1 | INTAKE AIR TEMP. THERMISTOR |
| CN41 | CONNECTOR (HA TERMINAL-A) | TH2 | PIPE TEMP. THERMISTOR/LIQUID |
| CN51 | CONNECTOR (CENTRALLY CONTROL) | TH5 | COND. /EVA. TEMP. THERMISTOR |
| LED1 | POWER SUPPLY(I.B.) | L1 | AC REACTOR(POWER FACTOR IMPROVEMENT) |
| LED2 | POWER SUPPLY(I.B.) | FS | FLOAT SWITCH |
| LED3 | TRANSMISSION(INDOOR-OUTDOOR) | TB4 | TERMINAL BLOCK (INDOOR/OUTDOOR CONNECTING LINE) |
| SW1 | SWITCH (FOR MODE SELECTION) | TB15 | TERMINAL BLOCK (REMOTE CONTROLLER TRANSMISSION LINE) |
| SW2 | SWITCH (FOR CAPACITY CODE) | | |
| SWE | CONNECTOR (EMERGENCY OPERATION) | | |

- NOTE) 1. Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.
 2. Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers(S1,S2,S3) for correct wirings.
 3. Symbols used in wiring diagram above are,
 ⊕:Connector, ⊙:Terminal Block.

SEZ-KC25VA

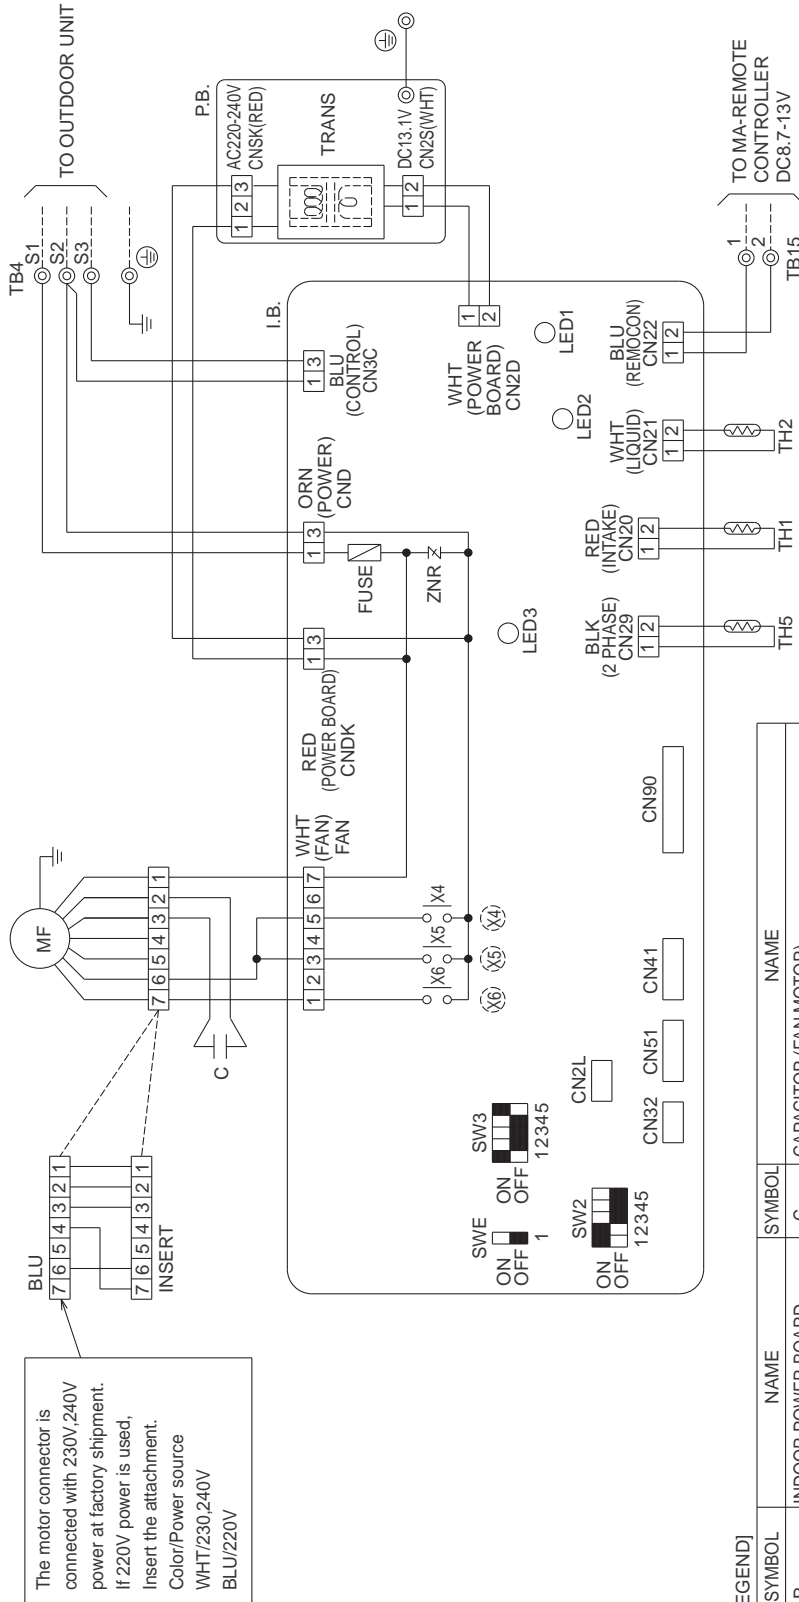


NOTE:

1. Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.
2. Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers (S1, S2, S3) for correct wirings.
3. Symbols used in wiring diagram above are, : Terminal (block), : Connector, : Terminal (block).
4. The wiring between MA-REMOTE CONTROLLER and TB15 is included in the package.

| SYMBOL | NAME | SYMBOL | NAME |
|--------|------------------------------------|--------|--|
| P.B. | INDOOR POWER BOARD | C | CAPACITOR (FAN MOTOR) |
| I.B. | INDOOR CONTROLLER BOARD | MF | FAN MOTOR |
| | CN2L CONNECTOR (LOSSNAY) | TB4 | TERMINAL BLOCK (INDOOR/OUTDOOR CONNECTING LINE) |
| | CN32 CONNECTOR (REMOTE SWITCH) | TB15 | TERMINAL BLOCK (REMOTE CONTROLLER TRANSMISSION LINE) |
| | CN41 CONNECTOR (HA TERMINAL-A) | TH1 | INTAKE AIR TEMP. THERMISTOR (0°C/15kΩ, 25°C/5.2kΩ DETECT) |
| | CN51 CENTRALLY CONTROL | TH2 | PIPE TEMP. THERMISTOR/LIQUID (0°C/15kΩ, 25°C/5.2kΩ DETECT) |
| | CN90 CONNECTOR (WIRELESS) | TH5 | COND./EVA. TEMP. THERMISTOR (0°C/15kΩ, 25°C/5.2kΩ DETECT) |
| | FUSE FUSE (6.3A) | | |
| | LED1 POWER SUPPLY (I.B.) | | |
| | LED2 POWER SUPPLY (I.B.) | | |
| | LED3 TRANSMISSION (INDOOR-OUTDOOR) | | |
| | SW2 SWITCH (CAPACITY CODE) | | |
| | SW3 SWITCH (MODE SELECTION) | | |
| | SWE SWITCH (EMERGENCY OPERATION) | | |
| | X4 RELAY (FAN MOTOR LL) | | |
| | X5 RELAY (FAN MOTOR Lo) | | |
| | X6 RELAY (FAN MOTOR HI) | | |
| | ZNR VARISTOR | | |

SEZ-KA35VA
SEZ-KA50VA
SEZ-KA60VA
SEZ-KA71VA

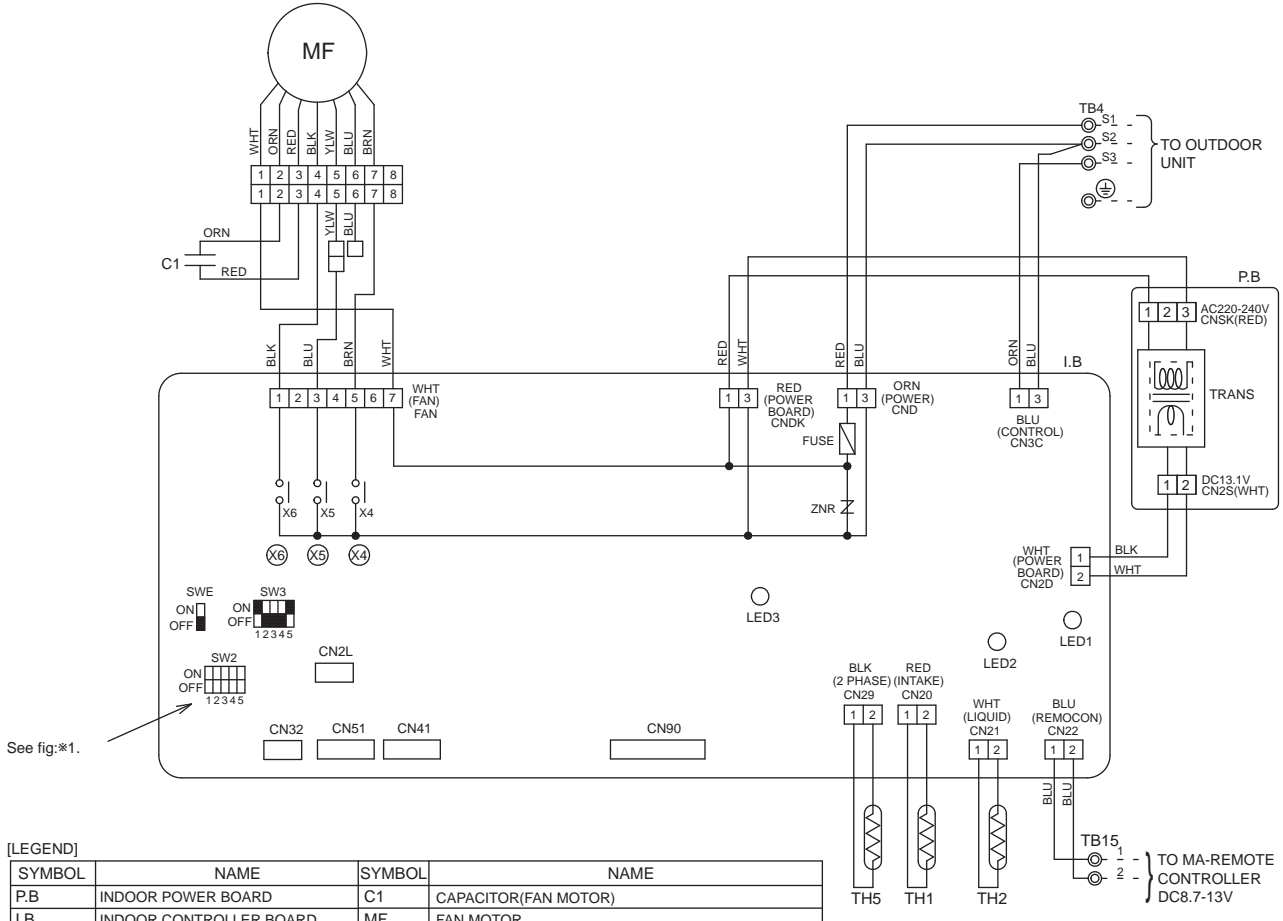

See fig.*1.

[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME |
|--------|------------------------------|--------|--|
| P.B | INDOOR POWER BOARD | C1 | CAPACITOR(FAN MOTOR) |
| I.B | INDOOR CONTROLLER BOARD | MF | FAN MOTOR |
| CN2L | CONNECTOR(LOSSNAY) | TB4 | TERMINAL BLOCK(INDOOR/OUTDOOR CONNECTING LINE) |
| CN32 | CONNECTOR(REMOTE SWITCH) | TB15 | TERMINAL BLOCK(REMOTE CONTROLLER TRANSMISSION LINE) |
| CN41 | CONNECTOR(HA TERMINAL-A) | TH1 | ROOM TEMP.THERMISTOR (0°C/15kΩ,25°C/5.4kΩ DETECT) |
| CN51 | CENTRALLY CONTROL | TH2 | PIPE TEMP.THERMISTOR/LIQUID (0°C/15kΩ,25°C/5.4kΩ DETECT) |
| CN90 | CONNECTOR(WIRELESS) | TH5 | COND./EVA.TEMP.THERMISTOR (0°C/15kΩ,25°C/5.4kΩ DETECT) |
| FUSE | FUSE(T6.3AL250V) | | |
| LED1 | POWER SUPPLY(I.B) | | |
| LED2 | POWER SUPPLY(I.B) | | |
| LED3 | TRANSMISSION(INDOOR-OUTDOOR) | | |
| SW2 | SWITCH(CAPACITY CODE) | | |
| SW3 | SWITCH(MODE SELECTION) | | |
| SWE | SWITCH(EMERGENCY OPERATION) | | |
| X4 | RELAY(FAN MOTOR LL) | | |
| X5 | RELAY(FAN MOTOR Lo) | | |
| X6 | RELAY(FAN MOTOR Hi) | | |
| ZNR | VARIATOR | | |

<fig.*1>

| MODELS | SW2 |
|--------|---------------------|
| KA35 | ON OFF 1 2 3 4 5 |
| KA50 | ON OFF 1 2 3 4 5 |
| KA60 | ON OFF 1 2 3 4 5 |
| KA71 | ON OFF 1 2 3 4 5 |

Notes:

1. Symbols used in wiring diagram above are, : Connector, : Terminal (block).
2. Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers (S1, S2, S3) for correct wirings.
3. Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.
4. Since the indoor fan motor(MF) is connected with 50Hz power, if 60Hz power is used, change the wiring connection shown in fig:*2.

<fig.*2>





*For details on how to operate self-diagnosis, refer to the service manuals etc.

PLA-RP35BA PLA-RP50BA PLA-RP60BA PLA-RP71BA

[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|----------|---------------------------------------|---------|---|-------------|--|
| I.B | INDOOR CONTROLLER BOARD | DCL | REACTOR | OPTION PART | |
| CN2L | CONNECTOR (LOSSNAY) | DP | DRAIN-UP MACHINE | W.B | PCB FOR WIRELESS REMOTE CONTROLLER |
| CN32 | CONNECTOR (REMOTE SWITCH) | FS | DRAIN FLOAT SWITCH | BZ | BUZZER |
| CN41 | CONNECTOR (HA TERMINAL-A) | MF | FAN MOTOR | LED1 | LED (OPERATION INDICATION : GREEN) |
| CN51 | CONNECTOR (CENTRALLY CONTROL) | MV | VANE MOTOR | LED2 | LED (PREPARATION FOR HEATING : ORANGE) |
| DSA | SURGE ABSORBER | TB2 | TERMINAL BLOCK (Indoor unit Power (option)) | RU | RECEIVING UNIT |
| FUSE | FUSE (T6.3AL250V) | TB4 | TERMINAL BLOCK (INDOOR/OUTDOOR CONNECTING LINE) | SW1 | EMERGENCY OPERATION (HEAT / DOWN) |
| LED1 | POWER SUPPLY (I.B) | TB5,TB6 | TERMINAL BLOCK (REMOTE CONTROLLER TRANSMISSION LINE) | SW2 | EMERGENCY OPERATION (COOL / UP) |
| LED2 | POWER SUPPLY (R.B) | | | | |
| LED3 | TRANSMISSION (INDOOR-OUTDOOR) | | | | |
| SW1 | SWITCH (MODEL SELECTION) *See table 1 | TH1 | ROOM TEMP. THERMISTOR (0°C / 15kΩ, 25°C / 5.4kΩ DETECT) | | |
| SW2 | SWITCH (CAPACITY CODE) *See table 2 | TH2 | PIPE TEMP. THERMISTOR/LIQUID (0°C / 15kΩ, 25°C / 5.4kΩ DETECT) | | |
| SWE | CONNECTOR (EMERGENCY OPERATION) | TH5 | COND. / EVA. TEMP. THERMISTOR (0°C / 15kΩ, 25°C / 5.4kΩ DETECT) | | |
| X1 | RELAY (DRAIN PUMP) | | | | |
| ZNR01.02 | VARISTOR | | | | |

Please set the voltage using the remote controller. For the setting method, please refer to the indoor unit installation Manual.

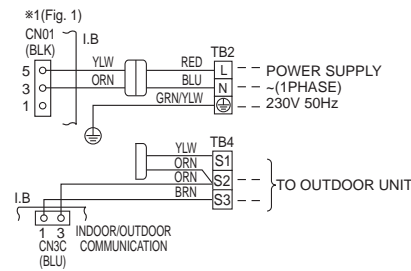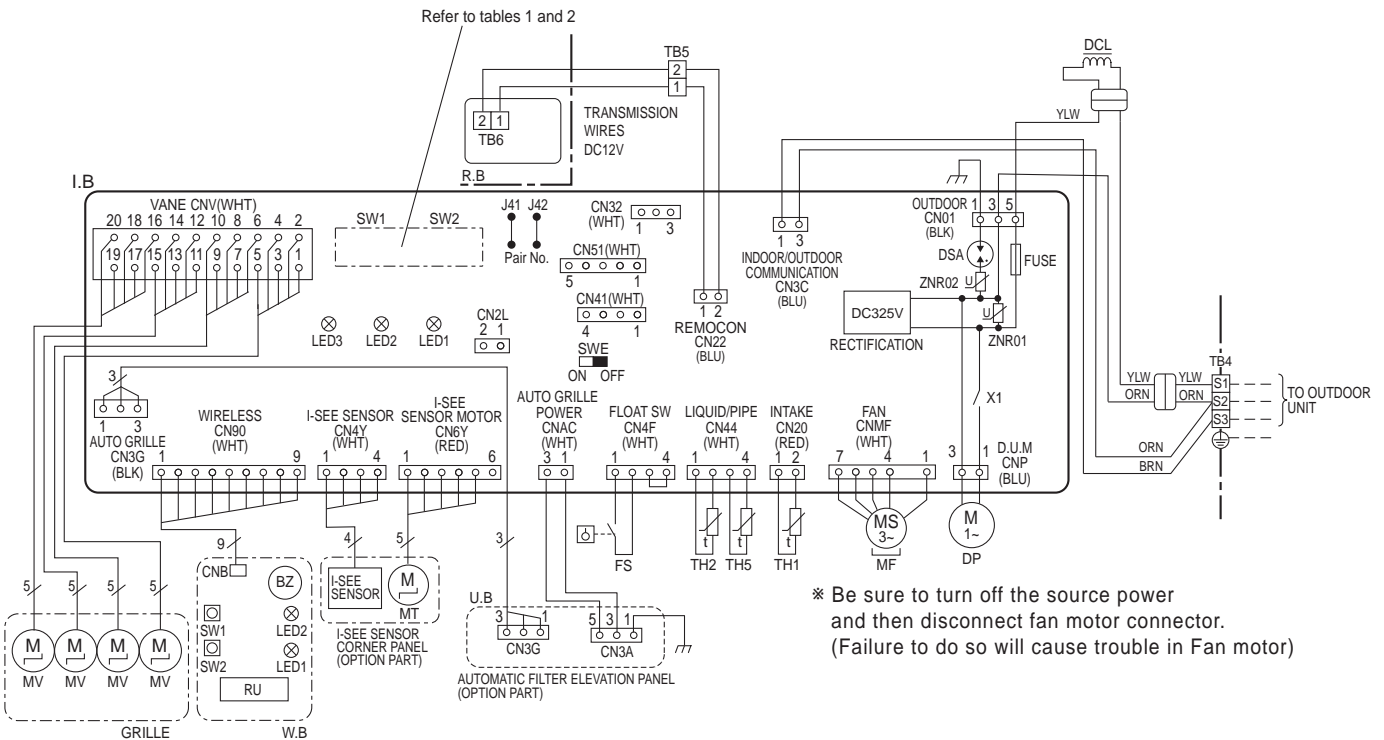

<Table 1>-SW1(MODEL SELECTION)

| SW1 |
|---------------------|
| Manufacture/Service |
| 1 2 3 4 5 ON OFF |

<Table 2>-SW2(CAPACITY CODE)

| MODELS | SW2 | | | | | |
|------------|---------------------|---|---|---|---|--------|
| | Manufacture/Service | | | | | |
| PLA-RP35BA | 1 | 2 | 3 | 4 | 5 | ON OFF |
| PLA-RP50BA | 1 | 2 | 3 | 4 | 5 | ON OFF |
| PLA-RP60BA | 1 | 2 | 3 | 4 | 5 | ON OFF |
| PLA-RP71BA | 1 | 2 | 3 | 4 | 5 | ON OFF |

Notes:

1. Symbols used in wiring diagram above are, : Connector, : Terminal (block).
2. Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers (S1, S2, S3) for correct wirings.
3. Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.
4. This diagram shows the wiring of indoor and outdoor connecting wires. (specification of 230V), adopting superimposed system of power and signal.


*1:When work to Supply power separately to indoor and outdoor units was applied, refer to Fig 1.
 *2:For power supply system of this unit, refer to the caution label located near this diagram.

PLA-RP35AA PLA-RP50AA PLA-RP60AA PLA-RP71AA

[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|--------|-------------------------|----------|--|--------|----------------------------------|
| P.B | INDOOR POWER BOARD | MF | FAN MOTOR | W.B | WIRELESS REMOTE CONTROLLER BOARD |
| I.B | INDOOR CONTROLLER BOARD | MV | VANE MOTOR | RU | RECEIVING UNIT |
| | FUSE | H2 | DEW PREVENTION HEATER | BZ | BUZZER |
| | ZNR | DP | DRAIN-UP MACHINE | LED1 | LED(RUN INDICATOR) |
| | BCR | DS | DRAIN SENSOR | LED2 | LED(HOT ADJUST) |
| | CN2L | TB2 | TERMINAL BLOCK (INDOOR UNIT POWER(OPTION)) | SW1 | SWITCH(HEATING ON/OFF) |
| | CN32 | TB4 | TERMINAL BLOCK (INDOOR/OUTDOOR CONNECTING LINE) | SW2 | SWITCH(COOLING ON/OFF) |
| | CN41 | TB5, TB6 | TERMINAL BLOCK(REMOTE CONTROLLER TRANSMISSION LINE) | | |
| | CN51 | TH1 | ROOM TEMP.THERMISTOR (0°C/15kΩ,25°C/5.4kΩ DETECT) | | |
| | LED1 | TH2 | PIPE TEMP.THERMISTOR/LIQUID (0°C/15kΩ,25°C/5.4kΩ DETECT) | | |
| | LED2 | TH5 | COND./EVA. TEMP. THERMISTOR (0°C/15kΩ,25°C/5.4kΩ DETECT) | | |
| | LED3 | | | | |
| | X1 | | | | |
| | X4 | | | | |
| | SW1 | | | | |
| | SW2 | | | | |
| | SWE | | | | |
| C | CAPACITOR(FAN MOTOR) | R.B | WIRED REMOTE CONTROLLER BOARD | | |

Please set the voltage using the remote controller. For the setting method, please refer to the indoor unit Installation Manual.

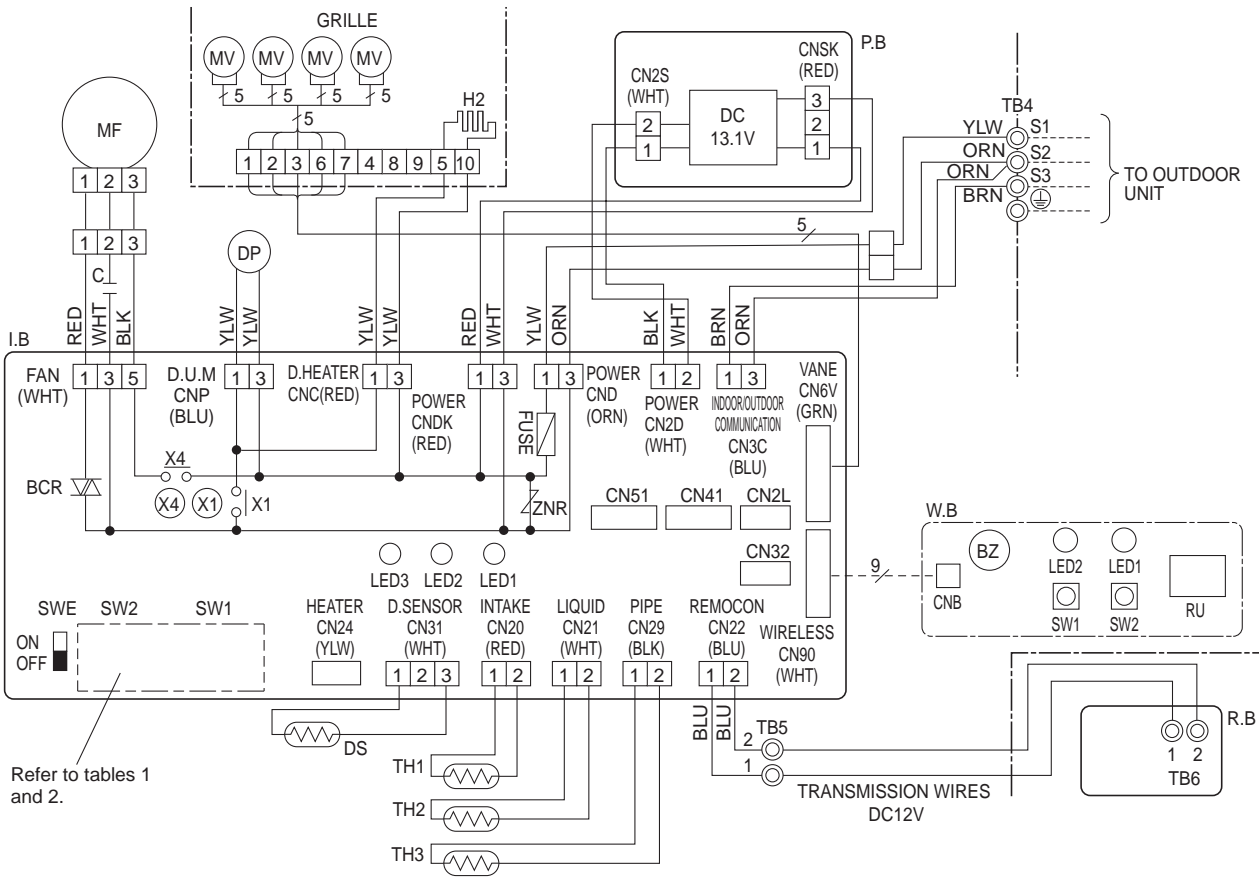

Notes:

- Symbols used in wiring diagram above are, : Connector, : Terminal (block).
- Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers (S1, S2, S3) for correct wirings.
- Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.
- This diagram shows the wiring of indoor and outdoor connecting wires (specification of 230V), adopting superimposed system of power and signal.

Table 1

| MODELS | SW1 | | | | |
|------------|---------------|---|---|---|----------|
| | Service board | | | | |
| PLA-RP. AA | 1 | 2 | 3 | 4 | 5 ON/OFF |


Table 2

| MODELS | SW2 | | | | |
|------------|---------------|---|---|---|----------|
| | Service board | | | | |
| PLA-RP35AA | 1 | 2 | 3 | 4 | 5 ON/OFF |
| PLA-RP50AA | 1 | 2 | 3 | 4 | 5 ON/OFF |
| PLA-RP60AA | 1 | 2 | 3 | 4 | 5 ON/OFF |
| PLA-RP71AA | 1 | 2 | 3 | 4 | 5 ON/OFF |

PCA-RP50GA PCA-RP50GA2 PCA-RP60GA PCA-RP71GA

[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|--------|--|---------|--|--------|--|
| P.B | INDOOR POWER BOARD | MF | FAN MOTOR | W.B | WIRELESS REMOTE CONTROLLER BOARD(OPTION) |
| I.B | INDOOR CONTROLLER BOARD | MV | VANE MOTOR | RU | RECEIVING UNIT |
| FUSE | FUSE (T6.3AL250V) | DP | DRAIN-UP MACHINE (OPTION) | BZ | BUZZER |
| ZNR | VARISTOR | DS | DRAIN SENSOR (OPTION) | LED1 | LED(RUN INDICATOR) |
| CN2L | CONNECTOR(LOSSNAY) | TB2 | TERMINAL BLOCK (HEATER) *PCH-P.GAH models only or option for PCA RP.GA models. | LED2 | LED(HOT ADJUST) |
| CN32 | CONNECTOR(REMOTE SWITCH) | TB4 | TERMINAL BLOCK(INDOOR/OUTDOOR CONNECTING LINE) | SW1 | SWITCH(HEATING ON/OFF) |
| CN41 | CONNECTOR(HA TERMINAL-A) | TB5,TB6 | TERMINAL BLOCK(REMOTE CONTROLLER TRANSMISSION LINE) | SW2 | SWITCH(COOLING ON/OFF) |
| CN51 | CONNECTOR(CENTRALLY CONTROL) | TH1 | ROOM TEMP.THERMISTOR (0°C/15kΩ, 25°C/5.4kΩ DETECT) | HEATER | |
| SW1 | SWITCH (MODEL SELECTION) *See Table 1. | TH2 | PIPE TEMP.THERMISTOR/LIQUID (0°C/15kΩ, 25°C/5.4kΩ DETECT) | FS1,2 | THERMAL FUSE(98°C/10A:50GAH/117°C/16A:100GAH 110°C/16A:60.71,125,140GAH) |
| SW2 | SWITCH (CAPACITY CODE) *See Table 2. | TH5 | COND./EVA.TEMP.THERMISTOR (0°C/15kΩ, 25°C/5.4kΩ DETECT) | H1 | HEATER |
| SWE | SWITCH(EMERGENCY OPERATION) | R.B | WIRED REMOTE CONTROLLER BOARD | 26H | HEATER THERMAL SWITCH |
| X1 | RELAY(DRAIN PUMP) | | | 88H | HEATER CONTACTOR |
| X4 | RELAY(FAN MOTOR) | | | | |
| BCR | FAN CONTROL ELEMENT | | | | |
| LED1 | POWER SUPPLY(L.B) | | | | |
| LED2 | POWER SUPPLY(R.B) | | | | |
| LED3 | TRANSMISSION(INDOOR-OUTDOOR) | | | | |
| C | CAPACITOR(FAN MOTOR) | | | | |

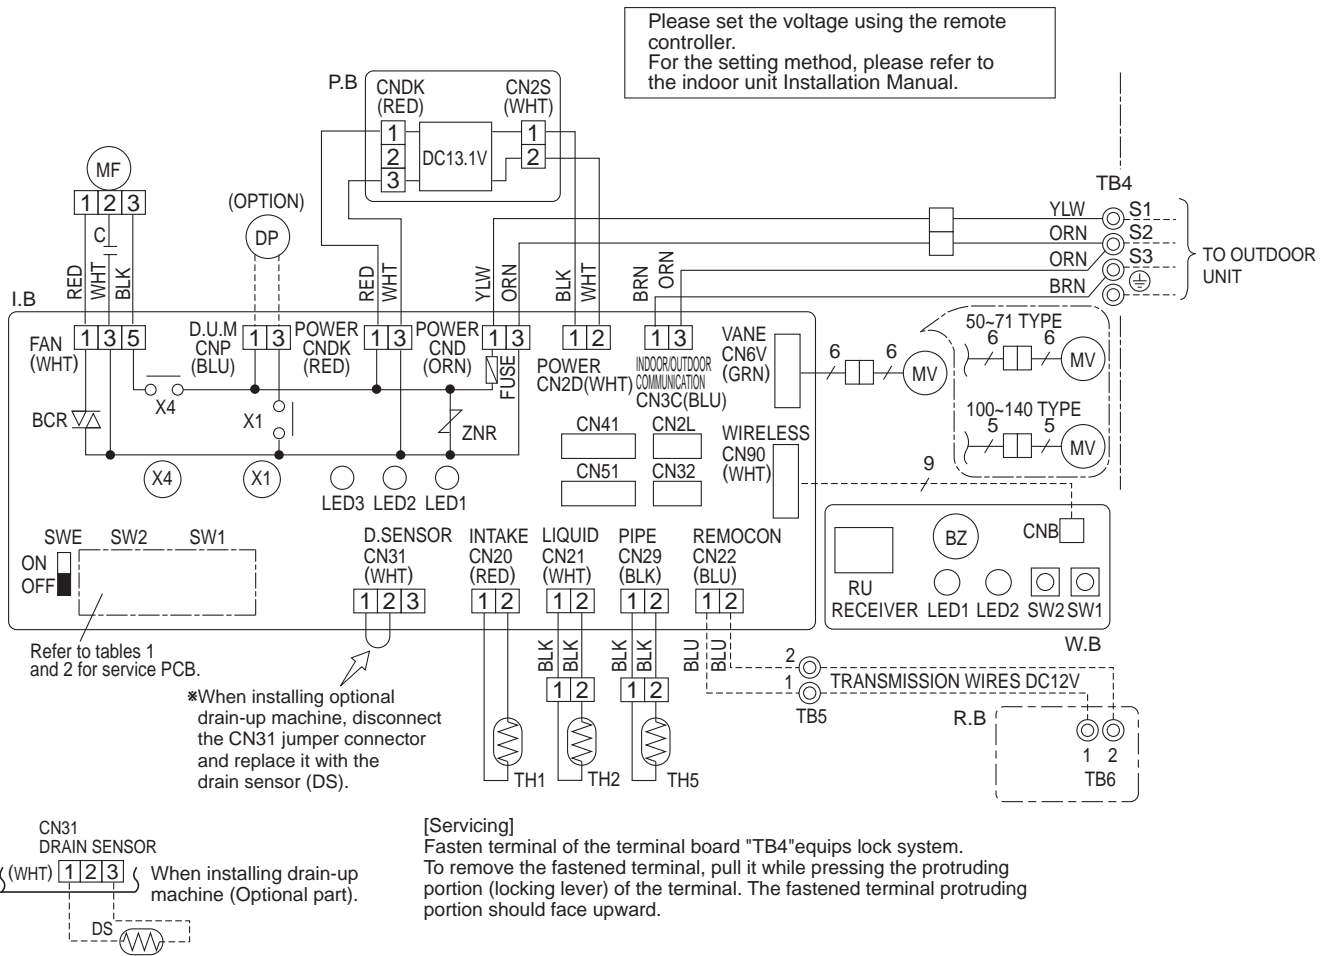

NOTES:

1. Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.
2. Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers (S1, S2, S3) for correct wirings.
3. Make sure that the main power supply of the booster heater is independent.
4. Symbols used in wiring diagram above are,
□□□ : Connector, ○ : Terminal (block).

Table 1

| SW1 | |
|-----------|---------------|
| MODELS | Service board |
| PCA-RP.GA | |

Table 2


| SW2 | |
|---------------------------|---------------|
| MODELS | Service board |
| PCA-RP50GA | |
| PCA-RP50GA2 PCA-RP60GA | |
| PCA-RP71GA | |

PEAD-RP35EA2 PEAD-RP50EA PEAD-RP60EA PEAD-RP71EA

[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|--------|---------------------------------|------------|-----------------------------|--------|---|
| I.B. | INDOOR CONTROLLER BOARD | SW2 | SWITCH(CAPACITY CORD) | TB4 | TERMINAL BLOCK (INDOOR/OUTDOOR CONNECTING LINE) |
| FUSE | FUSE(T6.3AL250V) | SWE | SWITCH(EMERGENCY OPERATION) | TB5 | TERMINAL BLOCK(REMOTE CONTROLLER) |
| ZNR | VARISTOR | X1 | RELAY(DRAIN PUMP) | TH1 | INTAKE AIR TEMP. THERMISTOR (0°C /15kΩ, 25°C /5.4kΩ DETECT) |
| CN2L | CONNECTOR(LOSSNAY) | X4 | RELAY(FAN MOTOR) | TH2 | PIPE TEMP. THERMISTOR/LIQUID (0°C /15kΩ, 25°C /5.4kΩ DETECT) |
| CN24 | CONNECTOR(HEATER) | X5 | RELAY(FAN MOTOR) | TH5 | COND./EVA. TEMP. THERMISTOR (0°C /15kΩ, 25°C /5.4kΩ DETECT) |
| CN32 | CONNECTOR(REMOTE SWITCH) | X6 | RELAY(FAN MOTOR) | | |
| CN41 | CONNECTOR(HA TERMINAL-A) | P.B. | INDOOR POWER BOARD | | |
| CN51 | CONNECTOR(CENTRALLY CONTROL) | DRAIN PUMP | (OPTIONAL PARTS) | | |
| CN90 | CONNECTOR(WIRELESS) | DP | DRAIN PUMP | | |
| LED1 | POWER SUPPLY(I.B.) | DS | DRAIN SENSOR | | |
| LED2 | POWER SUPPLY(REMOTE CONTROLLER) | C | CAPACITOR(FAN MOTOR) | | |
| LED3 | TRANSMISSION(INDOOR•OUTDOOR) | MF | FAN MOTOR | | |
| SW1 | SWITCH(MODEL SELECTION) | | | | |

INSIDE SECTION OF CONTROL BOX

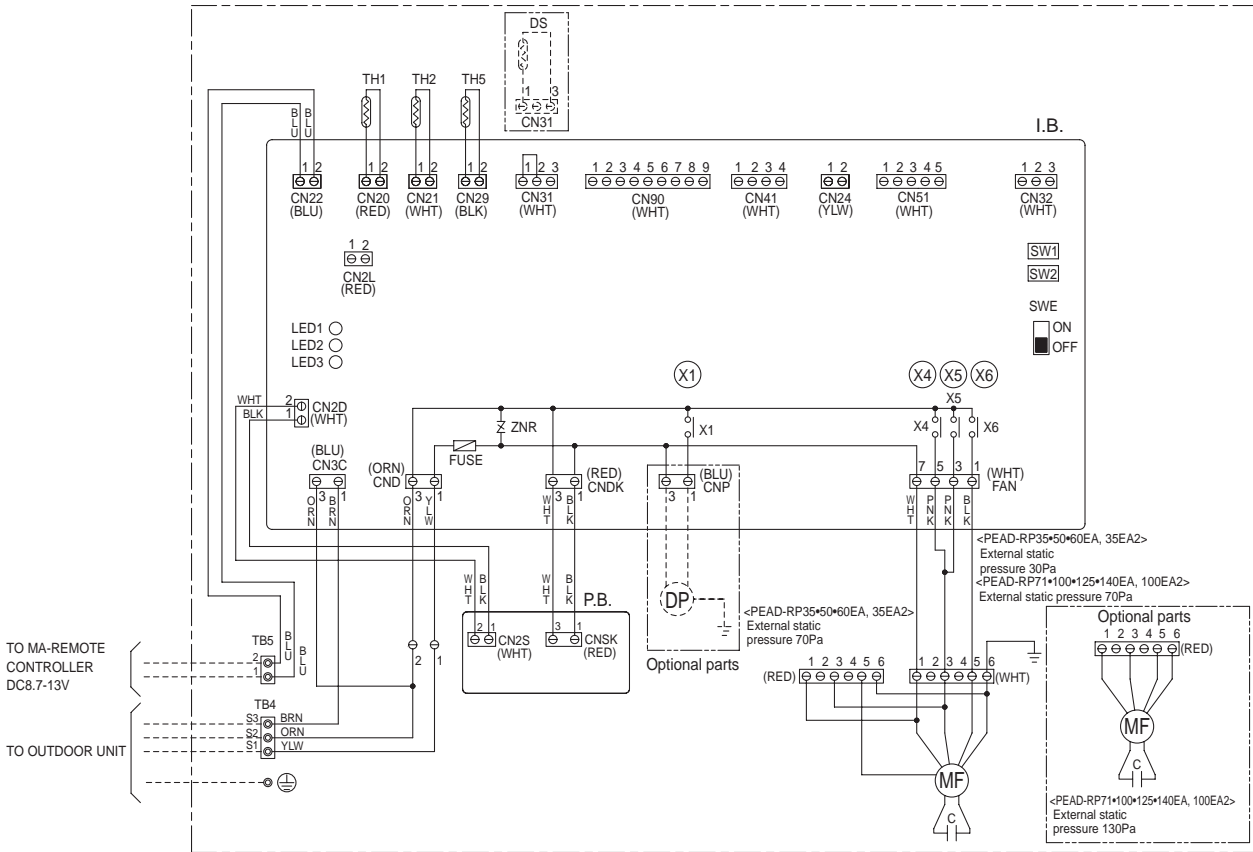

NOTES:


1. Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.
2. Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers (S1, S2, S3) for correct wirings.
3. Symbols used in wiring diagram above are,
⊗ : Connector, ⊙ : Terminal (block).
4. The wiring between MA-Remote controller and TB5 is included in the package.

| MODELS | SW1 Model selection switch | SW2 Capacity cord switch |
|--------|-------------------------------|-----------------------------|
| 35EA2 | | |
| 50EA | | |
| 60EA | | |
| 71EA | | |

PEAD-RP60GA PEAD-RP71GA

[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|--------|---------------------------------|--------|--|--------|--|
| I.B. | INDOOR CONTROLLER BOARD | SW1 | SWITCH(MODEL SELECTION) | TB5 | TERMINAL BLOCK(REMOTE CONTROLLER) |
| FUSE | FUSE(T6.3AL250V) | SW2 | SWITCH(CAPACITY CORD) | TH1 | INTAKE AIR TEMP.THERMISTOR (0°C /15kΩ, 25°C/5.4kΩ DETECT) |
| ZNR | VARISTOR | SWE | SWITCH(EMERGENCY OPERATION) | TH2 | PIPE TEMP. THERMISTOR/LIQUID (0°C /15kΩ, 25°C/5.4kΩ DETECT) |
| CN2L | CONNECTOR(LOSSNAY) | X1 | RELAY(DRAIN PUMP) | TH5 | COND./EVA. TEMP. THERMISTOR (0°C /15kΩ, 25°C/5.4kΩ DETECT) |
| CN24 | CONNECTOR(HEATER) | X4 | RELAY(FAN MOTOR) | | |
| CN32 | CONNECTOR(REMOTE SWITCH) | X5 | RELAY(FAN MOTOR) | | |
| CN41 | CONNECTOR(HA TERMINAL-A) | X6 | RELAY(FAN MOTOR) | | |
| CN51 | CONNECTOR(CENTRALLY CONTROL) | P.B. | INDOOR POWER BOARD | | |
| CN90 | CONNECTOR(WIRELESS) | C | CAPACITOR(FAN MOTOR) | | |
| LED1 | POWER SUPPLY(I.B.) | MF | FAN MOTOR | | |
| LED2 | POWER SUPPLY(REMOTE CONTROLLER) | TB4 | TERMINAL BLOCK (INDOOR/OUTDOOR CONNECTING LINE) | | |
| LED3 | TRANSMISSION(INDOOR•OUTDOOR) | | | | |

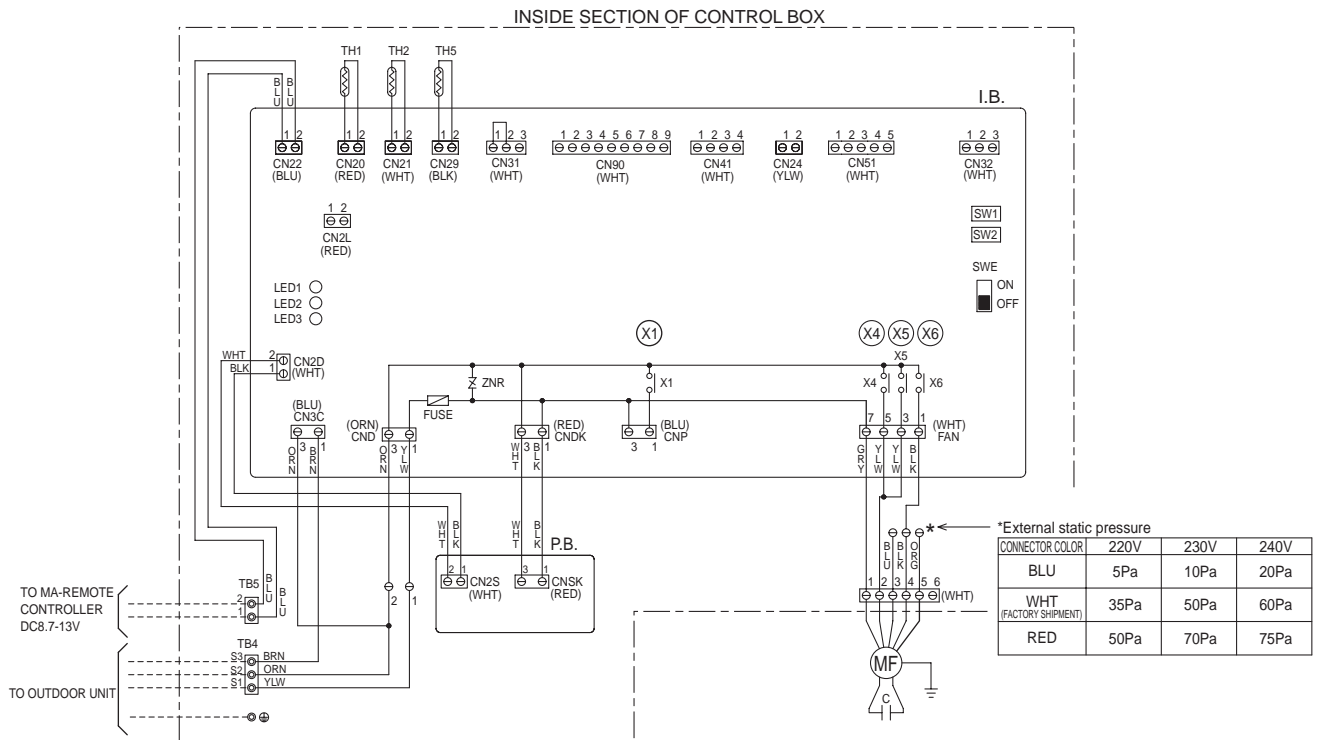

| MODELS | SW1 | SW2 | | | | | | | | | | | | | | | | | | | | |
|--------|--|----------------------|-----|----|---|---|----|-----|----|-----|----|--|---|---|---|---|---|----|-----|----|-----|----|
| | Model selection switch | Capacity cord switch | | | | | | | | | | | | | | | | | | | | |
| 60GA | <table border="1"> <tr><td>1</td><td>2</td><td>3</td><td>4</td><td>5</td></tr> <tr><td>ON</td><td>OFF</td><td>ON</td><td>OFF</td><td>ON</td></tr> </table> | 1 | 2 | 3 | 4 | 5 | ON | OFF | ON | OFF | ON | <table border="1"> <tr><td>1</td><td>2</td><td>3</td><td>4</td><td>5</td></tr> <tr><td>ON</td><td>OFF</td><td>ON</td><td>OFF</td><td>ON</td></tr> </table> | 1 | 2 | 3 | 4 | 5 | ON | OFF | ON | OFF | ON |
| 1 | 2 | 3 | 4 | 5 | | | | | | | | | | | | | | | | | | |
| ON | OFF | ON | OFF | ON | | | | | | | | | | | | | | | | | | |
| 1 | 2 | 3 | 4 | 5 | | | | | | | | | | | | | | | | | | |
| ON | OFF | ON | OFF | ON | | | | | | | | | | | | | | | | | | |
| 71GA | <table border="1"> <tr><td>1</td><td>2</td><td>3</td><td>4</td><td>5</td></tr> <tr><td>ON</td><td>OFF</td><td>ON</td><td>OFF</td><td>ON</td></tr> </table> | 1 | 2 | 3 | 4 | 5 | ON | OFF | ON | OFF | ON | <table border="1"> <tr><td>1</td><td>2</td><td>3</td><td>4</td><td>5</td></tr> <tr><td>ON</td><td>OFF</td><td>ON</td><td>OFF</td><td>ON</td></tr> </table> | 1 | 2 | 3 | 4 | 5 | ON | OFF | ON | OFF | ON |
| 1 | 2 | 3 | 4 | 5 | | | | | | | | | | | | | | | | | | |
| ON | OFF | ON | OFF | ON | | | | | | | | | | | | | | | | | | |
| 1 | 2 | 3 | 4 | 5 | | | | | | | | | | | | | | | | | | |
| ON | OFF | ON | OFF | ON | | | | | | | | | | | | | | | | | | |

NOTES:

1. Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.
2. Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers (S1, S2, S3) for correct wirings.
3. Symbols used in wiring diagram above are,
 : Connector, : Terminal (block).
4. The wiring between MA-Remote controller and TB5 is included in the package.

PEA-RP71EA

[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|--------|-------------------------------------|--------|---|--------|--|
| P.B | INDOOR POWER BOARD | I.B | SW1 SWITCH(MODEL SELECTION)*See table 1 | TB2 | TERMINAL BLOCK(INDOOR UNIT POWER(OPTION)) |
| I.B | INDOOR CONTROLLER BOARD | | SW2 SWITCH(CAPACITY CODE)*See table 2 | TB4 | TERMINAL BLOCK (INDOOR/OUTDOOR CONNECTING LINE) |
| | FUSE FUZE(T6.3AL250V) | | SWE SWITCH(EMERGENCY OPERATION) | TB5 | TERMINAL BLOCK(REMOTE CONTROLLER TRANSMISSION LINE) |
| | ZNR VARISTOR | X4 | RELAY(FAN MOTOR) | TH1 | ROOM TEMPERATURE THERMISTOR (0°C/15kΩ, 25°C/5.4kΩ DETECT) |
| | CN2L CONNECTOR(LOSSNAY) | X5 | RELAY(FAN MOTOR) | TH2 | PIPE TEMPERATURE THERMISTOR/LIQUID (0°C/15kΩ, 25°C/5.4kΩ DETECT) |
| | CN32 CONNECTOR(REMOTE SWITCH)) | X6 | RELAY(FAN MOTOR) | TH5 | COND./EVA. TEMPERATURE THERMISTOR (0°C/15kΩ, 25°C/5.4kΩ DETECT) |
| | CN41 CONNECTOR(HA TERMINAL-A) | R.B | REMOTE CONTROLLER BOARD | | |
| | CN51 CONNECTOR(CENTRALLY CONTROL) | | TB6 TERMINAL BLOCK(REMOTE CONTROLLER TRANSMISSION LINE) | | |
| | LED1 POWER SUPPLY(I.B) | C | CAPACITOR(FAN MOTOR) | | |
| | LED2 POWER SUPPLY(R.B) | MF | FAN MOTOR | | |
| | LED3 TRANSMISSION(INDOOR • OUTDOOR) | | | | |

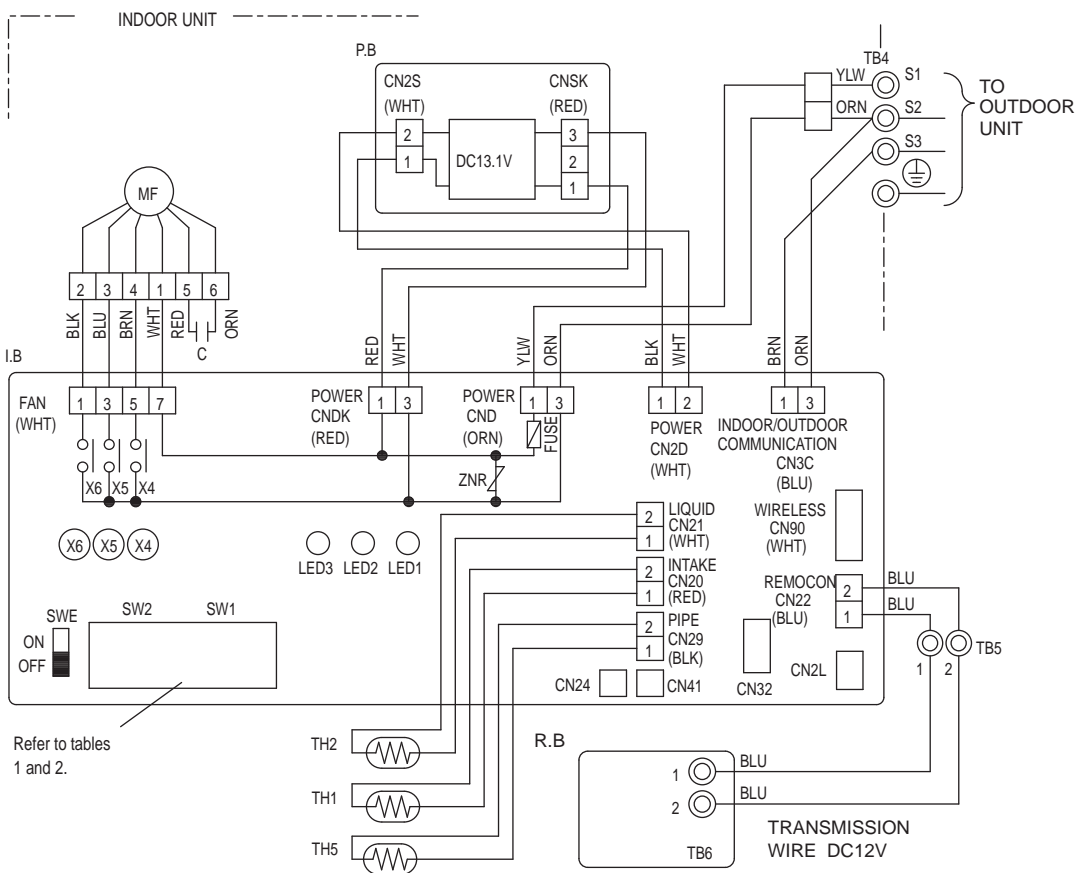


Table 1

| MODELS | SW1 | | | | |
|----------|---------------------|---|---|---|----------|
| | Manufacture/Service | | | | |
| PEA-RPEA | 1 | 2 | 3 | 4 | 5 ON OFF |

Table 2


| MODELS | SW2 | | | | |
|------------|---------------------|---|---|---|----------|
| | Manufacture/Service | | | | |
| PEA-RP71EA | 1 | 2 | 3 | 4 | 5 ON OFF |

Please set the voltage using the remote controller. For the setting method, please refer to the indoor unit installation Manual.

NOTES:

1. Since the outdoor side electric wiring may change, be sure to check the outdoor unit electric wiring diagram for servicing.
2. Indoor and outdoor connecting wires have polarities, make sure to match terminal numbers (S1, S2, S3) for correct wirings.
3. Symbols used in wiring diagram above are, □□: Connector, ⊙: Terminal (block).
4. This diagram shows the wiring of Indoor and Outdoor connecting wires(specification of 230V), adopting superimposed system of power and signal.

SUZ-KA25VA
SUZ-KA35VA

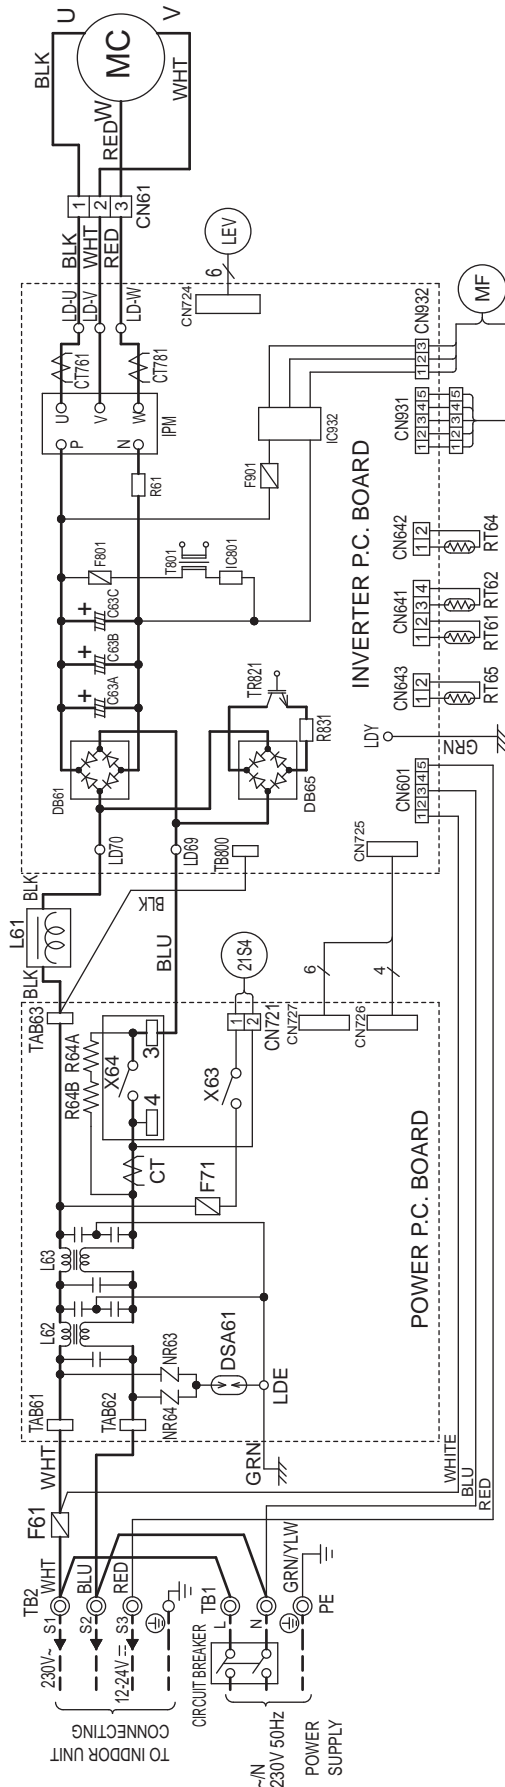


NOTE: 1. About the indoor electric wiring, refer to the indoor unit electric wiring diagram for servicing.
2. Use copper conductors only. (For field wiring)
3. Symbols below indicate.
⊙: Terminal block, □□□□: Connector

[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|----------------|--------------------------|------------|----------------------------------|-----------|----------------------------|
| CT,C761,C781 | CURRENT TRANSFORMER | L61 | REACTOR | R61, R831 | CURRENT-DETECTING RESISTOR |
| C63A,C63B,C63C | SMOOTHING CAPACITOR | L62,L63 | CMC COIL | R64A,R64B | CURRENT-LIMITING RESISTOR |
| DB61, DB65 | DIODE MODULE | MC | COMPRESSOR | TB1, TB2 | TERMINAL BLOCK |
| DSA61 | SURGE ABSORBER | MF | OUTDOOR FAN MOTOR | TR821 | SWITCHING POWER TRANSISTOR |
| F61 | FUSE (T20AL250V) | NR63, NR64 | VARIATOR | T801 | TRANSFORMER |
| F71 | FUSE (T3.15AL250V) | RT61 | DEFROST THERMISTOR | X63, X64 | RELAY |
| F801, F901 | FUSE (T3.15AL250V) | RT62 | DISCHARGE TEMPERATURE THERMISTOR | 21S4 | R. V. COIL |
| IC801 | INTELLIGENT POWER DEVICE | RT64 | FIN TEMPERATURE THERMISTOR | LEV | EXPANSION VALVE COIL |
| IPM, IC932 | INTELLIGENT POWER MODULE | RT65 | AMBIENT TEMPERATURE THERMISTOR | | |

SUZ-KA25VAH
SUZ-KA35VAH

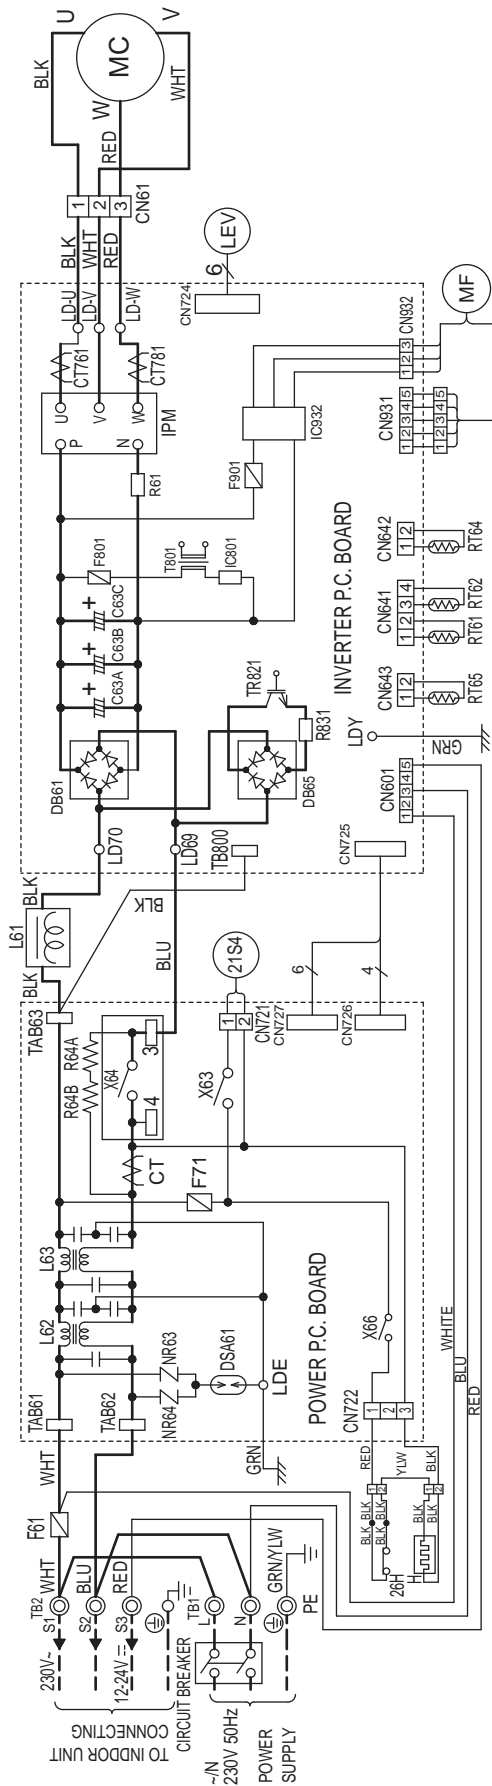


NOTE:1. About the indoor electric wiring, refer to the indoor unit electric wiring diagram for servicing.
2. Use copper conductors only. (For field wiring)
3. Symbols below indicate.
◎: Terminal block, □□□: Connector

[LEGEND]

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|----------------|--------------------------|-----------|----------------------------------|-------------|----------------------------|
| CT,CT761,CT781 | CURRENT TRANSFORMER | L61 | REACTOR | R64A,R64B | CURRENT-LIMITING RESISTOR |
| C63A,C63B,C63C | SMOOTHING CAPACITOR | L62,L63 | CMC COIL | TB1,TB2 | TERMINAL BLOCK |
| DB61,DB65 | DIODE MODULE | MC | COMPRESSOR | TR821 | SWITCHING POWER TRANSISTOR |
| DSA61 | SURGE ABSORBER | MF | OUTDOOR FAN MOTOR | T801 | TRANSFORMER |
| F61 | FUSE (T20AL250V) | NR63,NR64 | VARISTOR | X63,X64,X66 | RELAY |
| F71 | FUSE (T3.15AL250V) | RT61 | DEFROST THERMISTOR | 21S4 | R.V. COIL |
| F801,F901 | FUSE (T3.15AL250V) | RT62 | DISCHARGE TEMPERATURE THERMISTOR | H | DEFROST HEATER |
| IC801 | INTELLIGENT POWER DEVICE | RT64 | FIN TEMPERATURE THERMISTOR | 26H | HEATER PROTECTOR |
| IPM,IC932 | INTELLIGENT POWER MODULE | RT65 | AMBIENT TEMPERATURE THERMISTOR | | |
| LEV | EXPANSION VALVE COIL | R61,R831 | CURRENT-DETECTING RESISTOR | | |


**SUZ-KA50VA
SUZ-KA60VA**

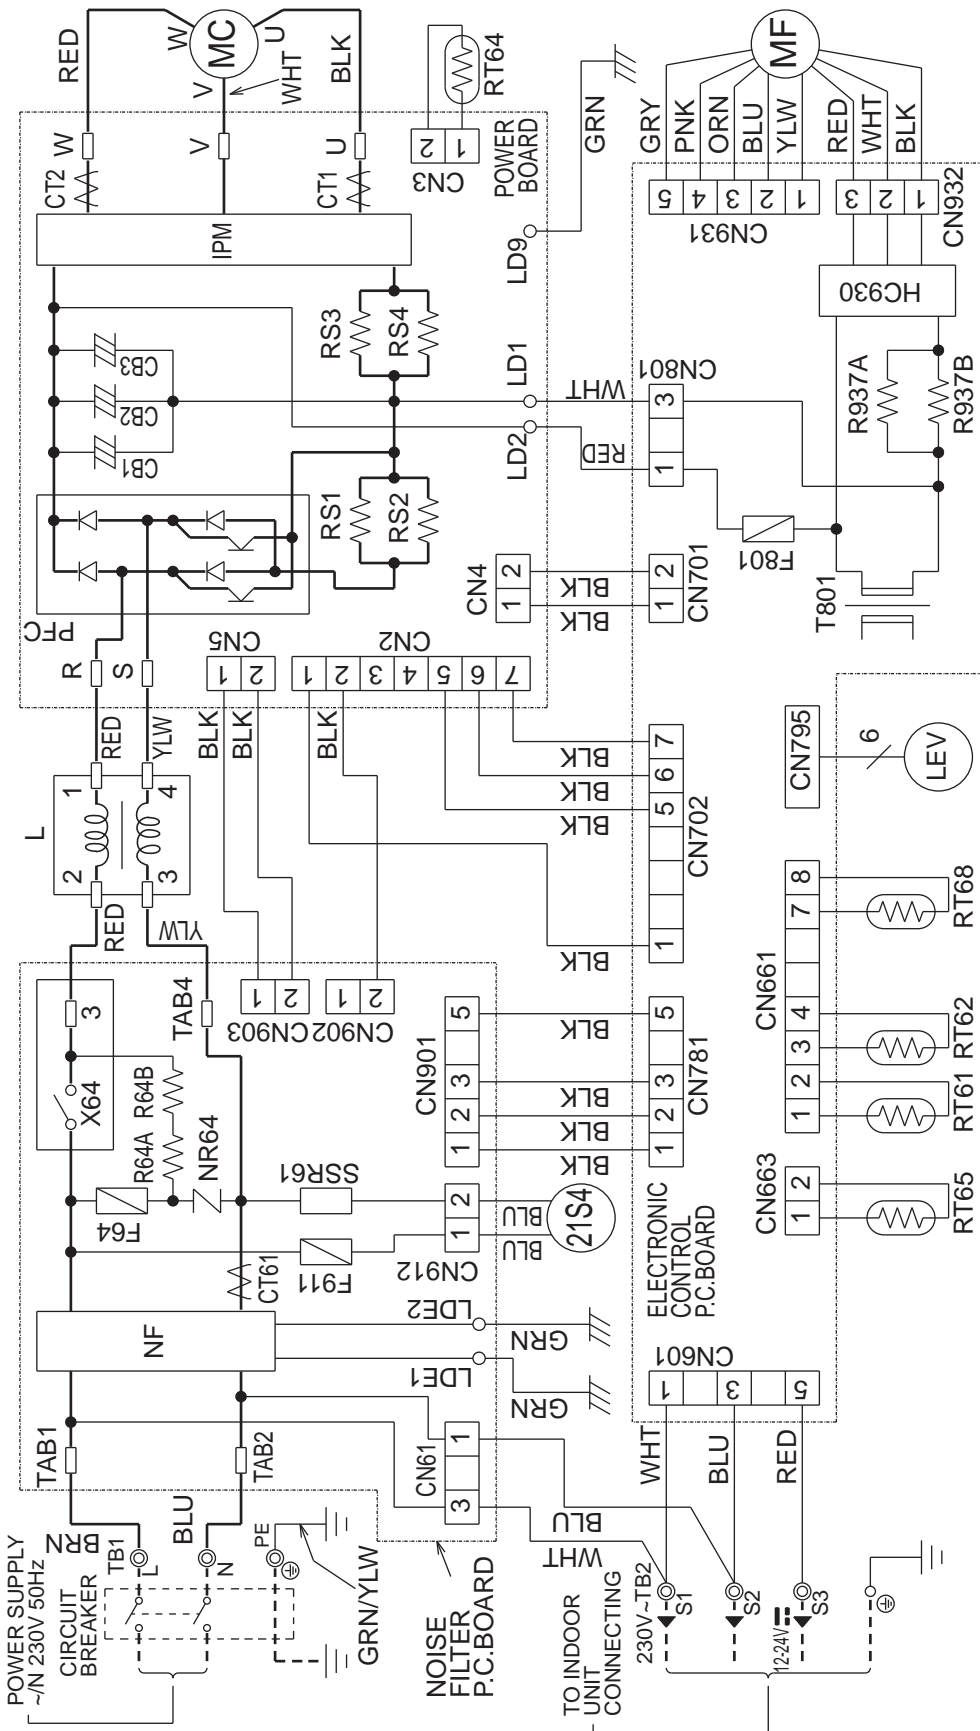

NOTES: 1. About the indoor electric wiring, refer to the indoor unit electric wiring diagram for servicing.
 2. Use copper conductors only (for field wiring).
 3. Symbols below indicate.
 ⊙: Terminal block □: Connector

| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|--------|--------------------------|----------|----------------------------------|--------|---|
| CB1-3 | SMOOTHING CAPACITOR | MC | COMPRESSOR | RT64 | FIN TEMPERATURE THERMISTOR |
| CT1, 2 | CURRENT TRANSFORMER | MF | OUTDOOR FAN MOTOR | RT65 | AMBIENT TEMPERATURE THERMISTOR |
| CT61 | CURRENT TRANSFORMER | NF | NOISE FILTER | RT68 | OUTDOOR HEAT EXCHANGER TEMPERATURE THERMISTOR |
| F64 | FUSE (T2AL 250V) | NR64 | VARIABLE RESISTOR | SSR61 | SOLENOID COIL RELAY |
| F801 | FUSE (T3.15AL 250V) | PFC | POWER FACTOR CONTROLLER | T801 | TRANSFORMER |
| F911 | FUSE (T1AL 250V) | R64A, B | RESISTOR | TB1 | TERMINAL BLOCK |
| HC930 | INTELLIGENT POWER MODULE | R937A, B | RESISTOR | TB2 | TERMINAL BLOCK |
| IPM | INTELLIGENT POWER MODULE | RS1-4 | RESISTOR | X64 | RELAY |
| L | REACTOR | RT61 | DEFROST THERMISTOR | 21S4 | DISCHARGE TEMPERATURE THERMISTOR |
| LEV | EXPANSION VALVE COIL | RT62 | DISCHARGE TEMPERATURE THERMISTOR | 21S4 | I.R.V. COIL |

SUZ-KA71VA

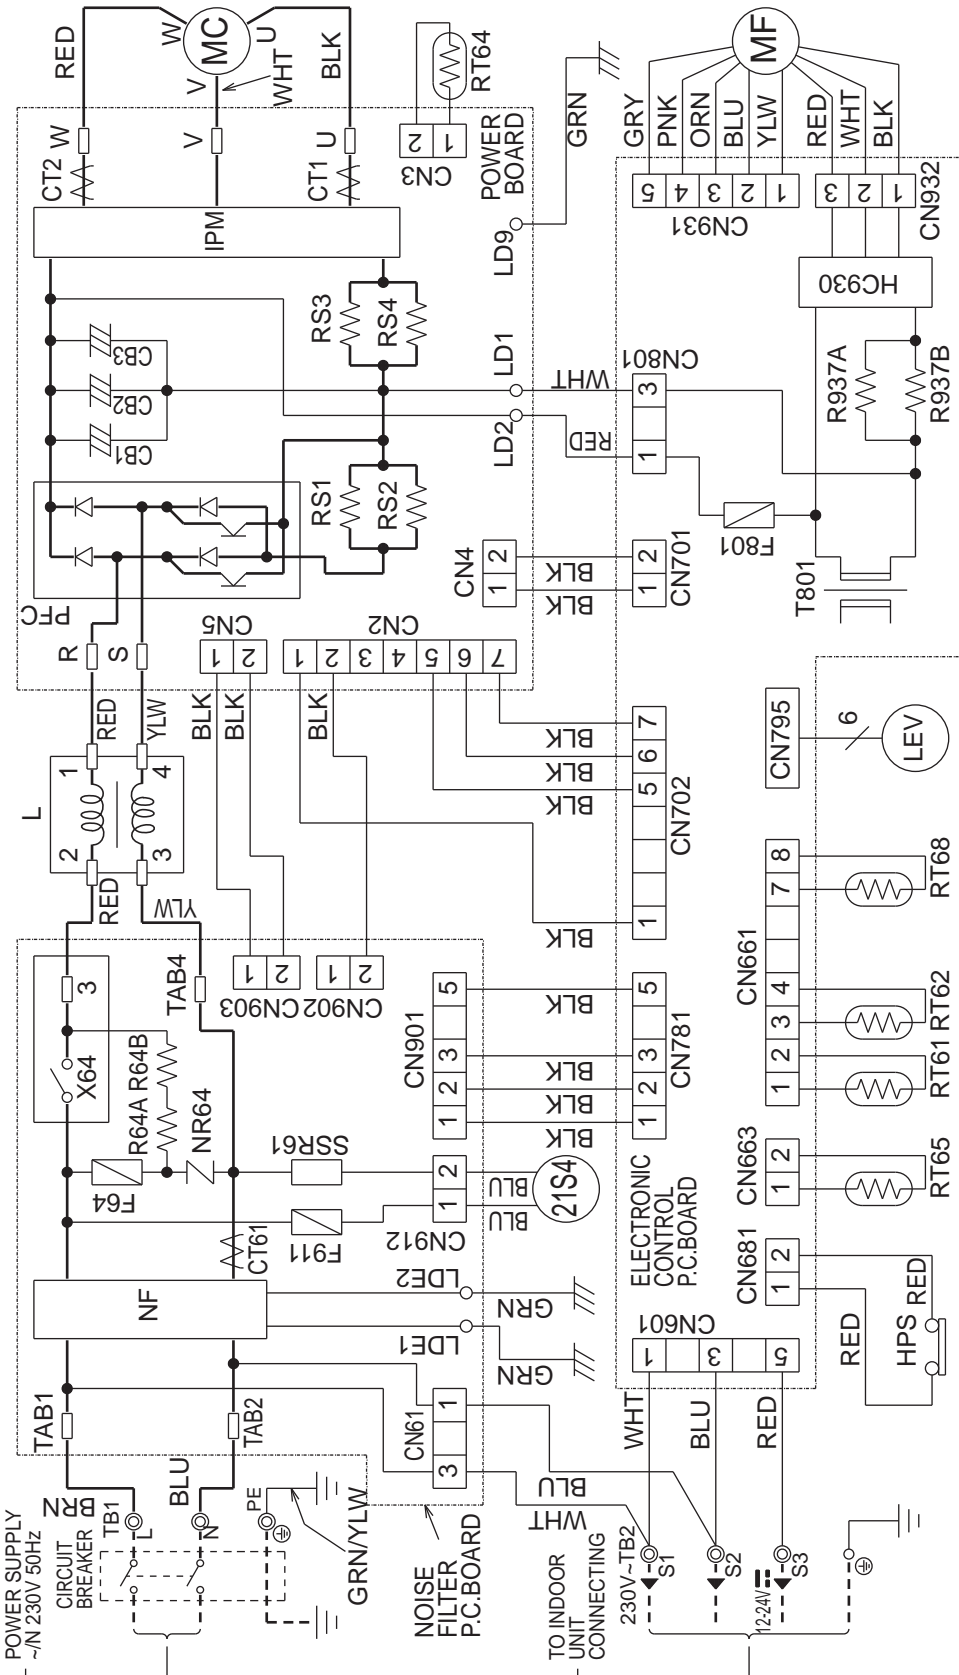

NOTES:

1. About the indoor electric wiring, refer to the indoor unit electric wiring diagram for servicing.
2. Use copper conductors only (for field wiring).
3. Symbols below indicate.
 - ⊕: Terminal block
 - : Connector

[LEGEND]


| SYMBOL | NAME | SYMBOL | NAME | SYMBOL | NAME |
|--------|--------------------------|----------|----------------------------|--------|---|
| CBT-3 | SMOOTHING CAPACITOR | MC | COMPRESSOR | RT65 | AMBIENT TEMPERATURE THERMISTOR |
| CT1, 2 | CURRENT TRANSFORMER | MF | OUTDOOR FAN MOTOR | RT68 | OUTDOOR HEAT EXCHANGER TEMPERATURE THERMISTOR |
| CT61 | CURRENT TRANSFORMER | NF | NOISE FILTER | SSR61 | SOLENOID COIL RELAY |
| F84 | FUSE (T2AL 250V) | NR64 | VARIATOR | T801 | TRANSFORMER |
| F801 | FUSE (T3.15AL 250V) | PFC | POWER FACTOR CONTROLLER | TB1 | TERMINAL BLOCK |
| F911 | FUSE (T1AL 250V) | R64A, B | RESISTOR | TB2 | TERMINAL BLOCK |
| HC930 | INTELLIGENT POWER MODULE | R337A, B | RESISTOR | X64 | RELAY |
| HPS | HIGH PRESSURE SWITCH | RS1~4 | RESISTOR | 21S4 | R.V. COIL |
| IPM | INTELLIGENT POWER MODULE | RT61 | DEFROST THERMISTOR | RT64 | DISCHARGE TEMPERATURE THERMISTOR |
| L | REACTOR | RT64 | FIN TEMPERATURE THERMISTOR | | |
| LEV | EXPANSION VALVE COIL | | | | |

5

REFRIGERANT SYSTEM DIAGRAM

5-1. INDOOR UNIT MFZ-KA25VA MFZ-KA35VA MFZ-KA50VA

Unit : mm

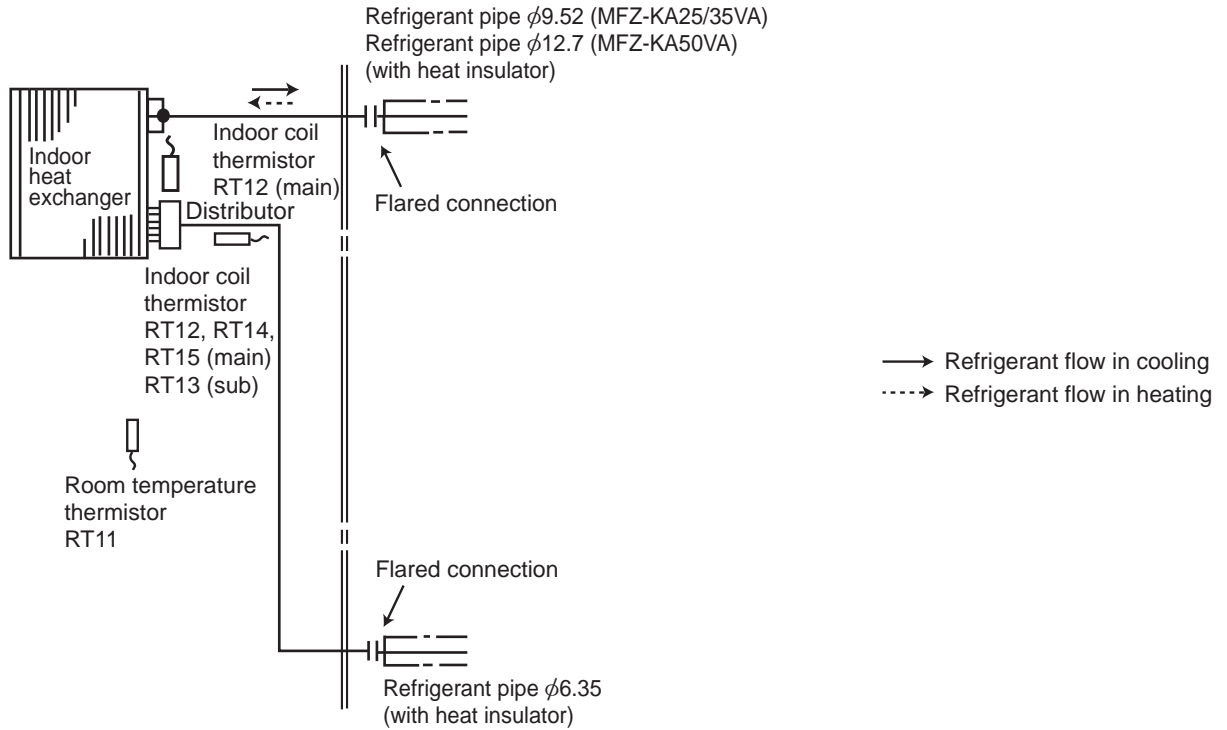


SLZ-KA-VA
SEZ-KC-VA
PLA-RP-BA
PEAD-RP-GA

SLZ-KA-VAL
SEZ-KA-VA
PLA-RP-AA
PEA-RP-EA


SEZ-KD-VA
PCA-RP-GA(2)

SEZ-KD-VAL
PEAD-RP-EA(2)

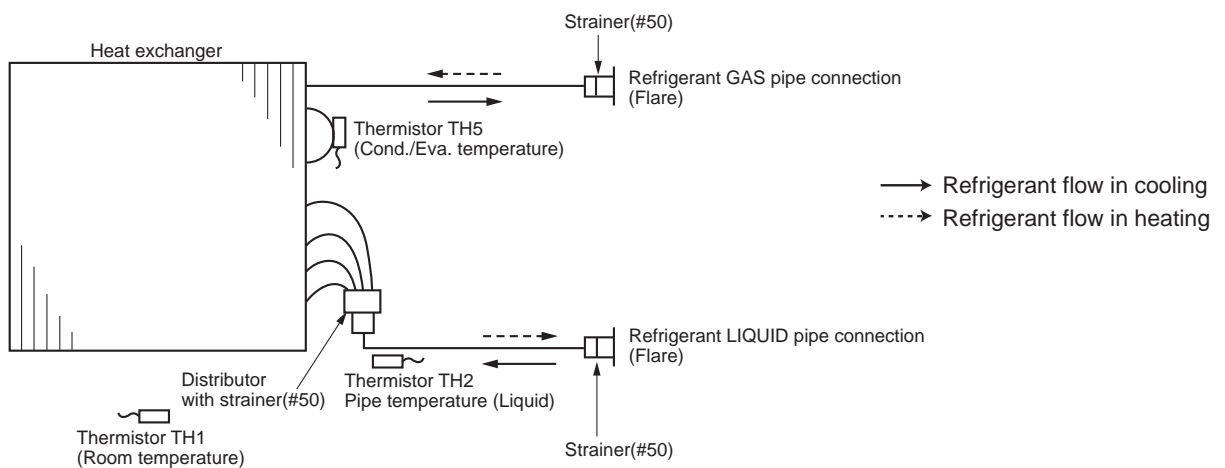


5-2. OUTDOOR UNIT
SUZ-KA25VA SUZ-KA25VAH

Unit:mm

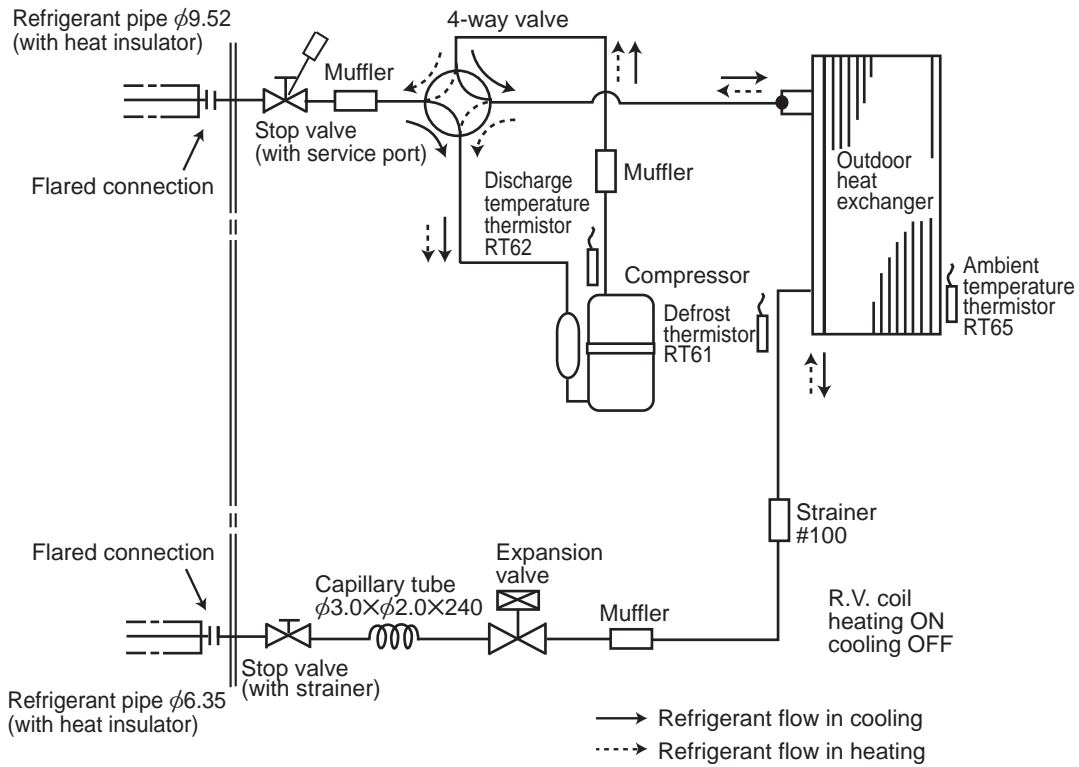


SUZ-KA35VA SUZ-KA35VAH

Unit:mm

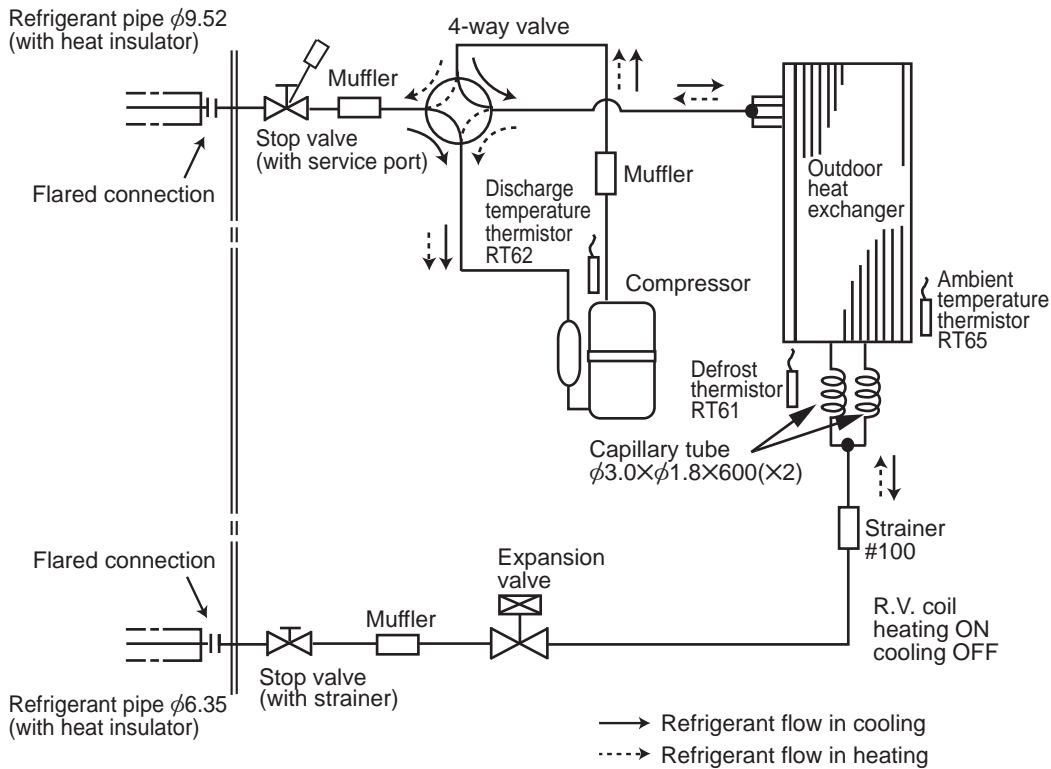


SUZ-KA50VA
SUZ-KA60VA

Unit:mm

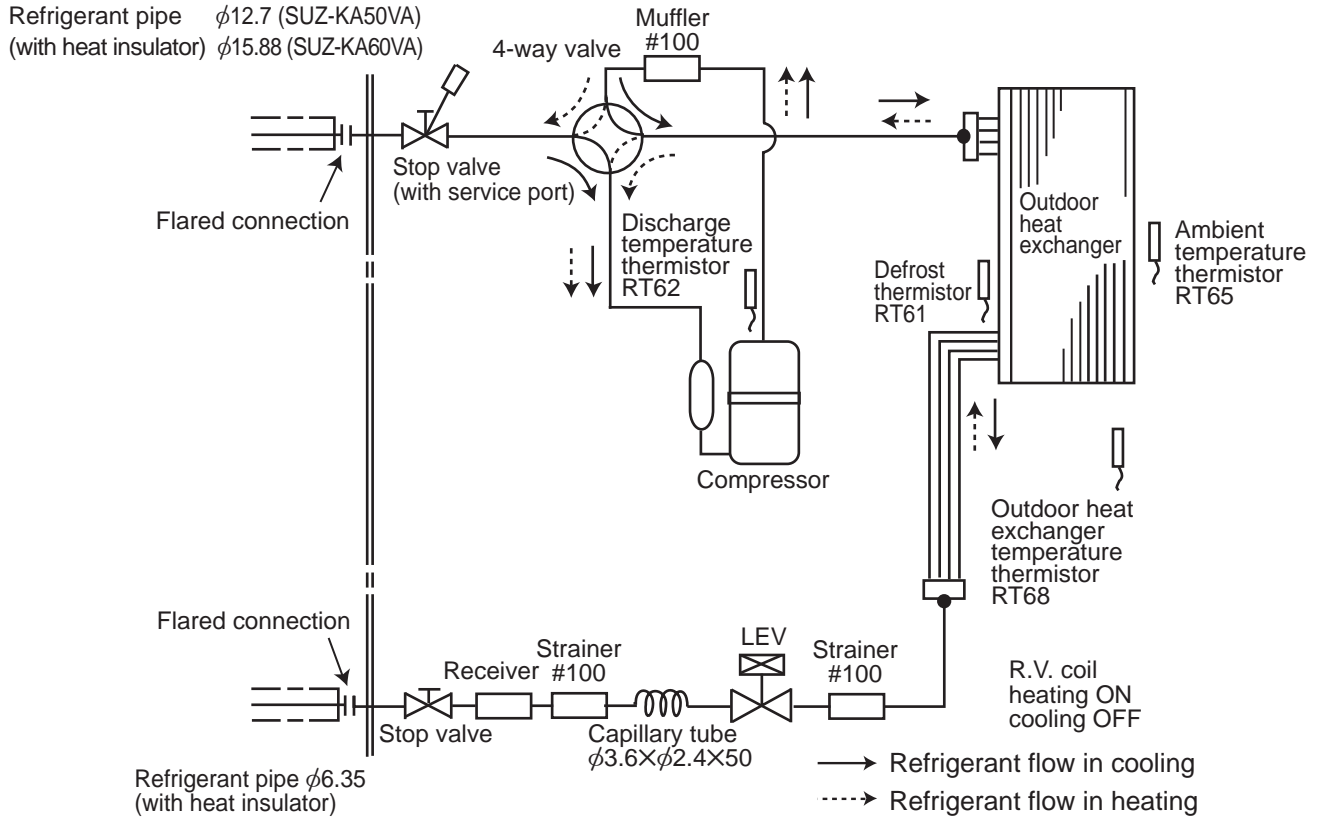

SUZ-KA71VA

Unit:mm

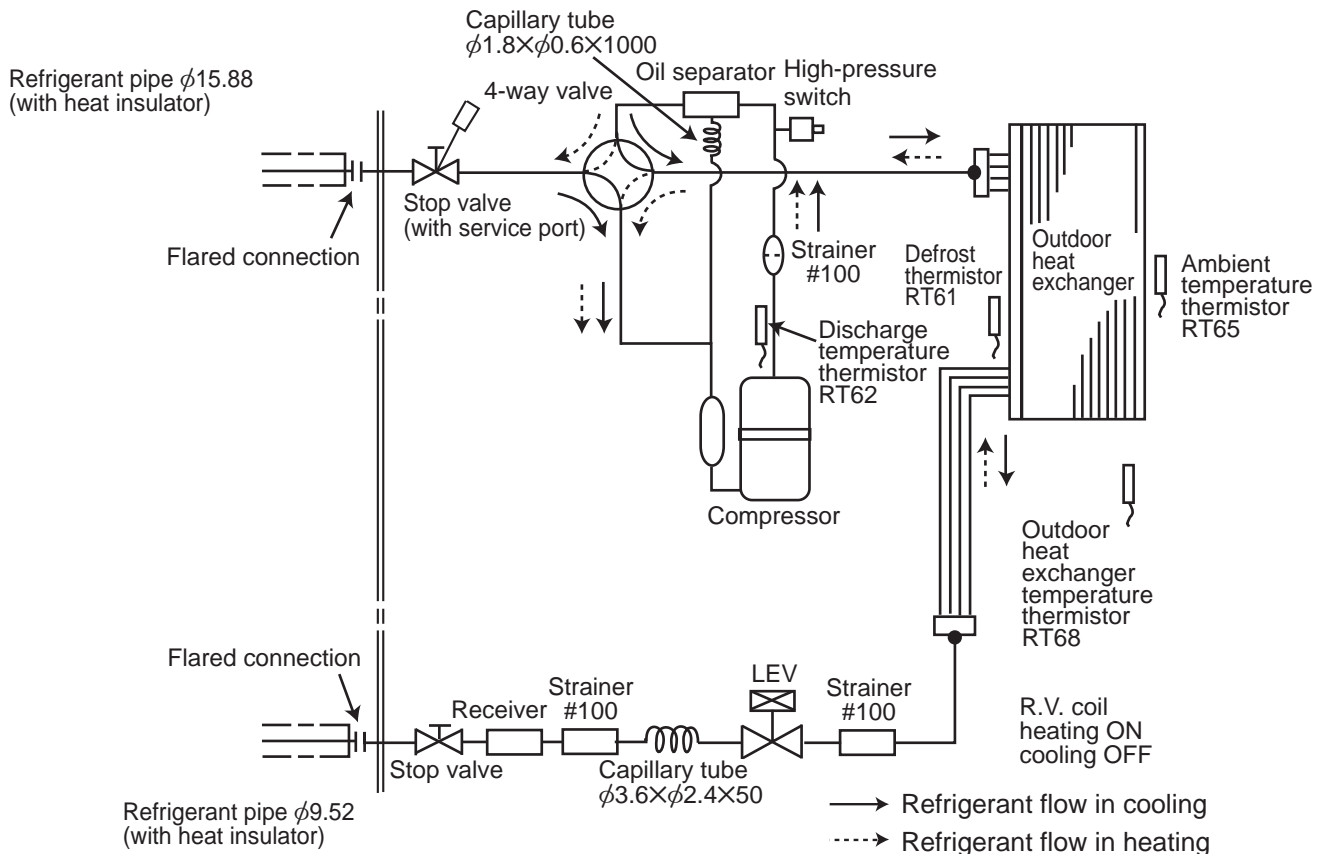


6


PERFORMANCE CURVES

FOR THE COMBINATION OF OUTDOOR UNIT SUZ-KA25VA(H)

Cooling capacity

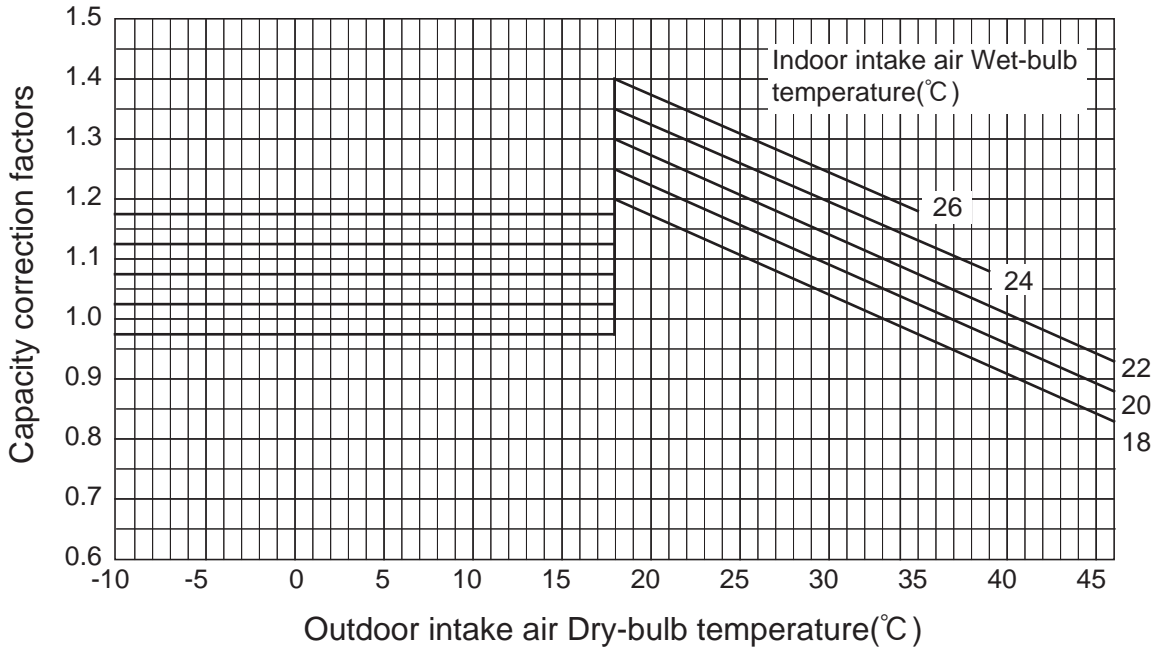


Total input (cooling)

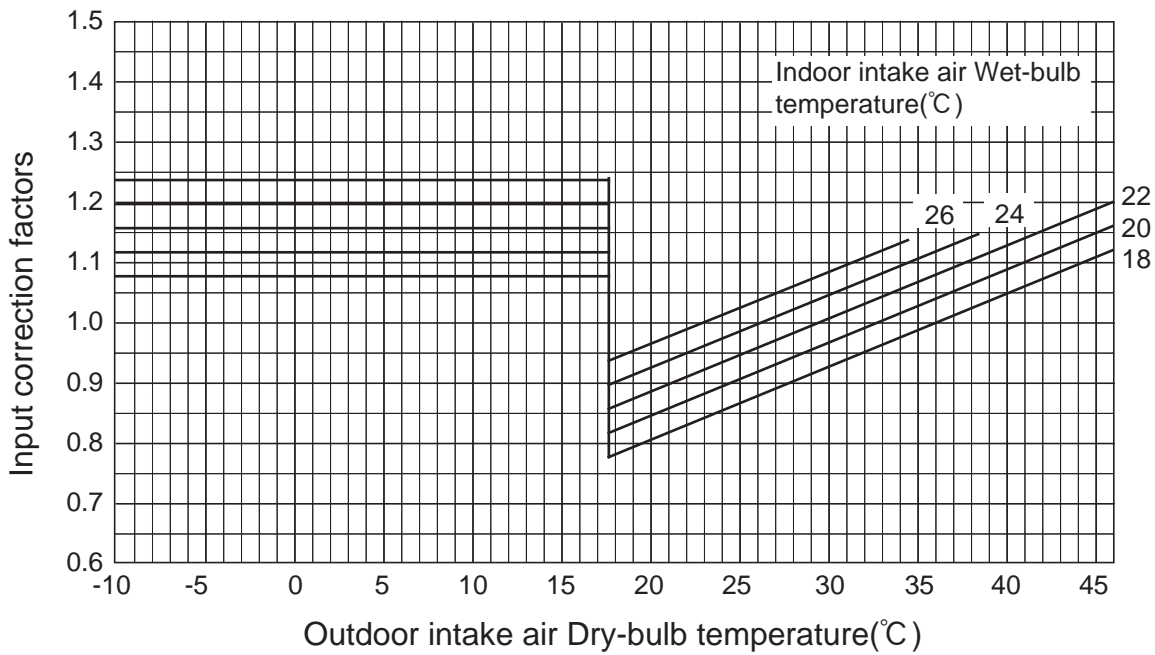




FOR THE COMBINATION OF OUTDOOR UNIT SUZ-KA35VA(H)

Cooling capacity

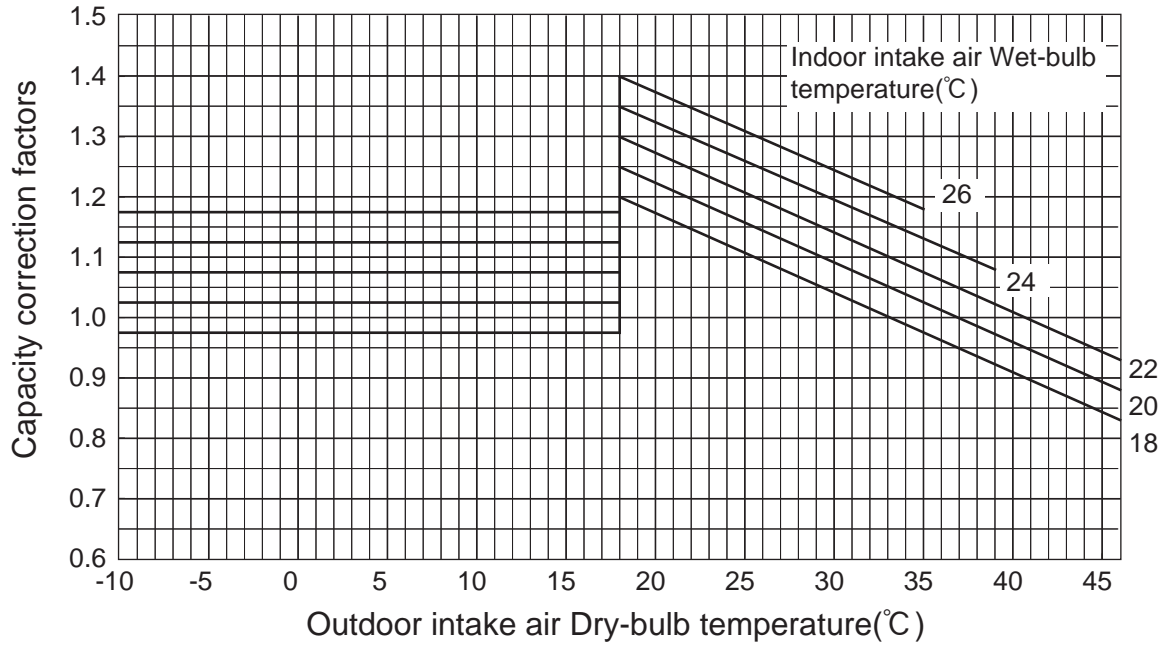


Total input (cooling)

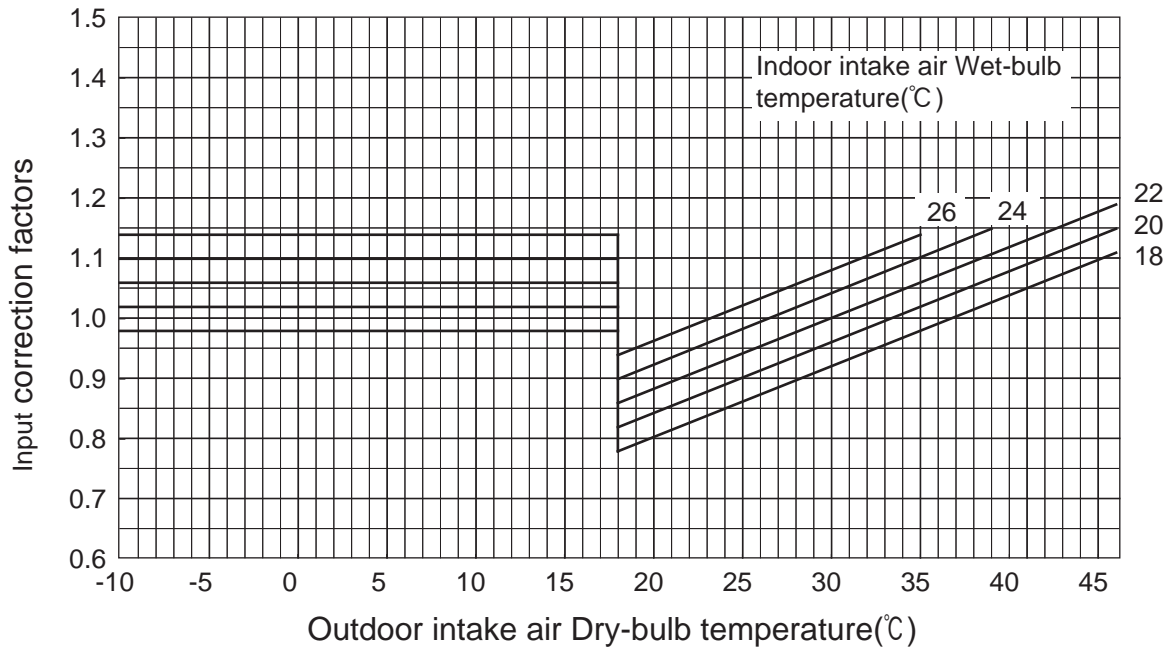


FOR THE COMBINATION OF OUTDOOR UNIT SUZ-KA50/60/71VA

Cooling capacity

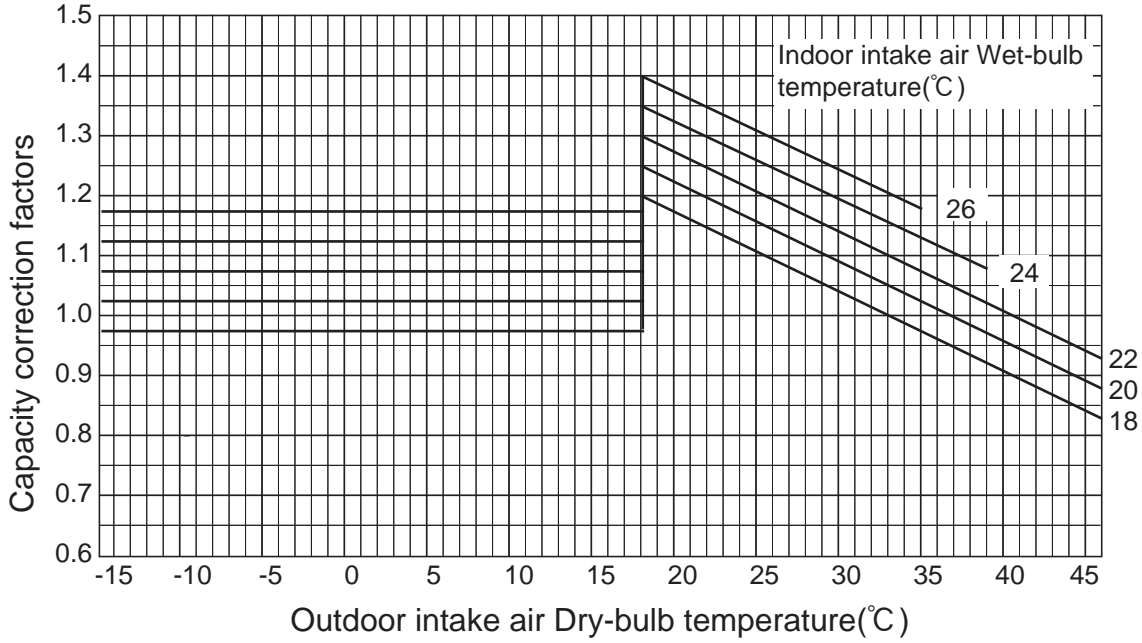


Total input (cooling)

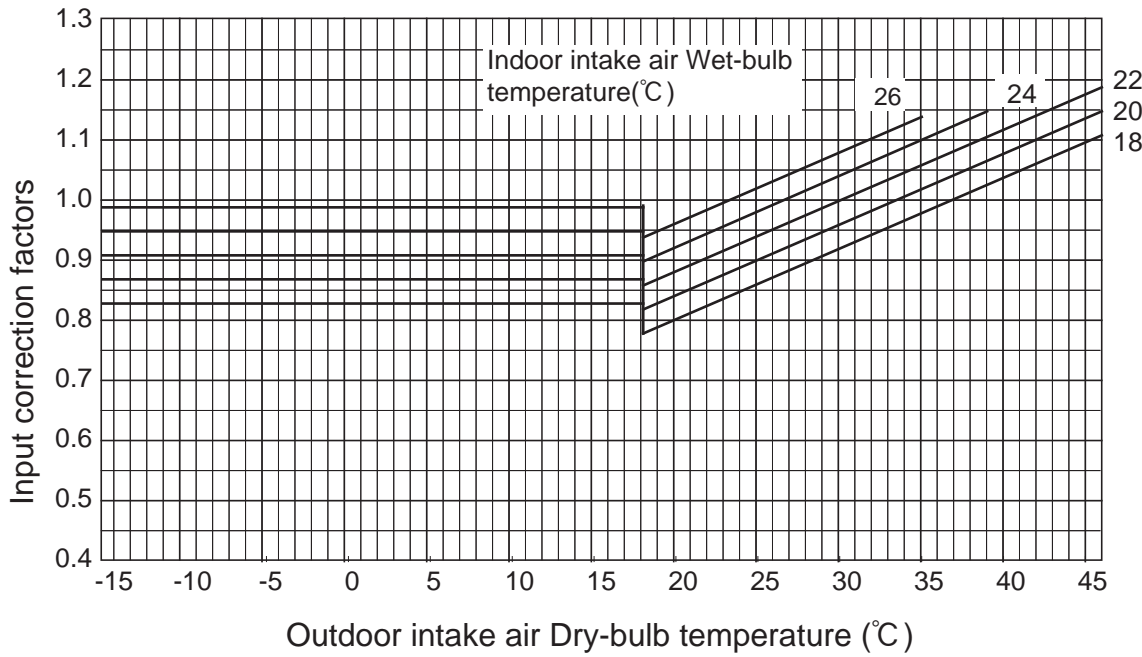




Heating capacity

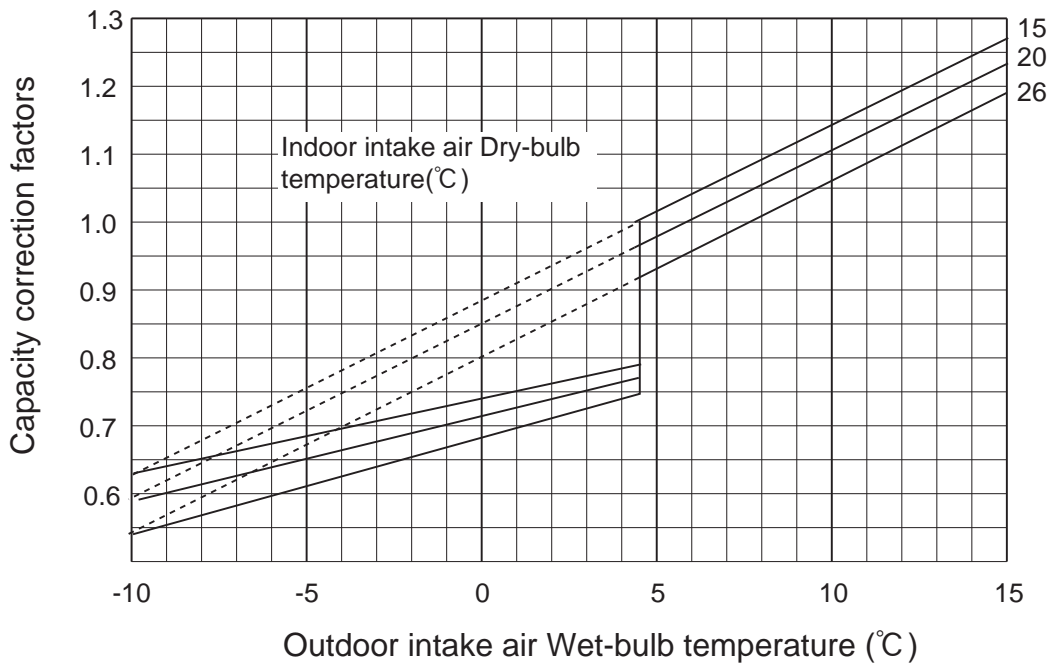

Total inputting (heating)

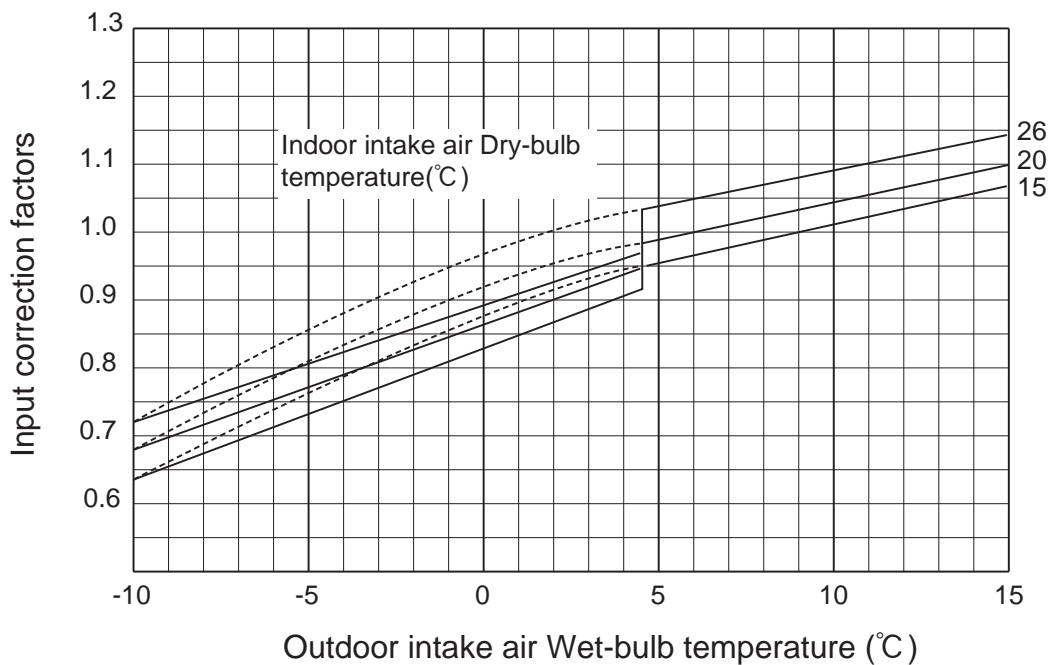

NOTE: The above curves are for the heating operation without any frost.


7 APPLICABLE EXTENSION PIPE FOR EACH MODEL

SUZ-KA25VA SUZ-KA25VAH
 SUZ-KA35VA SUZ-KA35VAH

MAX. REFRIGERANT PIPING LENGTH

| Models | Refrigerant piping Max. length : m A | Piping size O.D : mm | |
|--|--|----------------------|--------|
| | | Gas | Liquid |
| SUZ-KA25VA SUZ-KA35VA SUZ-KA25VAH SUZ-KA35VAH | 20 | 9.52 | 6.35 |

MAX. HEIGHT DIFFERENCE

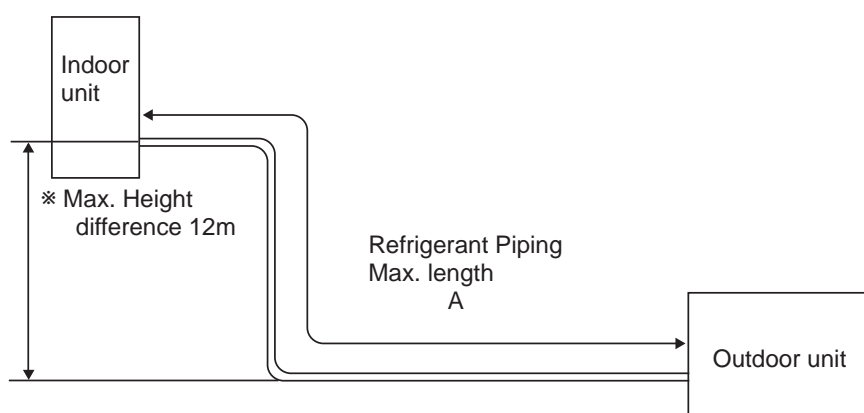

* Height difference should be within 12m regardless of which unit, indoor or outdoor position is high.

ADDITIONAL REFRIGERANT CHARGE (R410A:g)

| Models | Outdoor unit precharged | Refrigerant piping length (one way) | | | | | | | | | | | |
|---------------------------|----------------------------|-------------------------------------|----|----|----|-----|-----|-----|-----|-----|-----|-----|-----|
| | | 5m | 6m | 7m | 8m | 9m | 10m | 11m | 12m | 13m | 14m | 15m | 20m |
| SUZ-KA25VA SUZ-KA25VAH | 900 | 0 | 0 | 0 | 90 | 120 | 150 | 180 | 210 | 240 | 270 | 300 | 450 |
| SUZ-KA35VA SUZ-KA35VAH | 1,050 | 0 | 0 | 0 | 90 | 120 | 150 | 180 | 210 | 240 | 270 | 300 | 450 |


Calculation : $Xg=30g/m \times (\text{Refrigerant piping length(m)} - 5)$

**SUZ-KA50VA
SUZ-KA60VA
SUZ-KA71VA**

MAX. REFRIGERANT PIPING LENGTH

| Model | Refrigerant piping Max. length : m A | Piping size O.D : mm | |
|------------|--|----------------------|--------|
| | | Gas | Liquid |
| SUZ-KA50VA | 30 | 12.7 | 6.35 |
| SUZ-KA60VA | | 15.88 | |
| SUZ-KA71VA | | | 9.52 |

MAX. HEIGHT DIFFERENCE

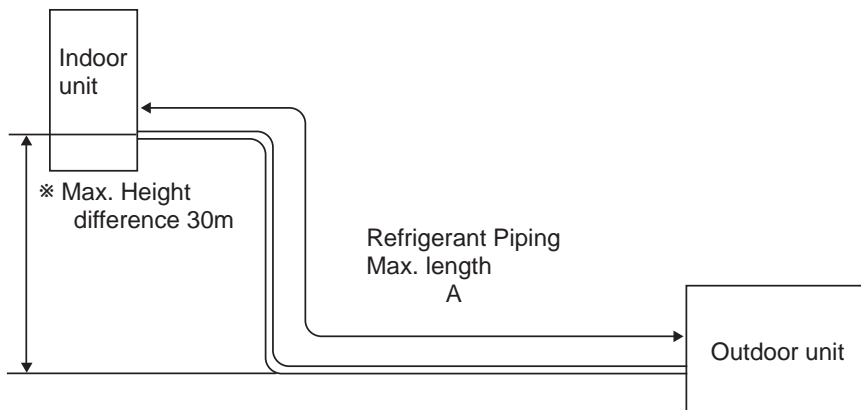

※ Height difference should be within 30m regardless of which unit, indoor or outdoor position is high.

ADDITIONAL REFRIGERANT CHARGE(R410A : g)

| Model | Outdoor unit precharged | Refrigerant piping length (one way) | | | | | |
|------------|----------------------------|-------------------------------------|-----|-----|-----|-----|-----|
| | | 7m | 10m | 15m | 20m | 25m | 30m |
| SUZ-KA50VA | 1,600 | 0 | 60 | 160 | 260 | 360 | 460 |
| SUZ-KA60VA | 1,800 | 0 | 60 | 160 | 260 | 360 | 460 |

Calculation : $Xg=20g/m \times (\text{Refrigerant piping length (m)}-7)$

| Model | Outdoor unit precharged | Refrigerant piping length (one way) | | | | | |
|------------|----------------------------|-------------------------------------|-----|-----|-----|-----|-------|
| | | 7m | 10m | 15m | 20m | 25m | 30m |
| SUZ-KA71VA | 2,000 | 0 | 165 | 440 | 715 | 990 | 1,265 |

Calculation : $Xg=55g/m \times (\text{Refrigerant piping length(m)}-7)$

8

AIR FLOW DATA

8-1. OUTLET AIR SPEED AND COVERAGE RANGE

| | | MFZ-KA25VA | MFZ-KA35VA | MFZ-KA50VA |
|----------------|----------------------|------------|------------|------------|
| Air flow | m ³ /min. | 8.7 | 9.1 | 10.7 |
| Air speed | m/sec. | 1.8 | 1.9 | 2.2 |
| Coverage range | m | 5.1 | 5.3 | 6.2 |

| | | SLZ-KA25VA SLZ-KA25VAL | SLZ-KA35VA SLZ-KA35VAL | SLZ-KA50VA SLZ-KA50VAL |
|----------------|----------------------|---------------------------|---------------------------|---------------------------|
| Air flow | m ³ /min. | 10 | 11 | 11 |
| Air speed | m/sec. | 3.4 | 3.7 | 3.7 |
| Coverage range | m | 3.7 | 4.1 | 4.1 |

| | | PLA-RP35BA | PLA-RP50BA | PLA-RP60BA | PLA-RP71BA |
|----------------|----------------------|------------|------------|------------|------------|
| Air flow | m ³ /min. | 15 | 18 | 18 | 21 |
| Air speed | m/sec. | 2.6 | 3.2 | 3.2 | 3.7 |
| Coverage range | m | 4.1 | 4.8 | 4.8 | 5.6 |

| | | PLA-RP35AA | PLA-RP50AA | PLA-RP60AA | PLA-RP71AA |
|----------------|----------------------|------------|------------|------------|------------|
| Air flow | m ³ /min. | 14 | 18 | 18 | 20 |
| Air speed | m/sec. | 2.8 | 3.6 | 3.6 | 4.0 |
| Coverage range | m | 4.0 | 5.2 | 5.2 | 5.7 |



| | | PCA-RP50GA | PCA-RP50GA2 | PCA-RP60GA | PCA-RP71GA |
|----------------|---------------------|------------|-------------|------------|------------|
| Air flow | m ³ /min | 13 | 18 | 18 | 18 |
| Air speed | m/sec | 3.7 | 3.8 | 3.8 | 3.8 |
| Coverage range | m | 8.8 | 10.4 | 10.4 | 10.4 |

* The air coverage range is the distance to which the 0.25m/sec air can reach, when air is blown out horizontally from the unit at the High notch position.
The coverage range should be used only as a general guideline since it varies according to the size of the room and the furniture inside the room.

8-2. SLZ-KA•VA SLZ-KA•VAL


8-2-1. Fresh air intake (Location for installation)

At the time of installation, use the duct holes (cut out) located at the positions shown in following diagram, as and when required.

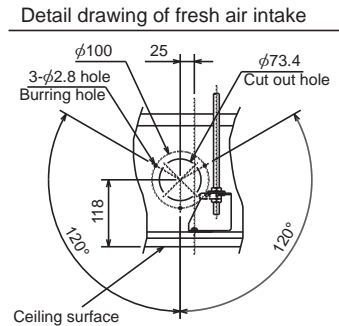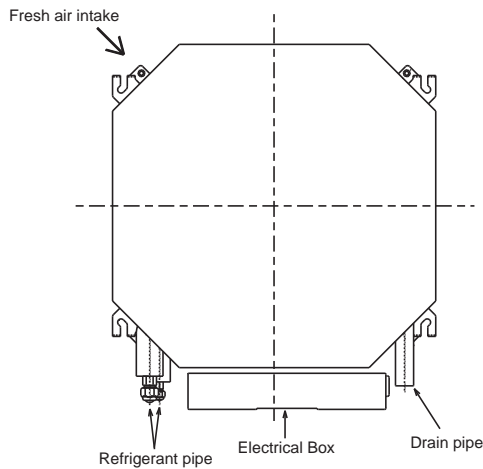


8-2-2. Fresh air intake amount & static pressure characteristics

Taking air into the unit

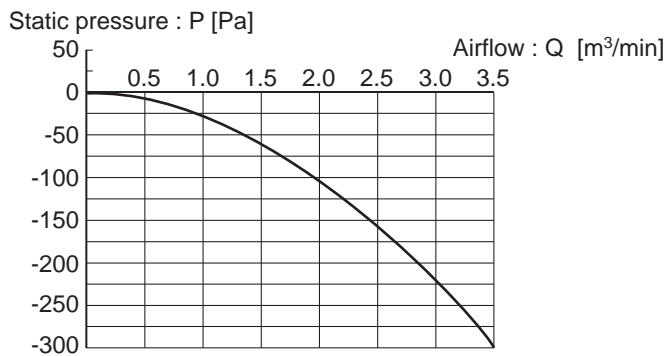

NOTE: Fresh air intake amount should be 20% or less of whole air amount to prevent dew dripping.

How to read curves

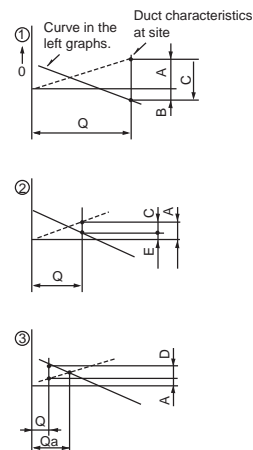


- Q...Designed amount of fresh air intake <m³/min>
- A...Static pressure loss of fresh air intake duct system with airflow amount Q <Pa>
- B...Forced static pressure at air conditioner inlet with airflow amount Q <Pa>
- C...Static pressure of booster fan with airflow amount Q <Pa>
- D...Static pressure loss increase amount of fresh air intake duct system for airflow amount Q <Pa>
- E...Static pressure of indoor unit with airflow amount Q
- Qa...Estimated amount of fresh air intake without D <m³/min>

8-3. SEZ-KD•VA(L) INDOOR FAN PERFORMANCE AND CORRECTED AIR FLOW


SEZ-KD25VA(L)

(External static pressure 5Pa) 220-240V 50/60Hz

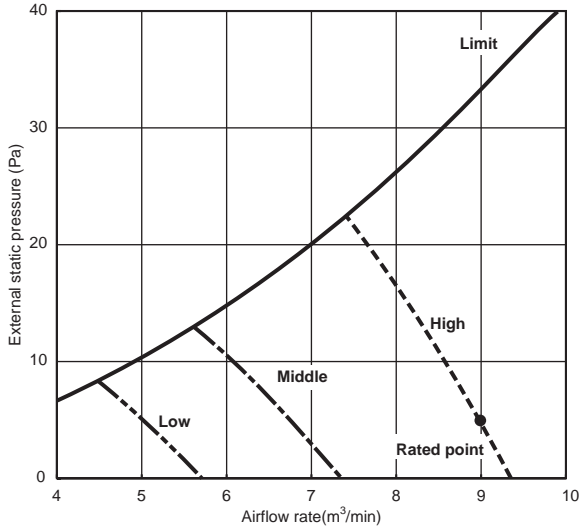


SEZ-KD25VA(L)

(External static pressure 15Pa) 220-240V 50/60Hz

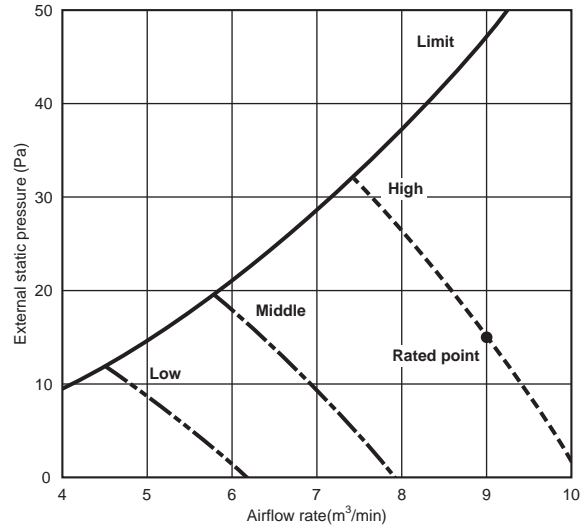


SEZ-KD25VA(L)

(External static pressure 35Pa) 220-240V 50/60Hz

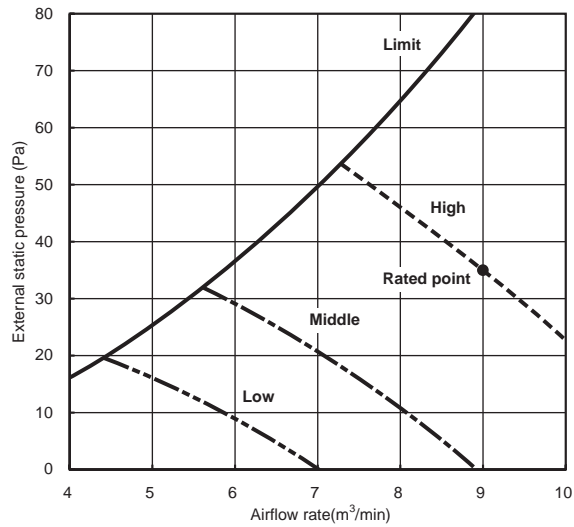


SEZ-KD25VA(L)

(External static pressure 50Pa) 220-240V 50/60Hz

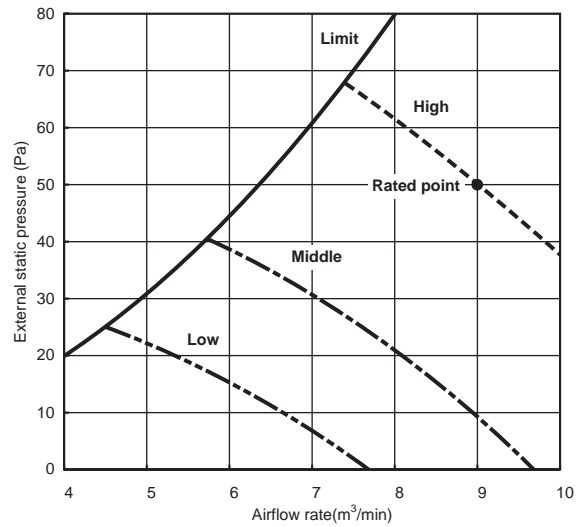


SEZ-KD35VA(L)

(External static pressure 5Pa) 220-240V 50/60Hz

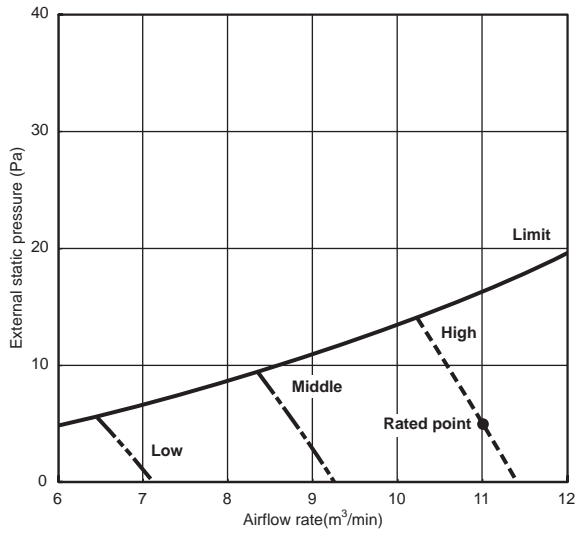


SEZ-KD35VA(L)

(External static pressure 15Pa) 220-240V 50/60Hz

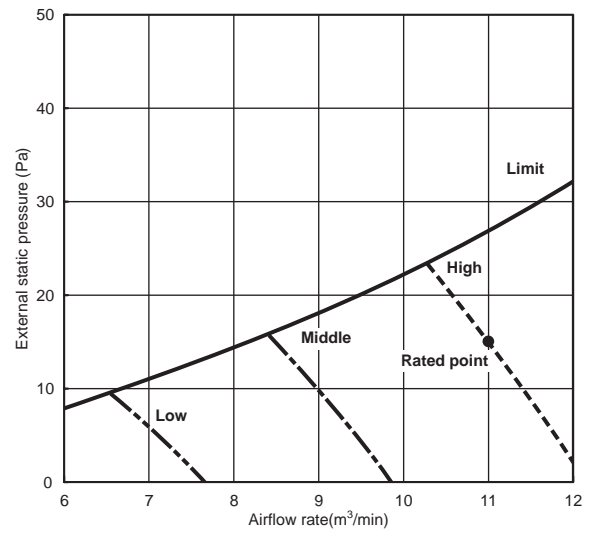


SEZ-KD35VA(L)

(External static pressure 35Pa) 220-240V 50/60Hz

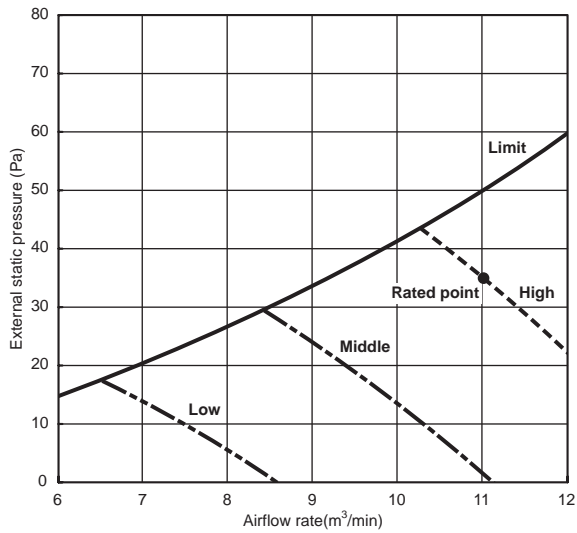


SEZ-KD35VA(L)

(External static pressure 50Pa) 220-240V 50/60Hz

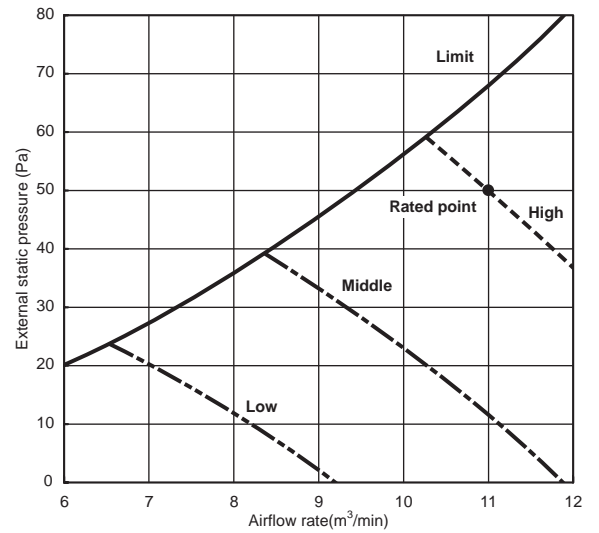


SEZ-KD50VA(L)

(External static pressure 5Pa) 220-240V 50/60Hz

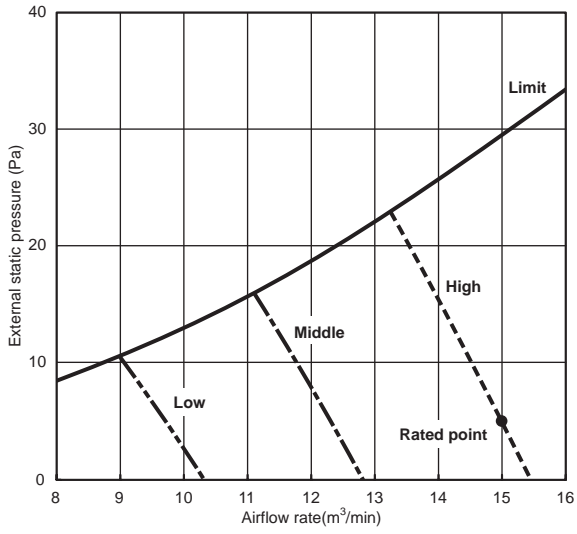


SEZ-KD50VA(L)

(External static pressure 15Pa) 220-240V 50/60Hz

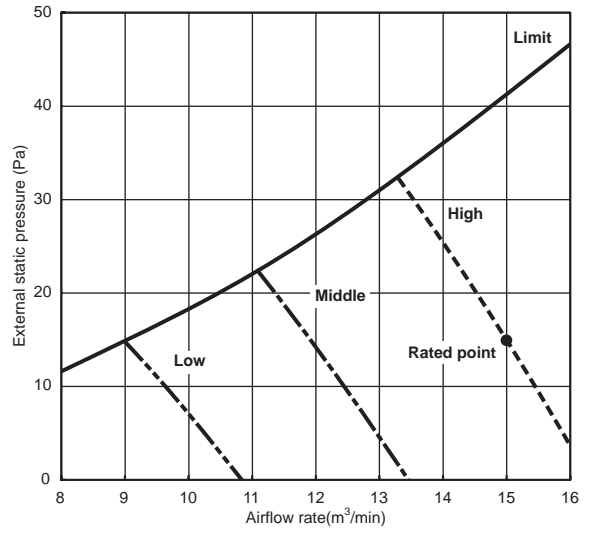


SEZ-KD50VA(L)

(External static pressure 35Pa) 220-240V 50/60Hz

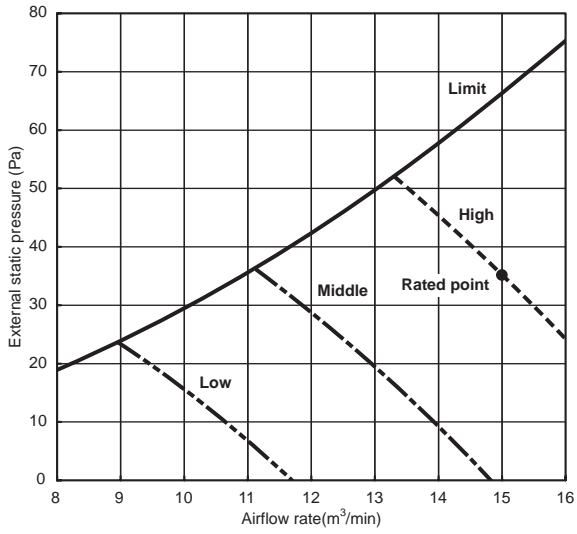


SEZ-KD50VA(L)

(External static pressure 50Pa) 220-240V 50/60Hz

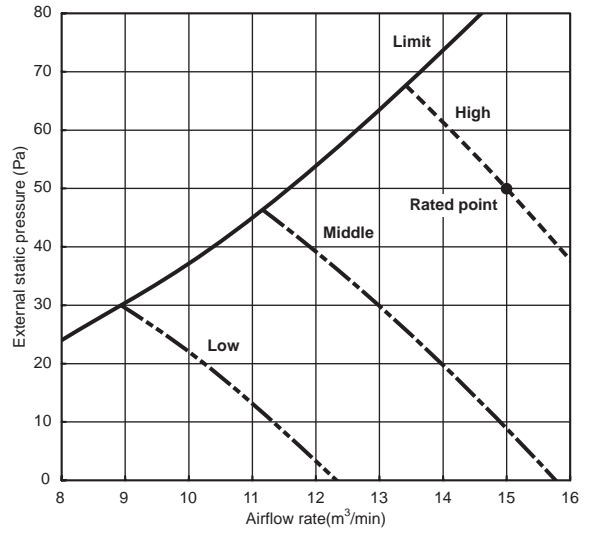


SEZ-KD60VA(L)

(External static pressure 5Pa) 220-240V 50/60Hz

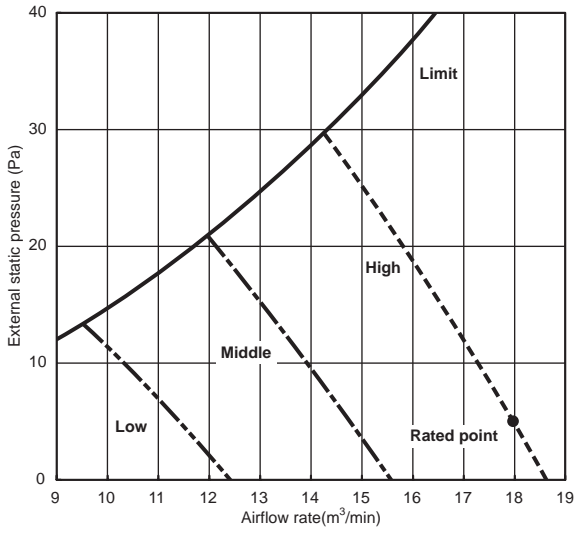


SEZ-KD60VA(L)

(External static pressure 15Pa) 220-240V 50/60Hz

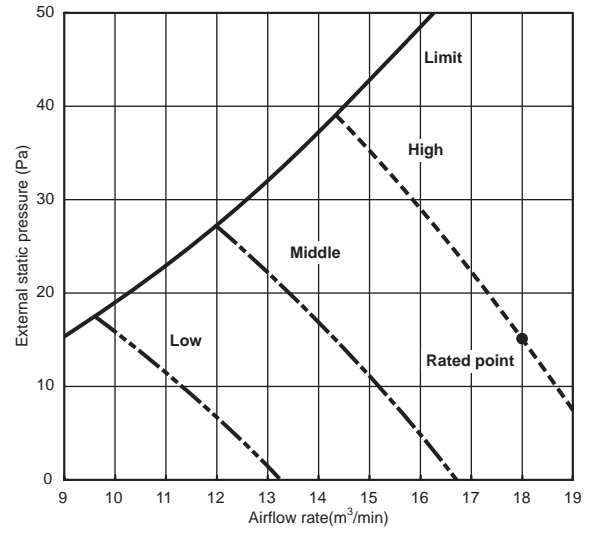


SEZ-KD60VA(L)

(External static pressure 35Pa) 220-240V 50/60Hz

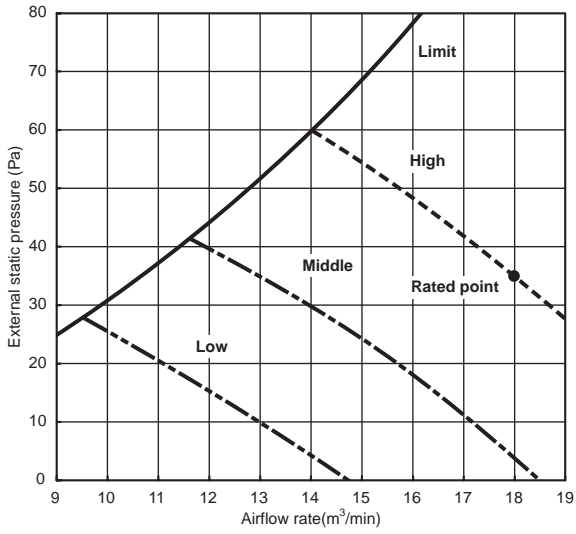


SEZ-KD60VA(L)

(External static pressure 50Pa) 220-240V 50/60Hz

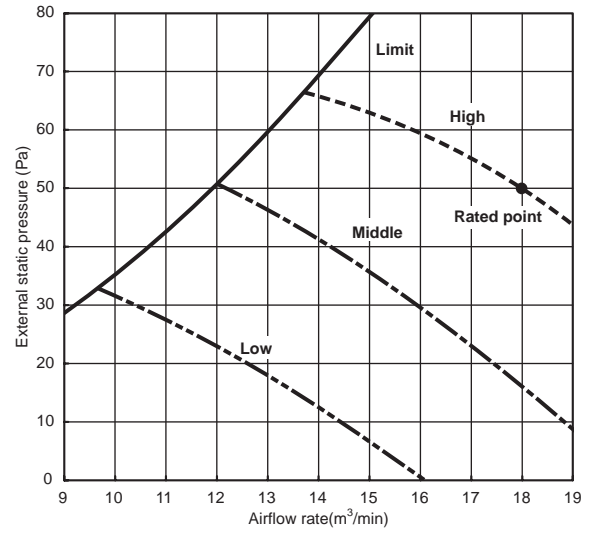


SEZ-KD71VA(L)

(External static pressure 5Pa) 220-240V 50/60Hz

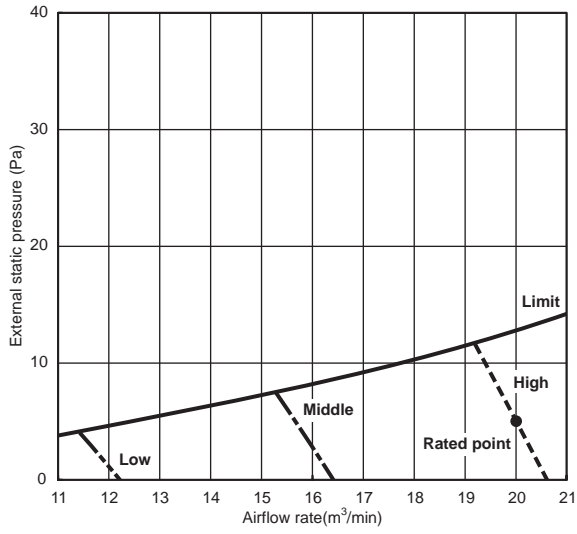


SEZ-KD71VA(L)

(External static pressure 15Pa) 220-240V 50/60Hz

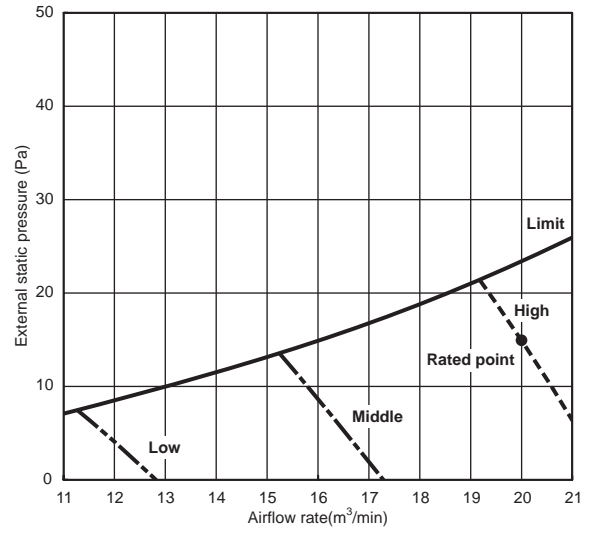


SEZ-KD71VA(L)

(External static pressure 35Pa) 220-240V 50/60Hz

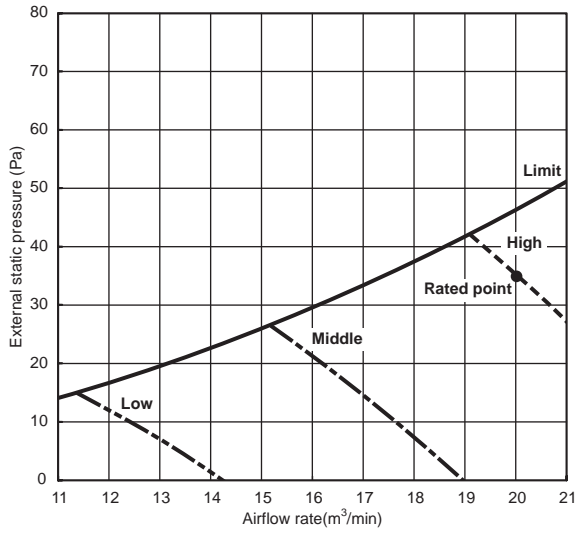



SEZ-KD71VA(L)

(External static pressure 50Pa) 220-240V 50/60Hz


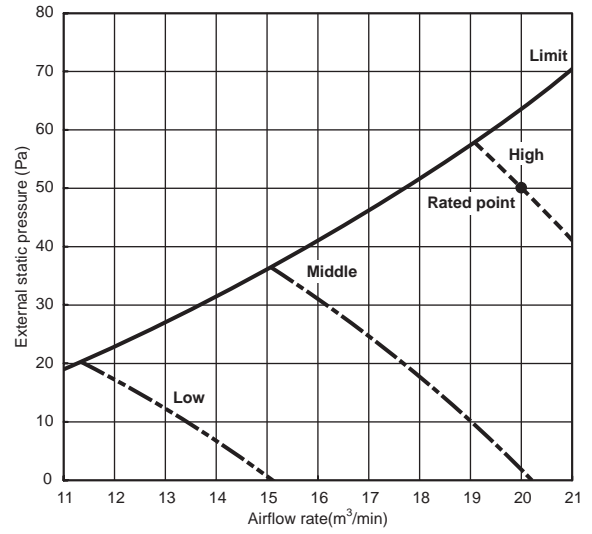


8-4. SEZ-KA•VA INDOOR FAN PERFORMANCE AND CORRECTED AIR FLOW

SEZ-KA35VA

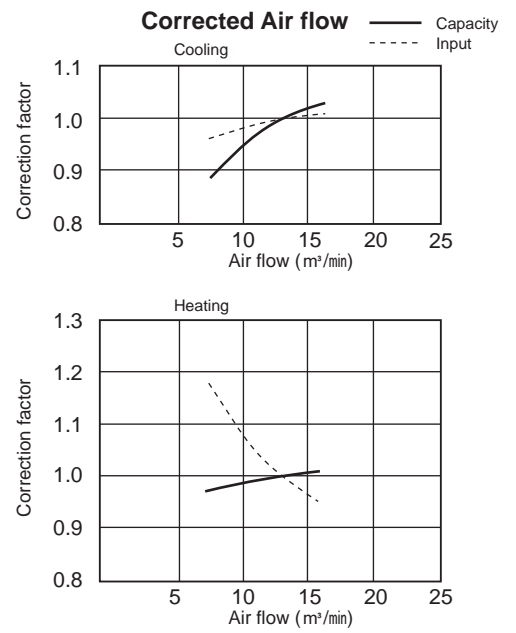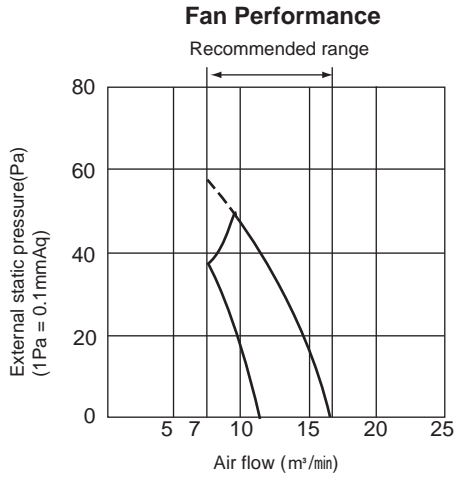




SEZ-KA50VA

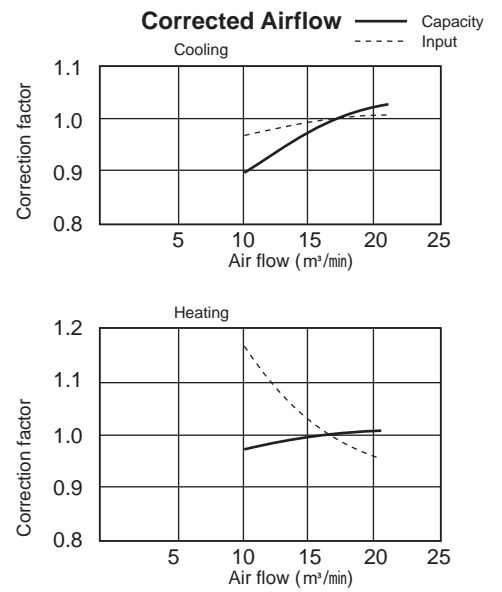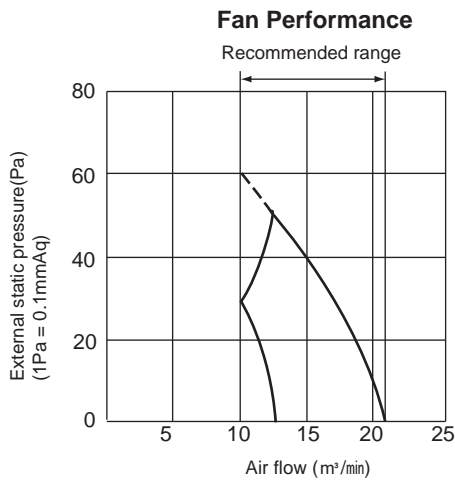






INDOOR FAN PERFORMANCE AND CORRECTED AIR FLOW

SEZ-KA60VA

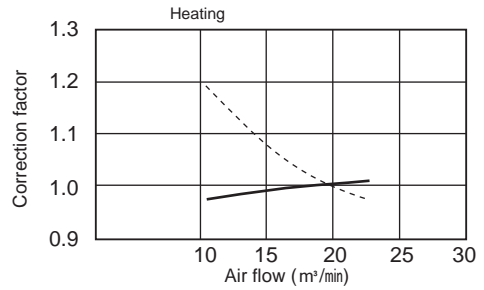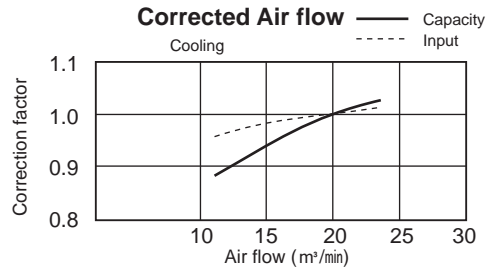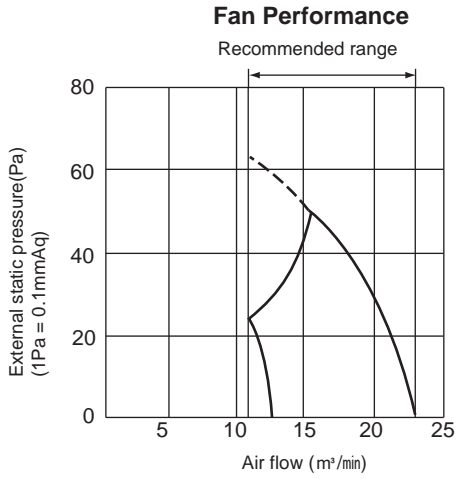

SEZ-KA71VA

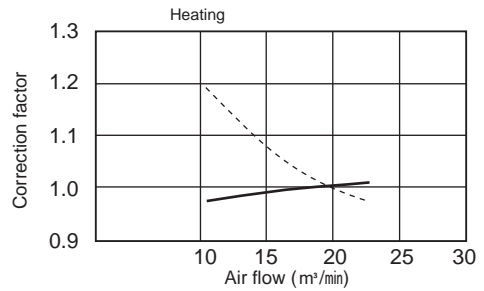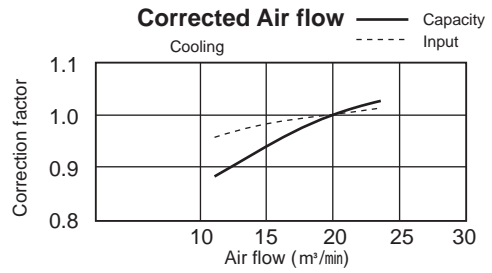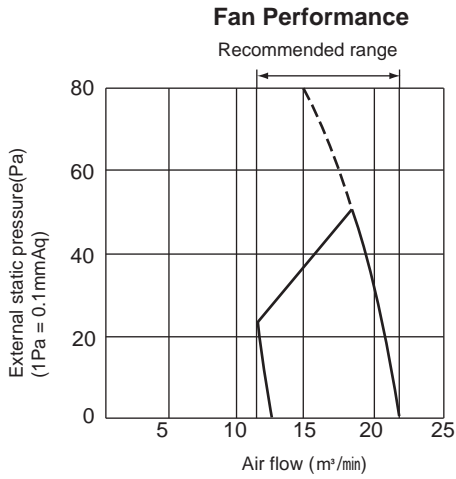

8-5. PLA-RP-BA

8-5-1 FRESH AIR INTAKE AND BRANCH DUCT

1. Branch duct hole and fresh air intake hole (Fig. 1)

At the time of installation, use the duct holes (cut out) located at the positions shown in Fig.1, as and when required.

- A fresh air intake hole for the optional multi function casement can also be made.

Note:

The figure marked with * in the drawing represent the dimensions of the main unit excluding those of the optional multi function casement.

When installing the optional multi function casement, add 135 mm to the dimensions marked on the figure.

When installing the branch ducts, be sure to insulate adequately.

Otherwise condensation and dripping may occur.

Unit : mm


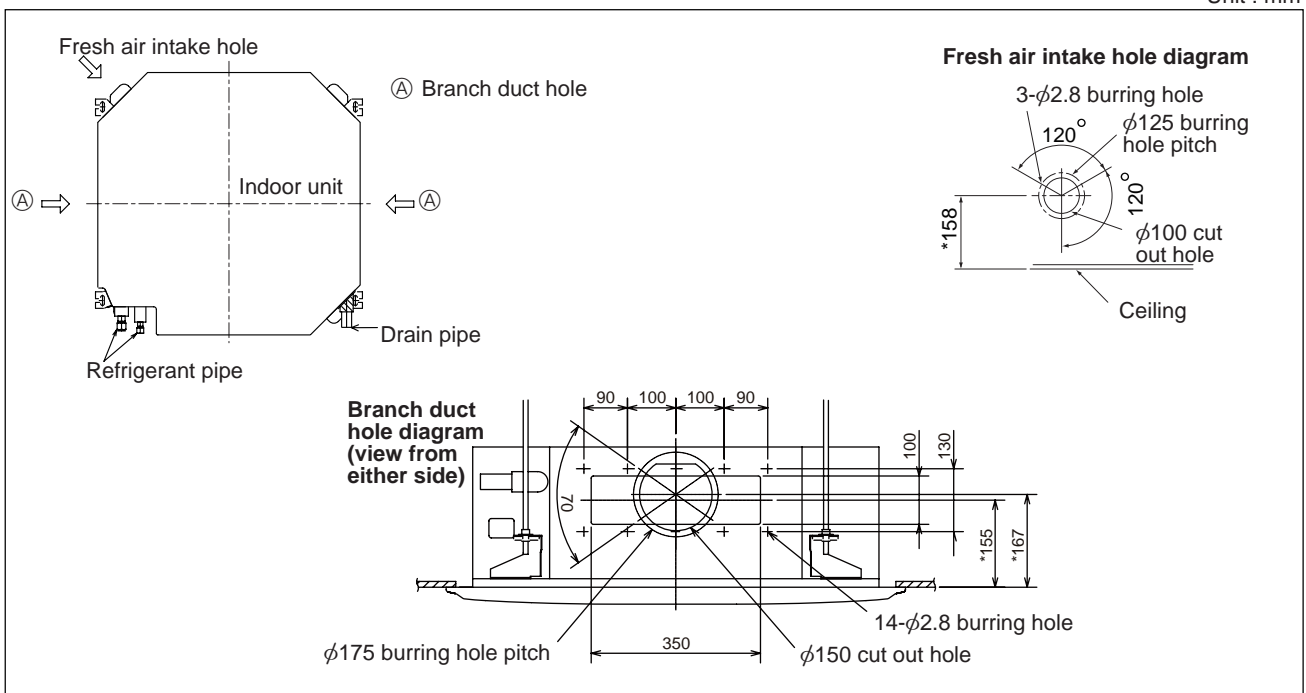


Fig. 1

2. Fresh air intake (Installation at site)

- By mounting the optional multi-function casement to the indoor unit main body, and mounting the duct and duct flange (option) onto it further, fresh exterior air intake can be accomplished.


(The mounting of the multi-function casement increases the height of the ceiling plenum by 135mm.)

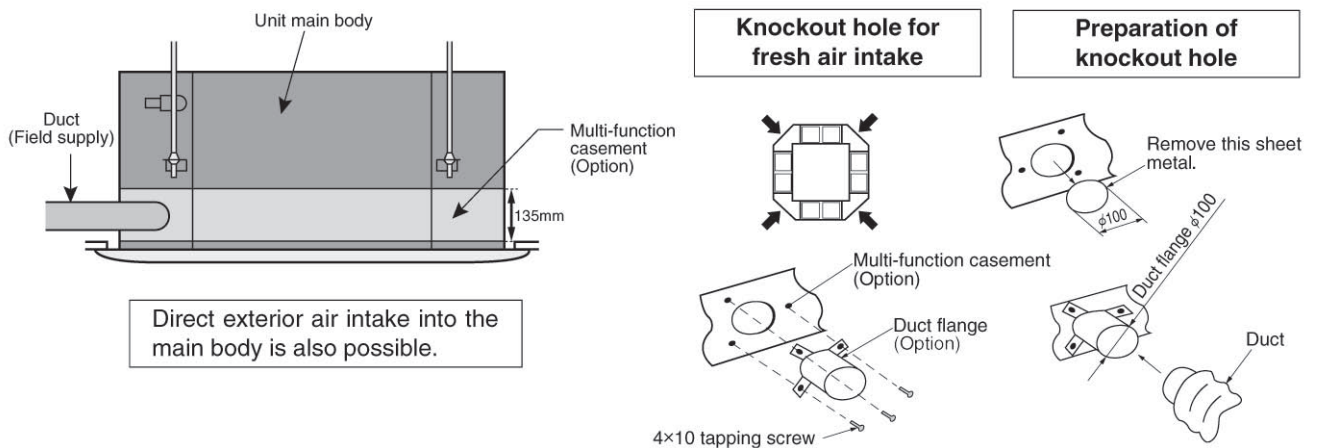


3. Fresh air intake volume & static pressure characteristics

PLA-RP35~71BA


① At using multi-function casement, standard filter

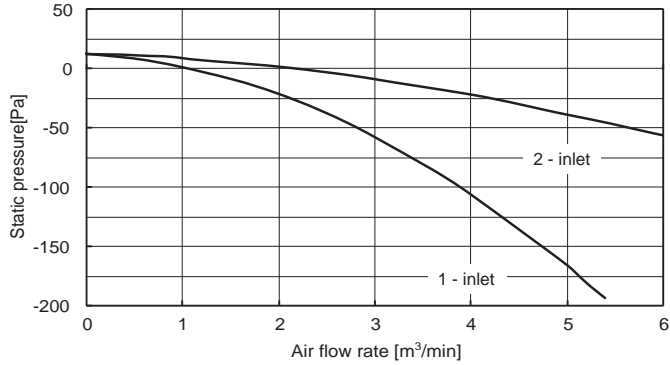


② Direct intake to unit

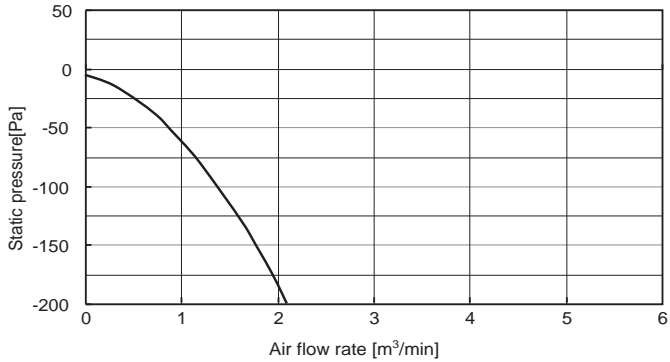

③ At using multi-function casement, high efficiency filter

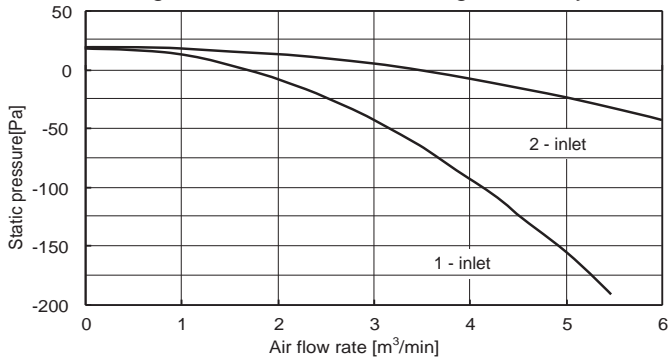

How to read the chart

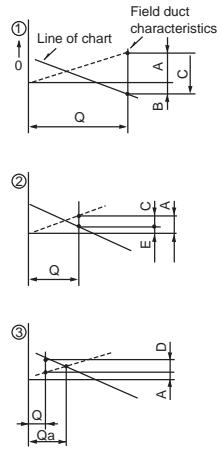



- Q...Design fresh air intake volume $\langle m^3/min \rangle$
- A...Static pressure loss [Pa] of fresh air intake duct at airflow rate of Q
- B...Required boost pressure [Pa] of air conditioner inlet at airflow rate of Q
- C...Required static pressure [Pa] of booster fan at airflow rate of Q
- D...Required compensation [Pa] for static pressure loss of fresh air intake duct to make airflow rate Q
- E...Static pressure [Pa] of indoor unit at airflow rate of Q
- Qa...Estimated fresh air intake $[m^3/min]$ without compensation of D

4. Change of outlet numbers


[The optional air outlet is necessary.]

To change the air outlet number to 3-, or 2-way outlet, the outlet number should be closed with the operational air outlet shutter.


(When the air outlets are closed, close the vane by removing the vane connector.)

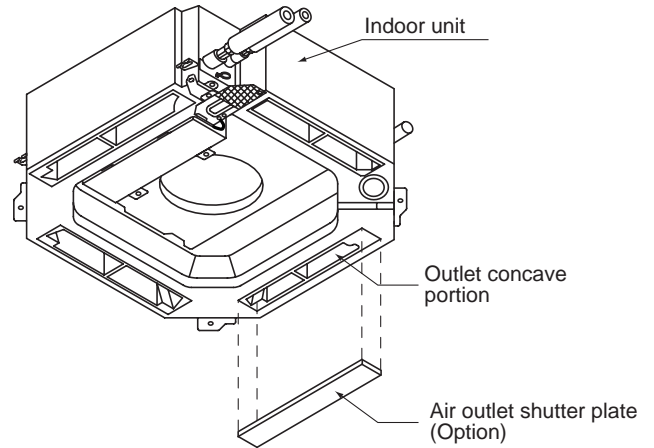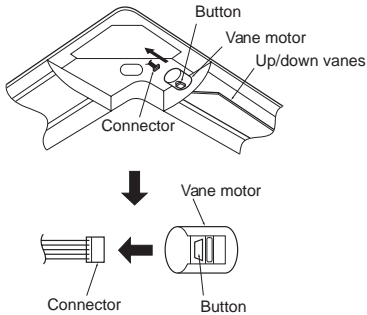


5. Branch duct and change of outlet numbers

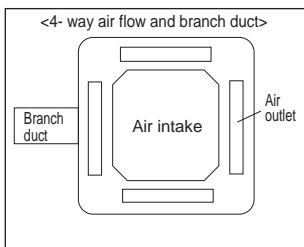

※ Branch duct should be connected to one of the branch duct holes on the main unit.

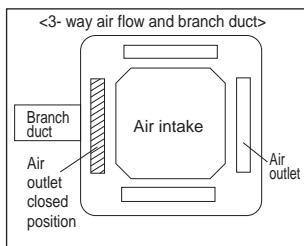


※ Close the outlet on the side of branch duct and air flows in 3 directions.

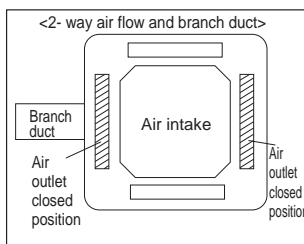


※ The outlet on the side of branch duct and one of the other outlets are closed. Air flows in 2 directions.

PLA-RP71BA


● 4-way airflow (horizontal vane) Round duct

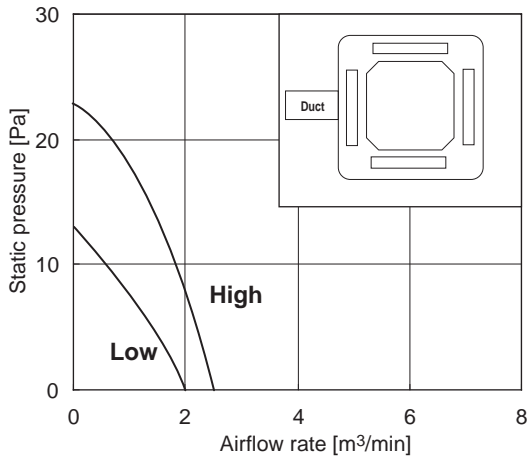


● 4-way airflow (horizontal vane) Rectangular duct

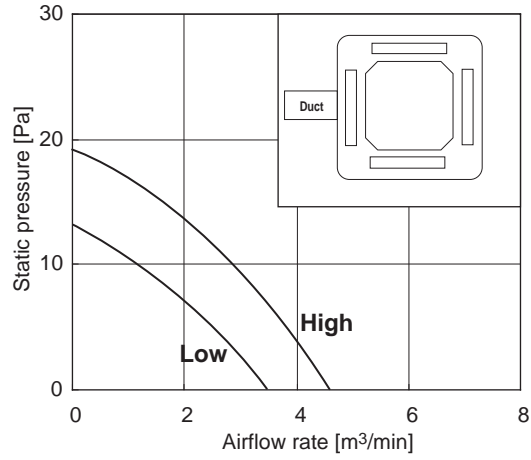


● 3-way airflow (horizontal vane) Round duct

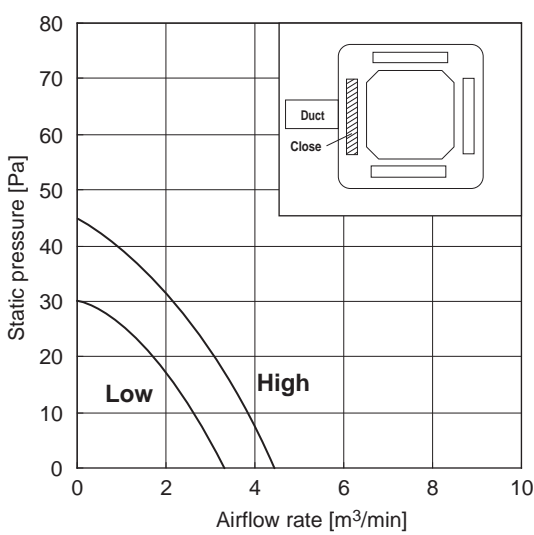


● 3-way airflow (horizontal vane) Rectangular duct

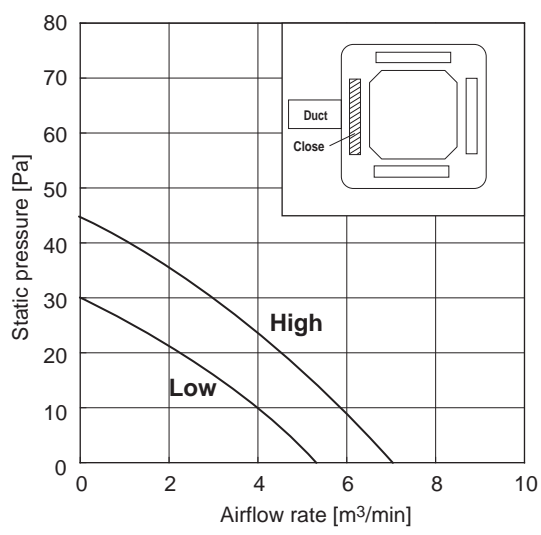

● 2-way airflow (horizontal vane) Round duct

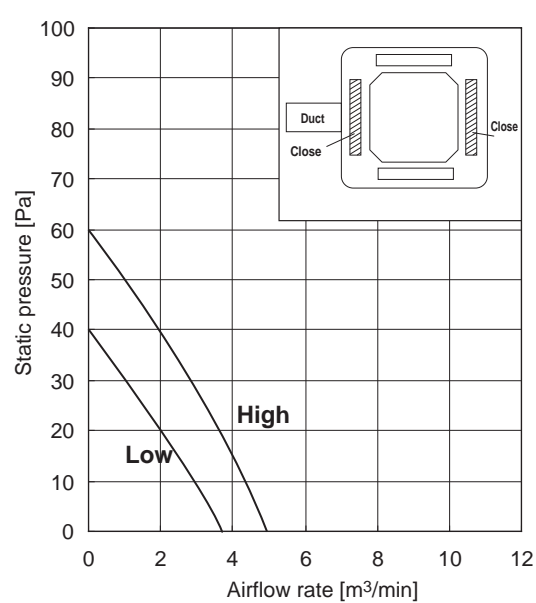

● 2-way airflow (horizontal vane) Rectangular duct

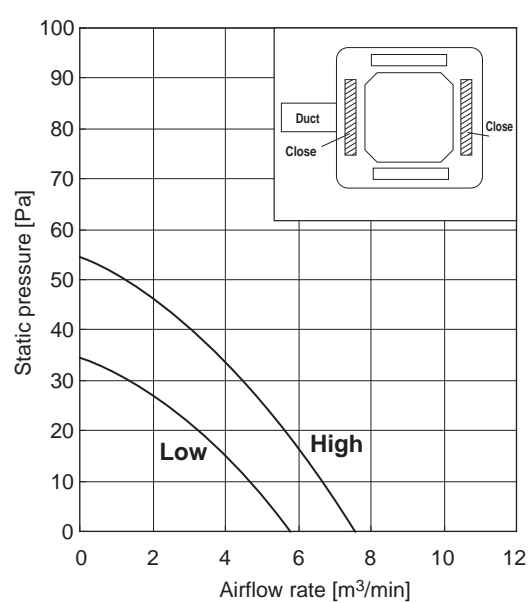

- Use 1 of the 2 duct holes on the indoor unit.
- Air flow rate of PLA-RP35~60BA can be calculated from the airflow rate based on the characteristic of the duct for PLA-RP71BA.
- Use the optional air outlet shutter plate (PAC-SH51SP-E) for 3-way and 2-way air flow.

8-6. PLA-RP-AA

8-6-1. Fresh air intake amount


1. Adjusting the width of the air outlets

● Change of outlet numbers


[The optional air outlet shutter is necessary.]

To change the air outlet numbers to 3-, or 2-way outlet, the outlets should be closed with the optional air outlet shutter.

When the air outlets are closed, close the vane by removing the vane connector.

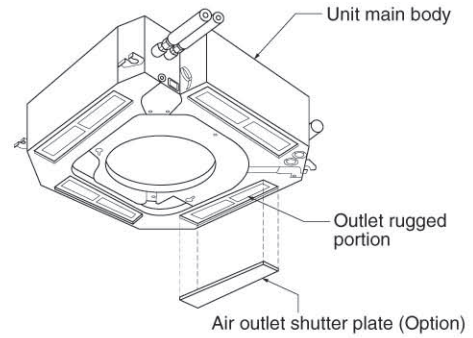


- For the portion to be cut (V-shaped groove), see the figure below (as seen from the rear of the panel).

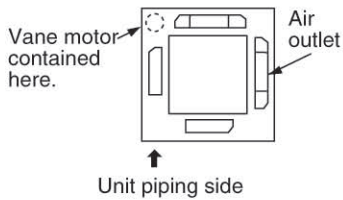

2. Fresh air intake (Installation of site)

- By mounting the optional multi-function casement to the indoor unit main body, and mounting the duct and duct flange (field supply) onto it further, fresh exterior air intake can be accomplished.


(The mounting of the multi-function casement increases the height of the ceiling plenum by 135mm.)

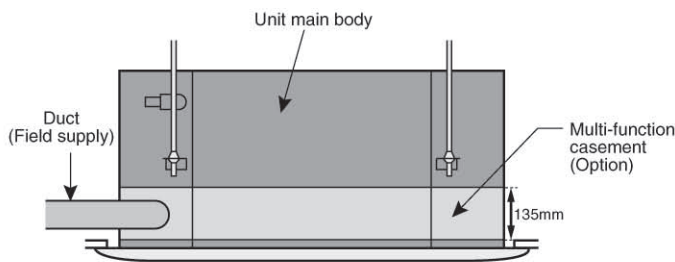

Direct exterior air intake into the main body is also possible.

Knockout hole for fresh air intake


Preparation of knockout hole

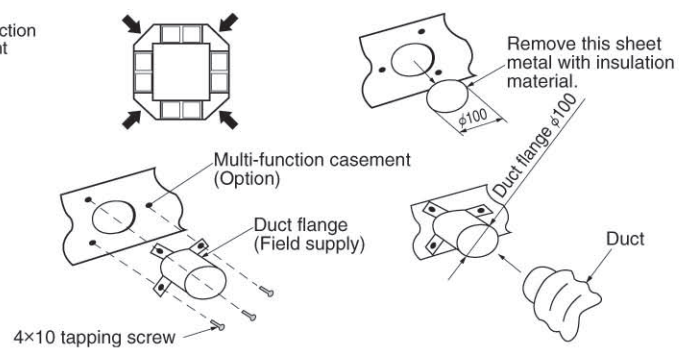




3. Fresh air intake volume & static pressure characteristics

① PLA-RP71AA

(at using of multi-function casement, standard filter)

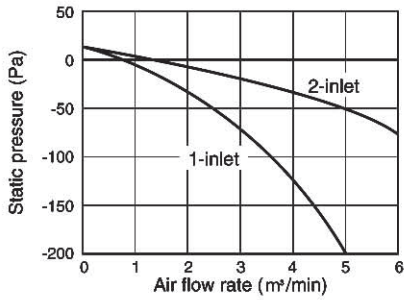

How to read the chart



Q...Desig fresh air intake volume
m^3/min

A...Static pressure loss [Pa] of fresh air intake duct at airflow rate of Q

B...Required boost pressure [Pa] of air conditioner inlet at airflow rate of Q


C...Required static pressure [Pa] of booster fan at airflow rate of Q

D...Required compensation [Pa] for static prssure loss of fresh air intake duct to make airflow rate Q

E...Static pressure [Pa] of indoor unit at airflow rate of Q


Qa...Estimated fresh air intake
[m^3/min] without compensation of D

② PLA-RP71AA (Direct intake to unit)

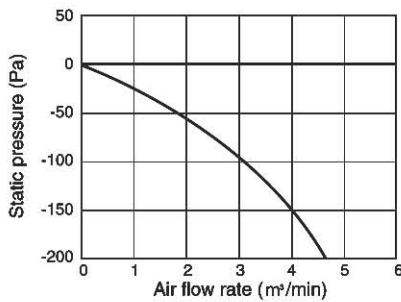


8-5-2. BRANCH DUCT (Installation at site)

To be compatible with both round and rectangular branch ducts, knockout holes are designed to fit to both shapes for flexible on-site installation.

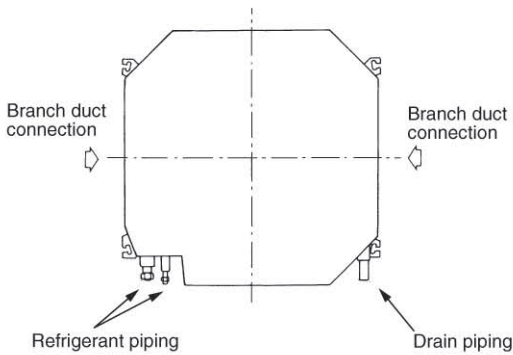


Connecting to round duct

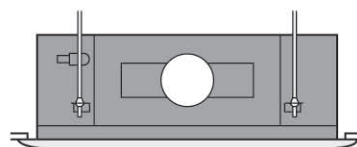

$\phi 150$ cutout for round duct


Connecting to rectangular duct

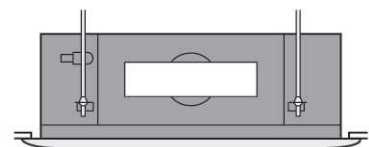


350×100mm cutout for rectangular duct

Branch duct air flow rate/static pressure characteristics
PLA-RP35AA


4-way air flow (horizontal vane) Rectangular duct

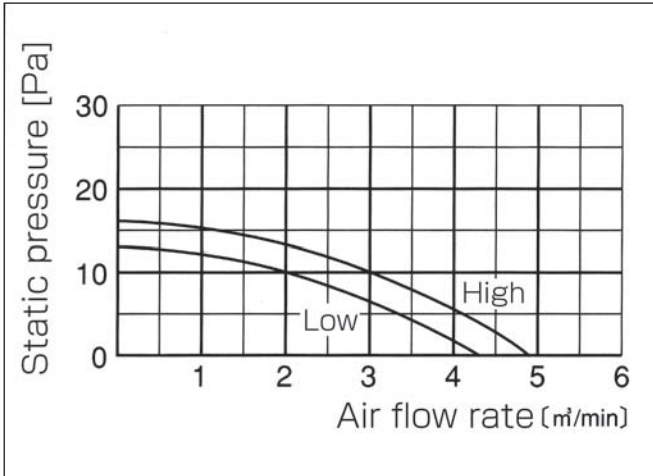


4-way air flow (horizontal vane) Round duct

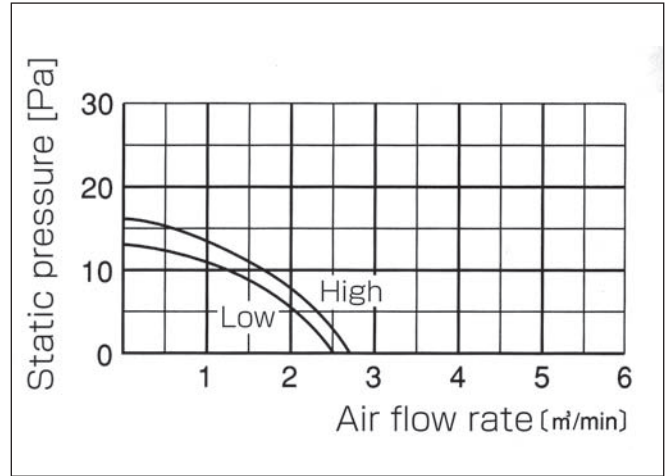


3-way air flow (horizontal vane) Rectangular duct

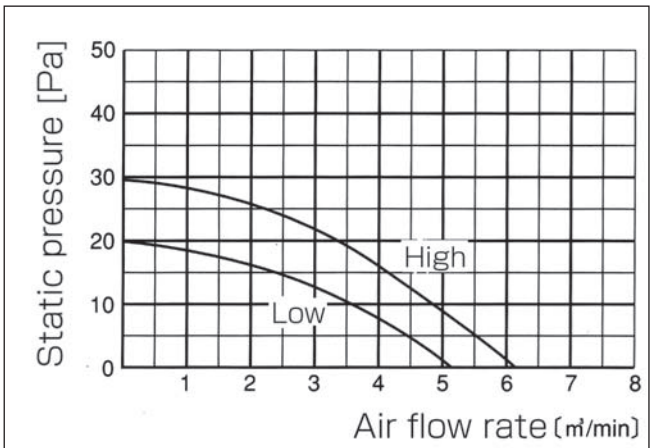


3-way air flow (horizontal vane) Round duct

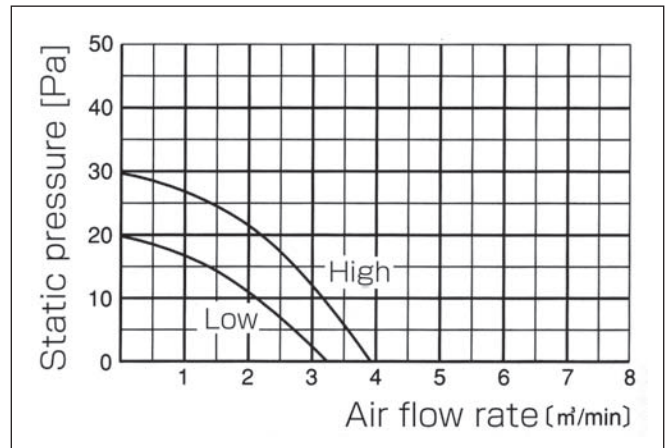

2-way air flow (horizontal vane) Rectangular duct

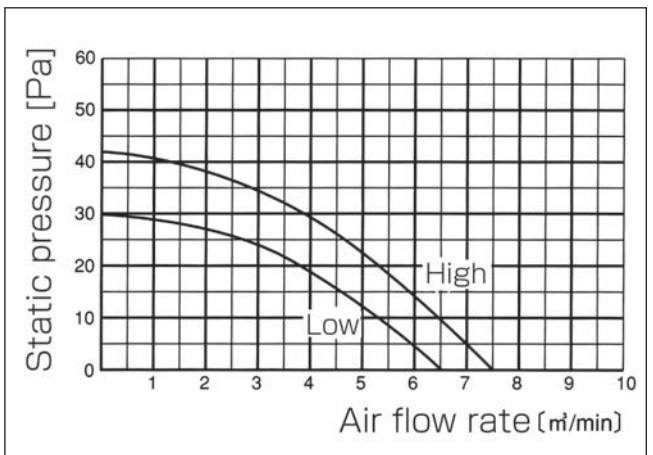


2-way air flow (horizontal vane) Round duct

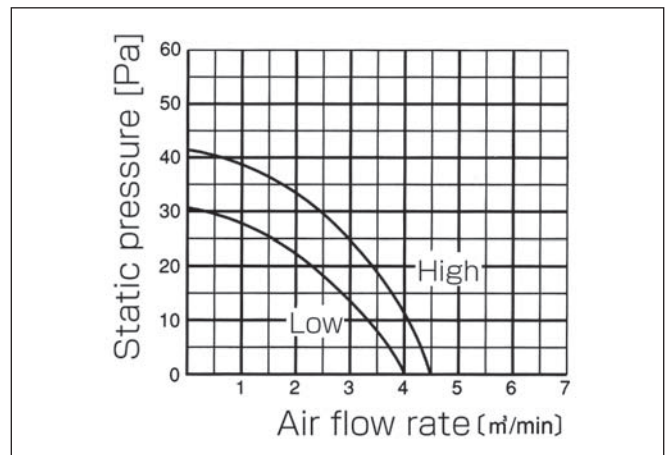


PLA-RP50AA
PLA-RP60AA


4-way air flow (horizontal vane) Rectangular duct

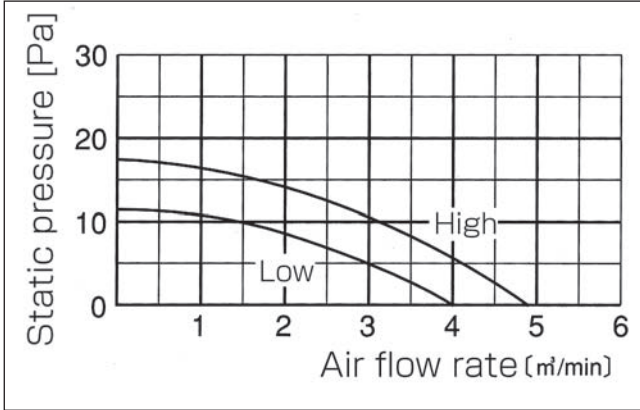


4-way air flow (horizontal vane) Round duct

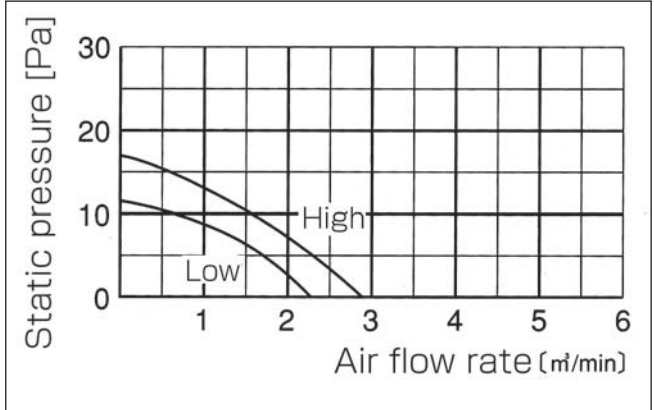


3-way air flow (horizontal vane) Rectangular duct

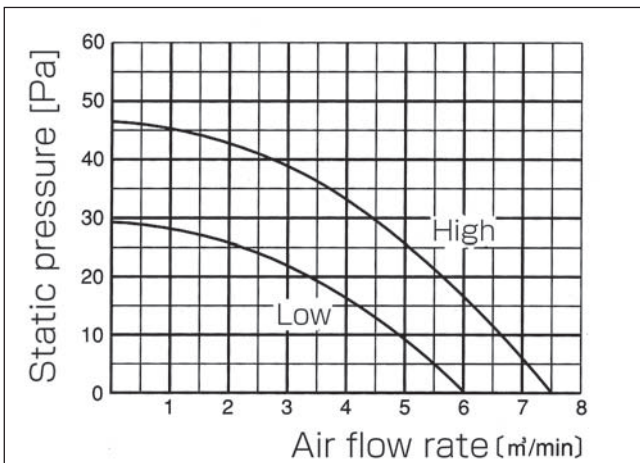


3-way air flow (horizontal vane) Round duct

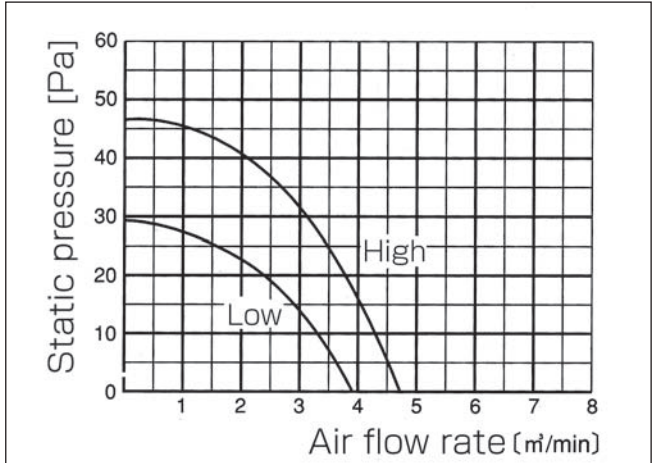

2-way air flow (horizontal vane) Rectangular duct

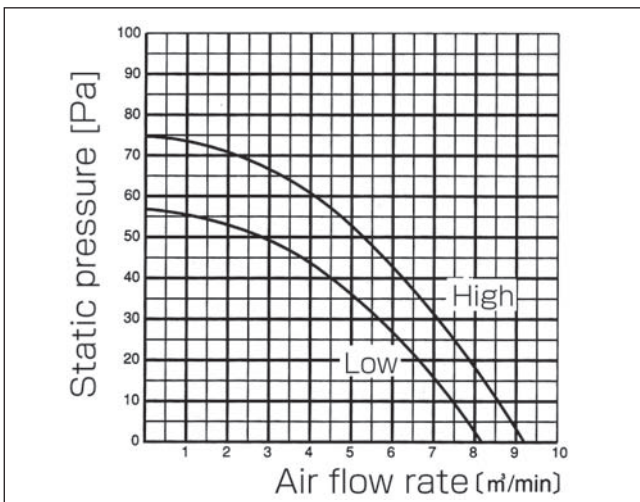


2-way air flow (horizontal vane) Round duct

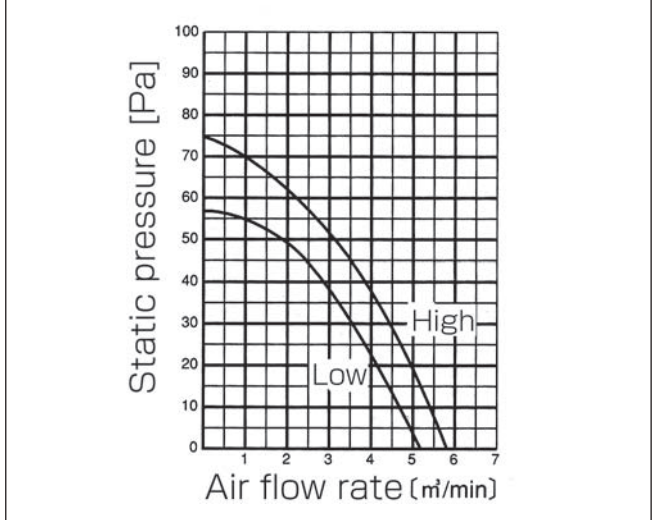


PLA-RP71AA


4-way air flow (horizontal vane) Rectangular duct

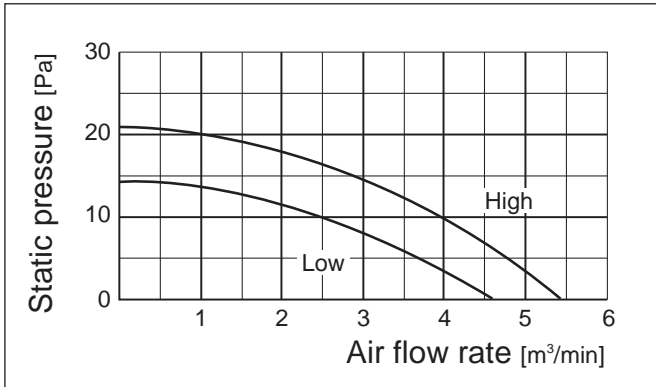


4-way air flow (horizontal vane) Round duct

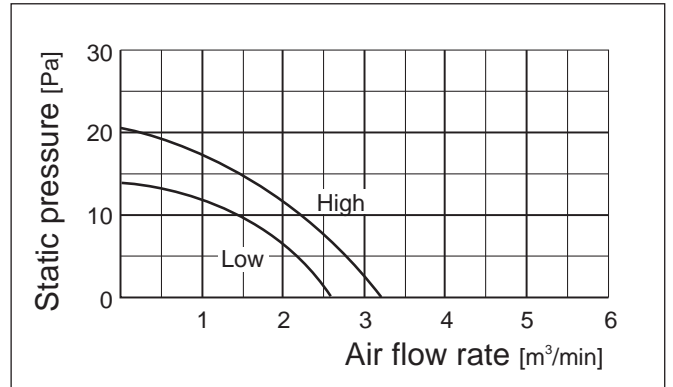


3-way air flow (horizontal vane) Rectangular duct

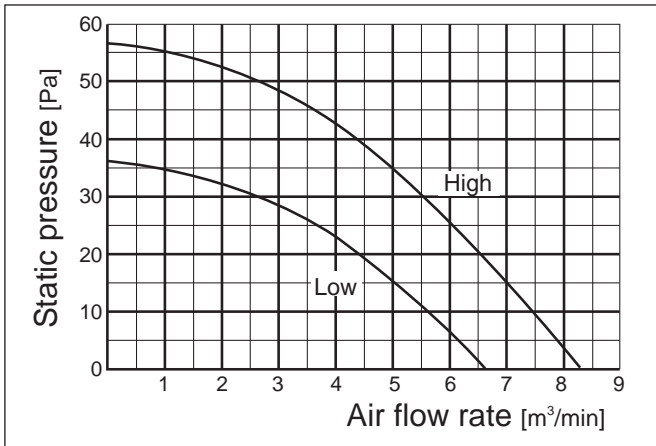


3-way air flow (horizontal vane) Round duct

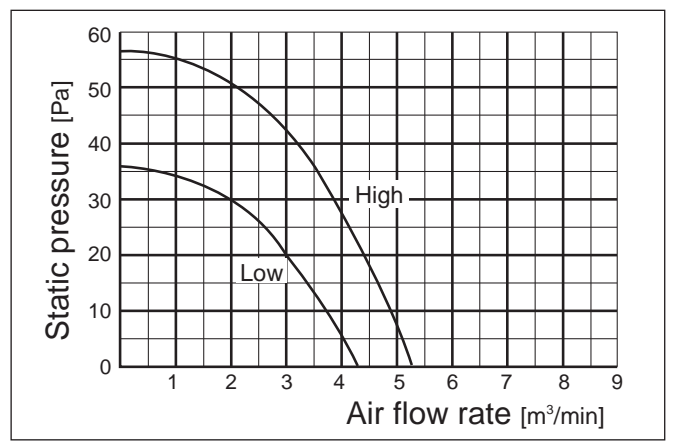

2-way air flow (horizontal vane) Rectangular duct

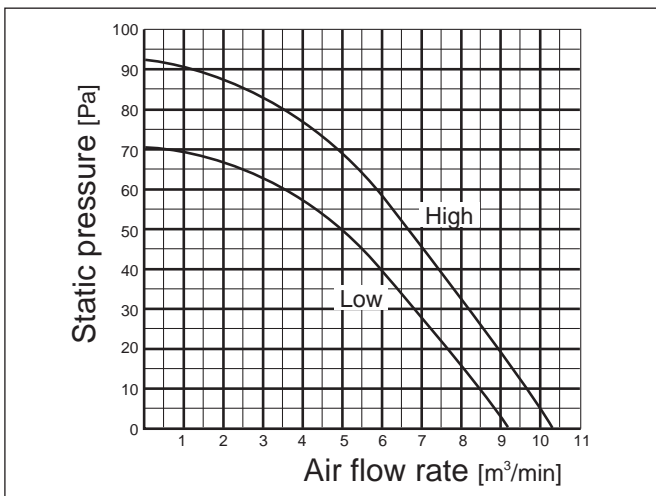





2-way air flow (horizontal vane) Round duct

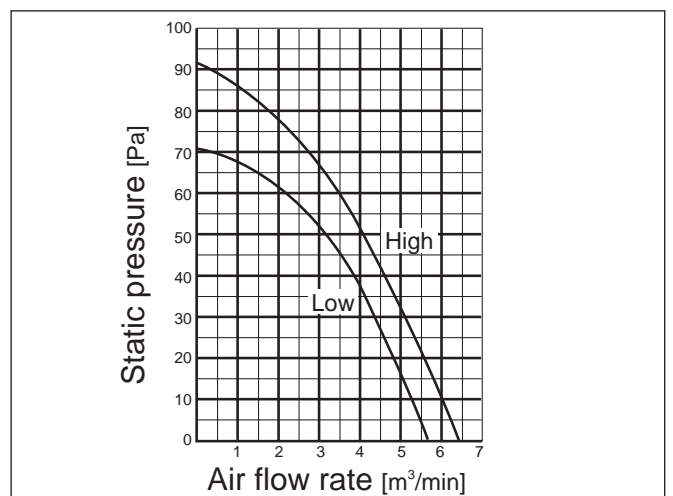





8-7. PEAD-RP-EA, EA2, GA

8-7-1. Fan performance and corrected air flow

PEAD-RP35EA2 PEAD-RP50EA

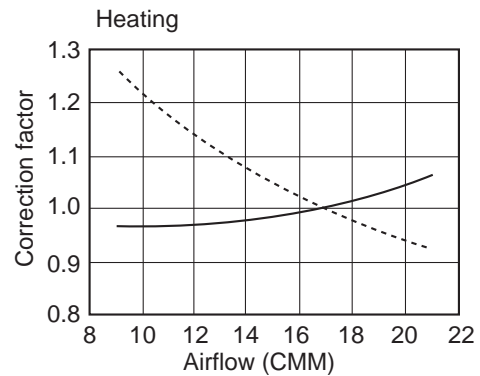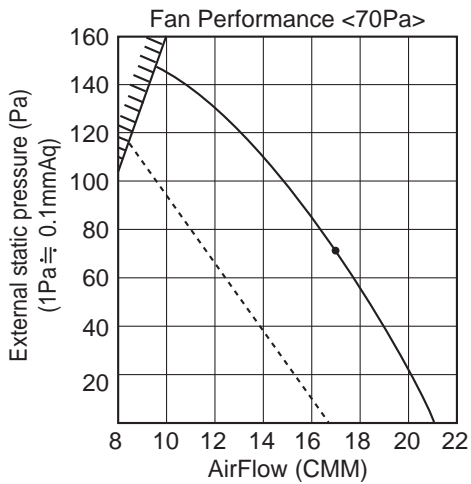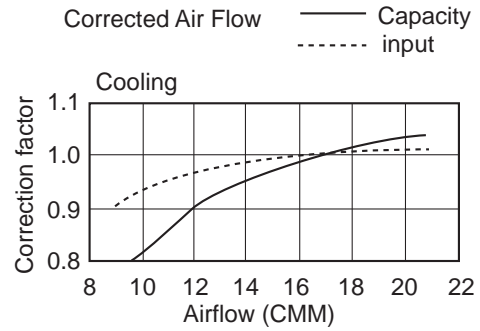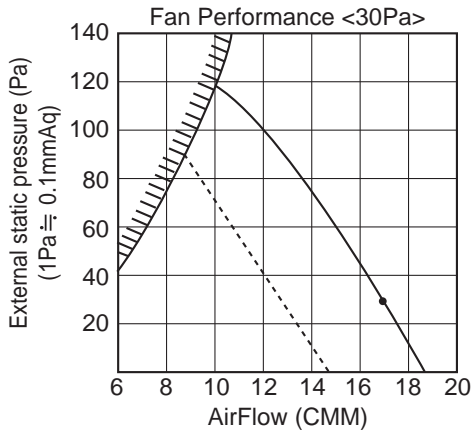


PEAD-RP60EA

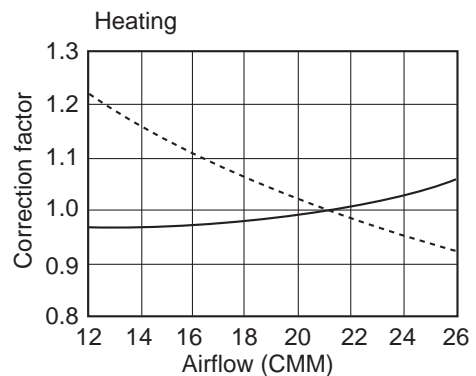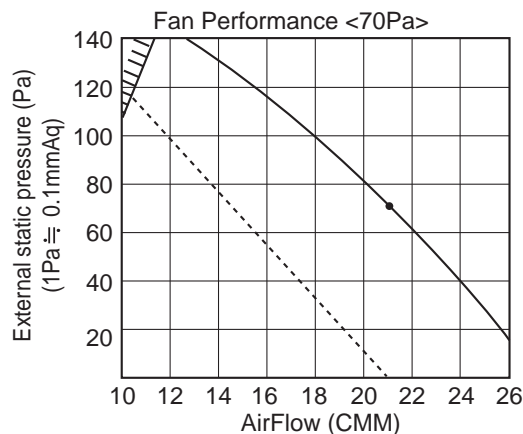
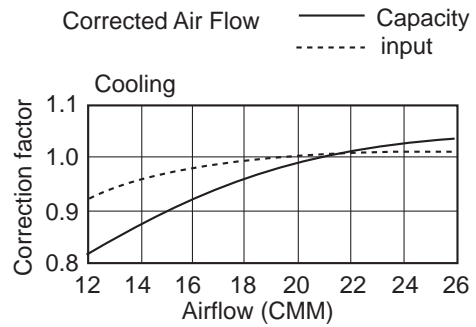
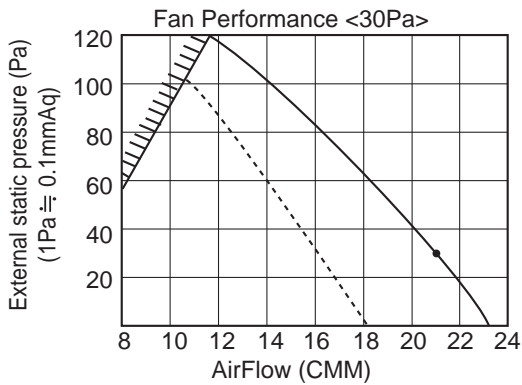


PEAD-RP71EA

Fan performance <130Pa>

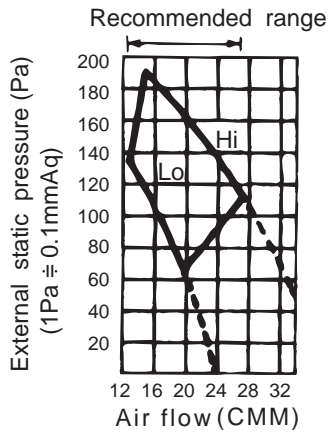


Fan performance <70Pa>

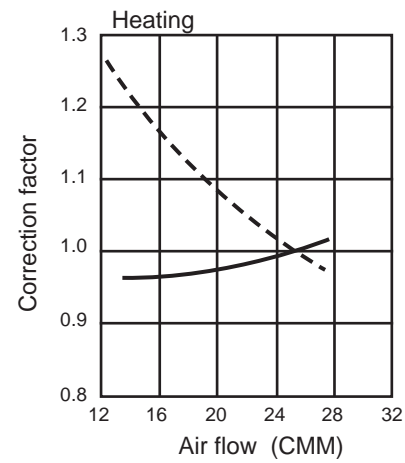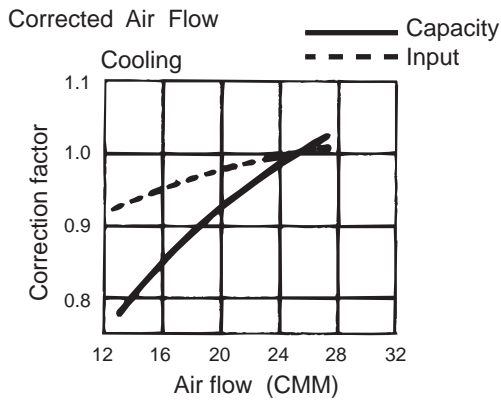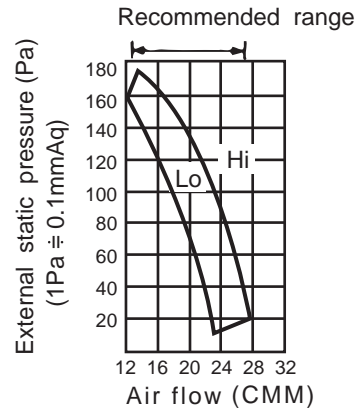


PEAD-RP60GA


Fan performance <220V>

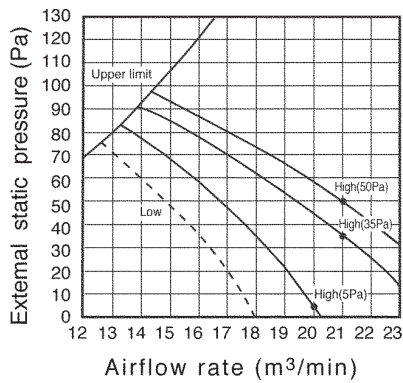


Fan performance <230V>

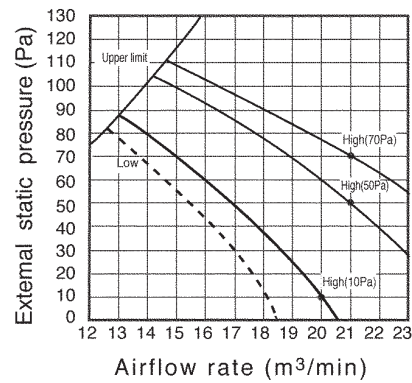

Fan performance <240V>

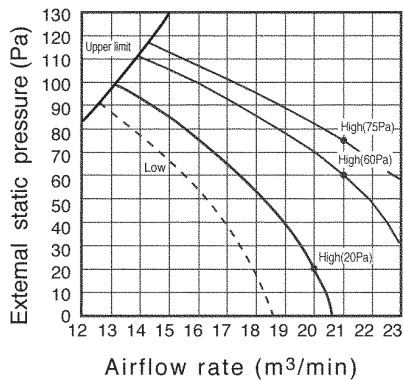


Corrected air flow

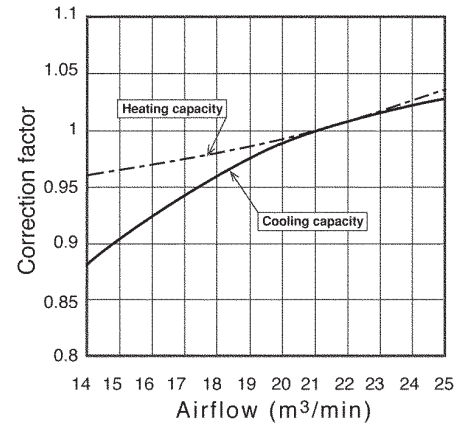


PEAD-RP71GA


Fan performance <220V>

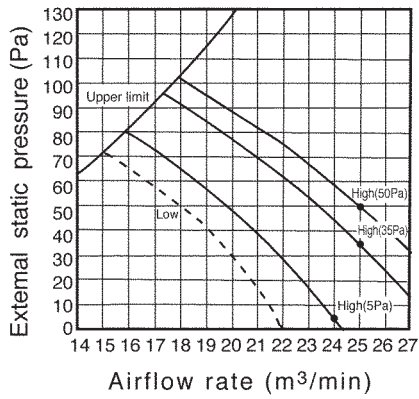


Fan performance <230V>

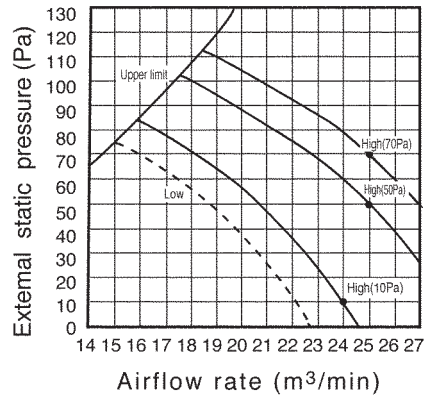

Fan performance <240V>

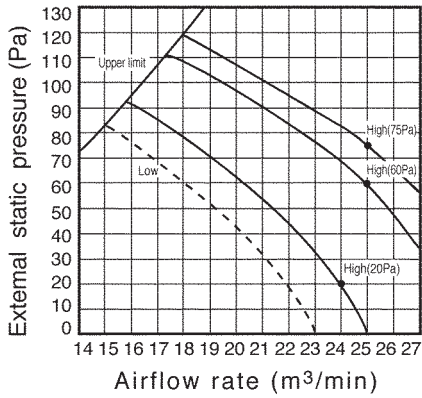



Corrected air flow

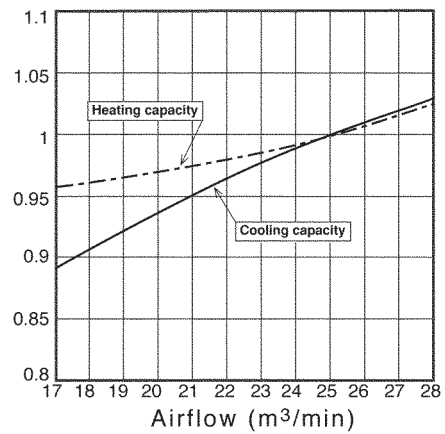

8-8. PEA-RP-EA

8-8-1. Fan performance and corrected airflow

PEA-RP71EA

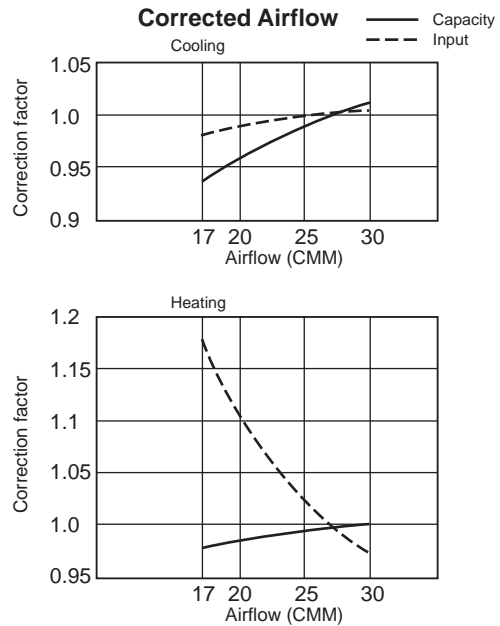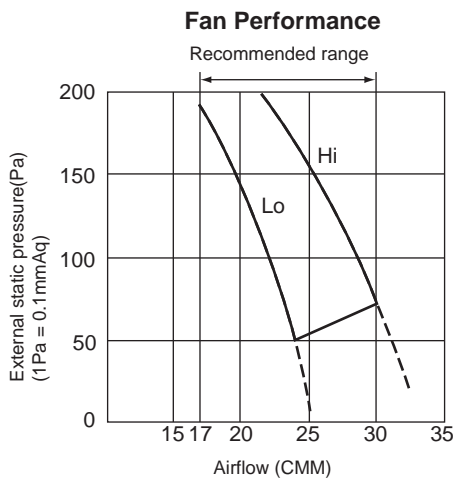


MFZ-KA25VA

| FAN SPEED | FUNCTION | SPL(dB(A)) | LINE |
|------------|----------|------------|------|
| Super High | COOLING | 37 | ●—● |
| | HEATING | 37 | ○—○ |

Test conditions,

Cooling : Dry-bulb temperature 27°C Wet-bulb temperature 19°C
 Heating : Dry-bulb temperature 20°C Wet-bulb temperature 15°C

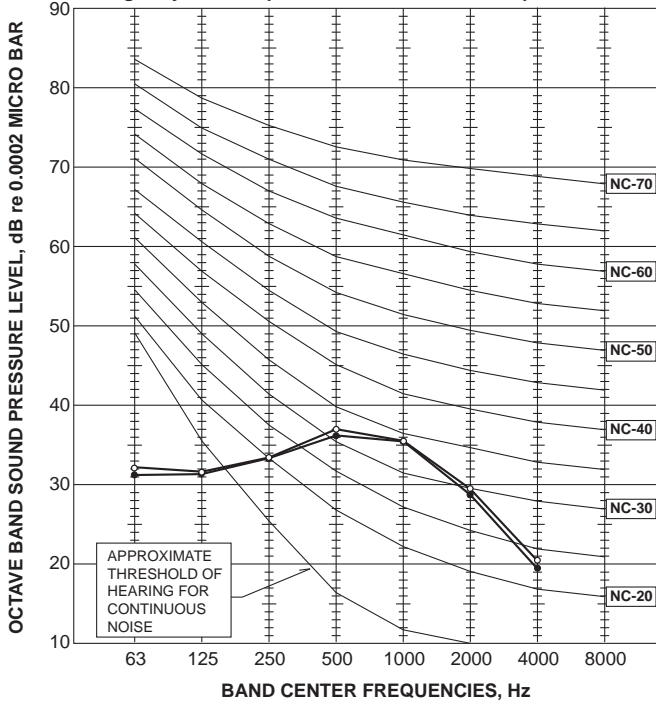


MFZ-KA35VA

| FAN SPEED | FUNCTION | SPL(dB(A)) | LINE |
|------------|----------|------------|------|
| Super High | COOLING | 38 | ●—● |
| | HEATING | 38 | ○—○ |

Test conditions,

Cooling : Dry-bulb temperature 27°C Wet-bulb temperature 19°C
 Heating : Dry-bulb temperature 20°C Wet-bulb temperature 15°C


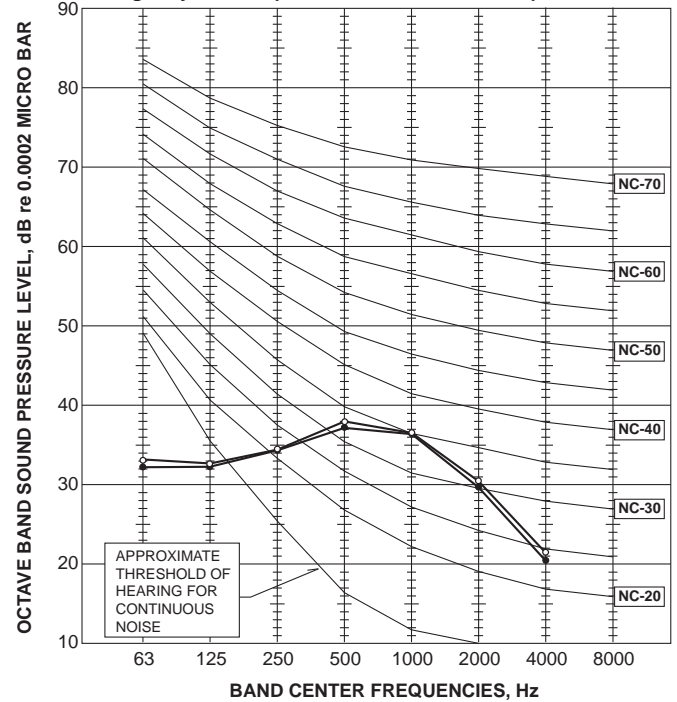


MFZ-KA50VA

| FAN SPEED | FUNCTION | SPL(dB(A)) | LINE |
|------------|----------|------------|------|
| Super High | COOLING | 43 | ●—● |
| | HEATING | 44 | ○—○ |

Test conditions,


Cooling : Dry-bulb temperature 27°C Wet-bulb temperature 19°C
 Heating : Dry-bulb temperature 20°C Wet-bulb temperature 15°C

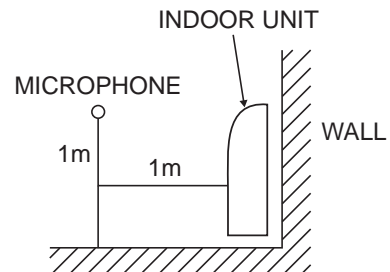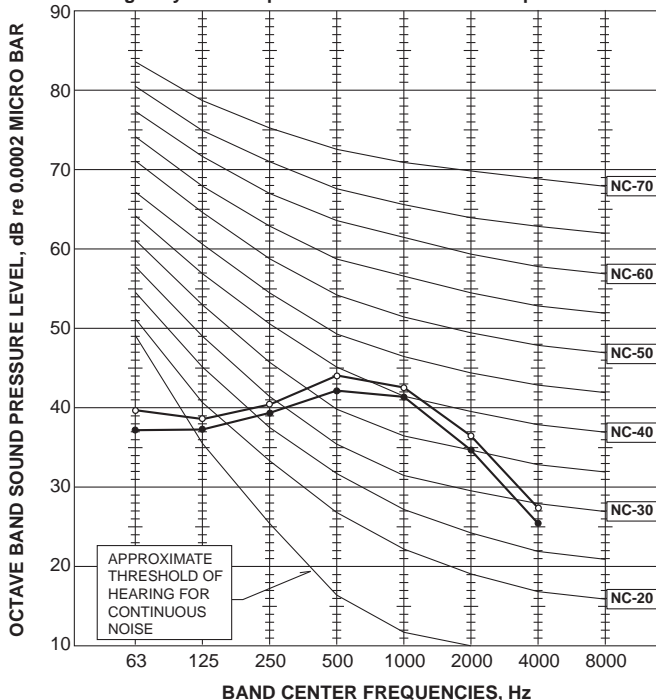

**SLZ-KA25VAL
SLZ-KA25VA**

<50Hz>


| NOTCH | SPL(dB) | LINE |
|--------|---------|------|
| High | 37 | ○—○ |
| Medium | 31 | △—△ |
| Low | 28 | □—□ |

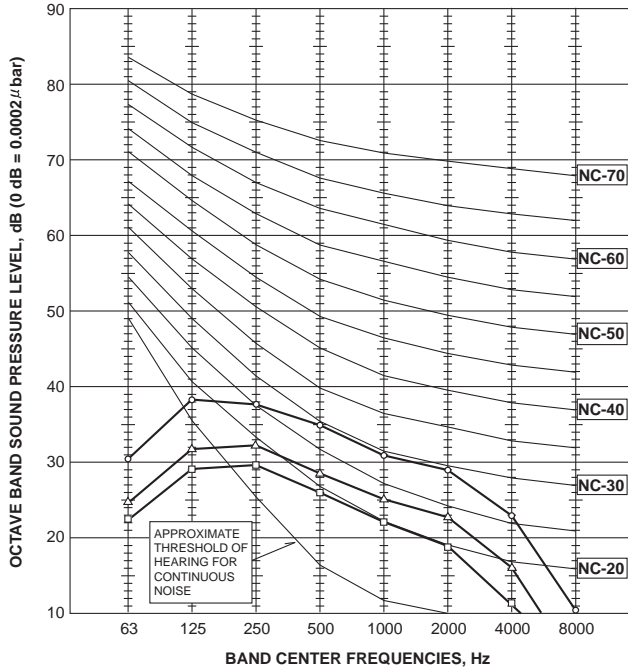

**SLZ-KA35VAL
SLZ-KA35VA**

<50Hz>



| NOTCH | SPL(dB) | LINE |
|--------|---------|------|
| High | 38 | ○—○ |
| Medium | 33 | △—△ |
| Low | 29 | □—□ |

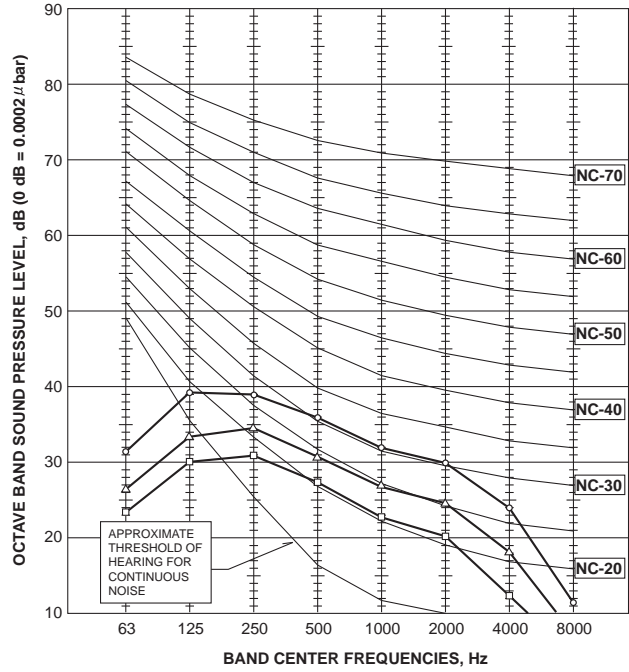

**SLZ-KA50VAL
SLZ-KA50VA**

<50Hz>

| NOTCH | SPL(dB) | LINE |
|--------|---------|------|
| High | 39 | ○—○ |
| Medium | 34 | △—△ |
| Low | 30 | □—□ |

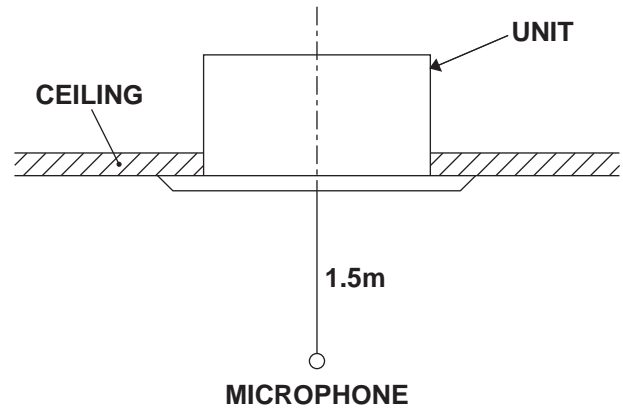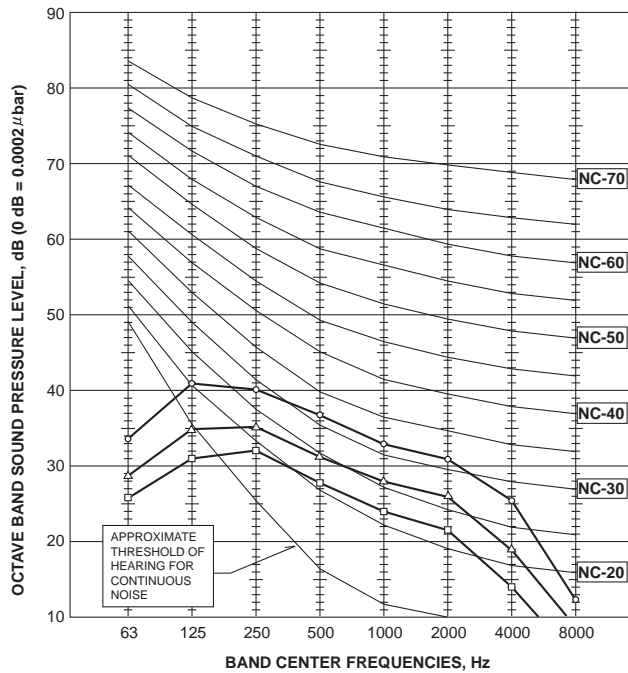


NOTE: The sound level is measured in an anechoic room where echoes are few, when compressor stops. The sound may be bigger than the indicated level in actual use due to surrounding echoes. The sound level can be higher by about 2 dB than the indicated level during cooling and heating operation.

NOISE CRITERION CURVES

SEZ-KD25VA(L)

External static pressure: 5Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|-----------|
| High | 29 | ————— |
| Middle | 25 | - - - - - |
| Low | 22 | — · — · — |

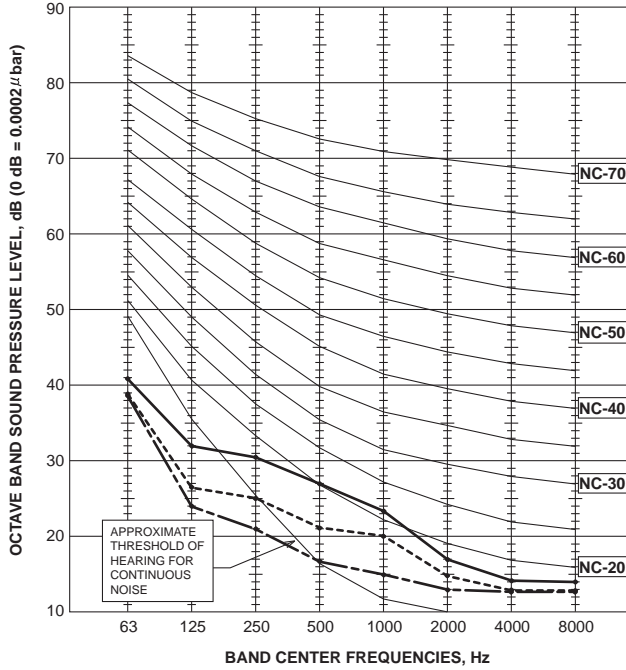

SEZ-KD25VA(L)

External static pressure: 15Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|-----------|
| High | 30 | ————— |
| Middle | 26 | - - - - - |
| Low | 23 | — · — · — |

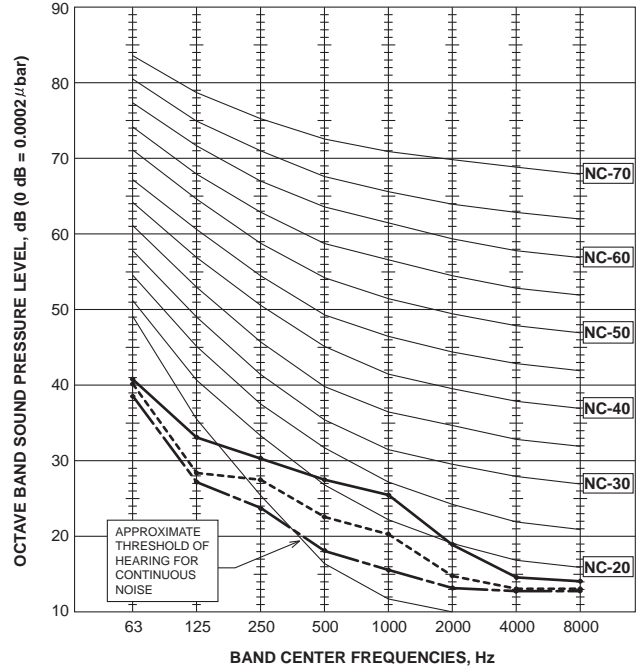

SEZ-KD25VA(L)

External static pressure: 35Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|-----------|
| High | 31 | ————— |
| Middle | 28 | - - - - - |
| Low | 24 | — · — · — |

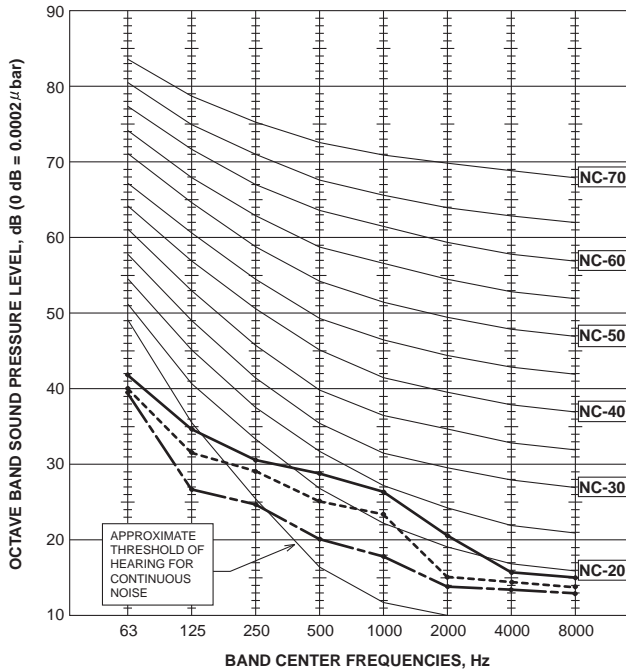

SEZ-KD25VA(L)

External static pressure: 50Pa

| NOTCH | SPL(dB) | LINE |
|--------|---------|-----------|
| High | 33 | ————— |
| Middle | 29 | - - - - - |
| Low | 25 | — · — · — |

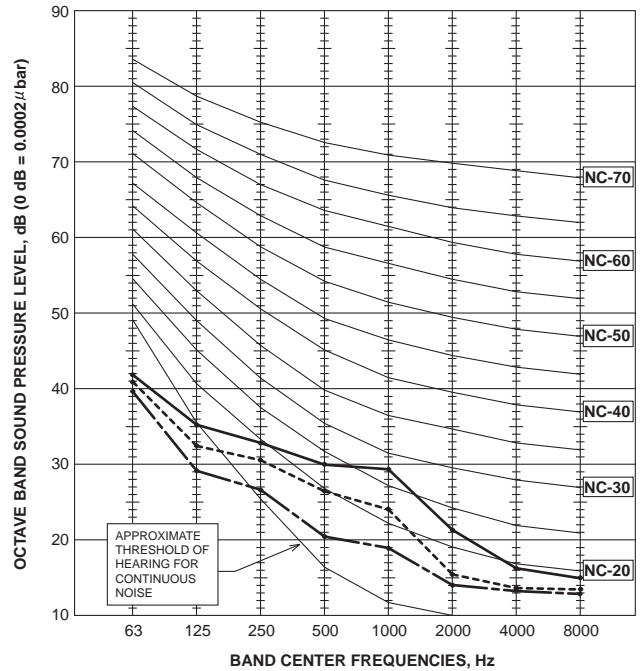


NOTE: The sound level is measured in an anechoic room where echoes are few, when compressor stops. The sound may be bigger than indicated level in actual use due to surrounding echoes. The sound level can be higher by about 2 dB than the indicated level during cooling and heating operation.

SEZ-KD35VA(L)

External static pressure: 5Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 33 | ———— |
| Middle | 28 | ----- |
| Low | 23 | - - - - |

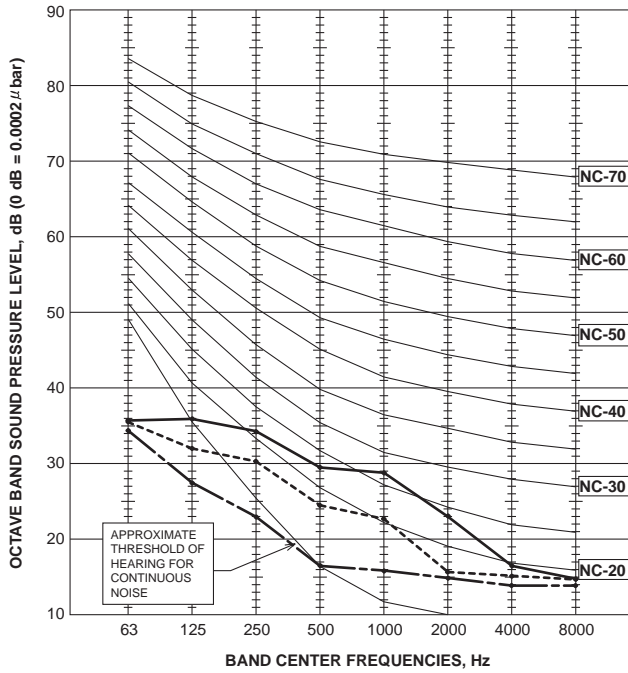

SEZ-KD35VA(L)

External static pressure: 15Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 33 | ———— |
| Middle | 28 | ----- |
| Low | 23 | - - - - |

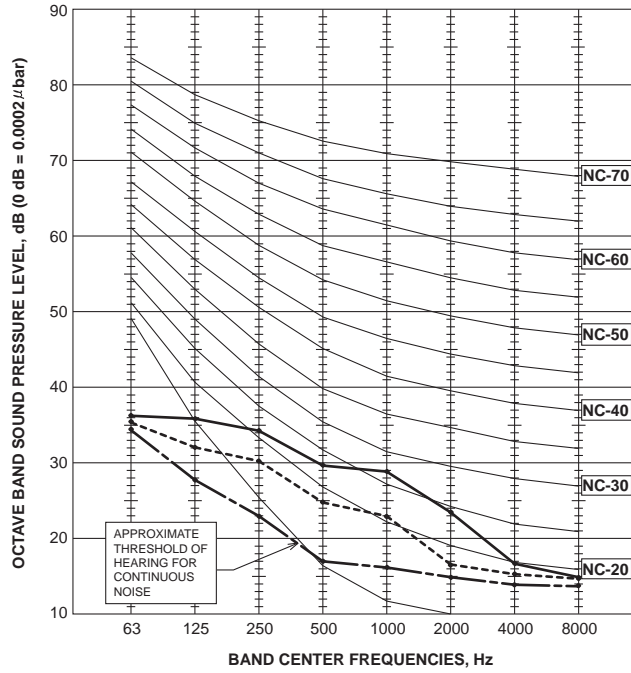

SEZ-KD35VA(L)

External static pressure: 35Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 34 | ———— |
| Middle | 29 | ----- |
| Low | 24 | - - - - |

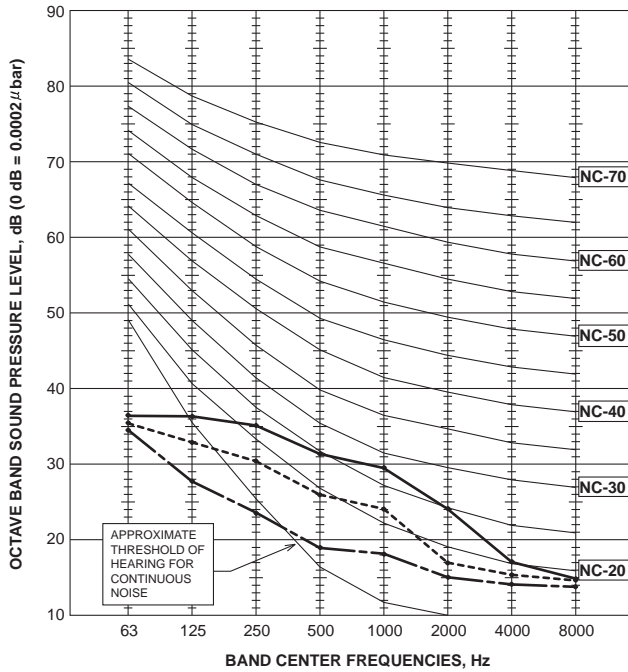

SEZ-KD35VA(L)

External static pressure: 50Pa

| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 35 | ———— |
| Middle | 31 | ----- |
| Low | 25 | - - - - |

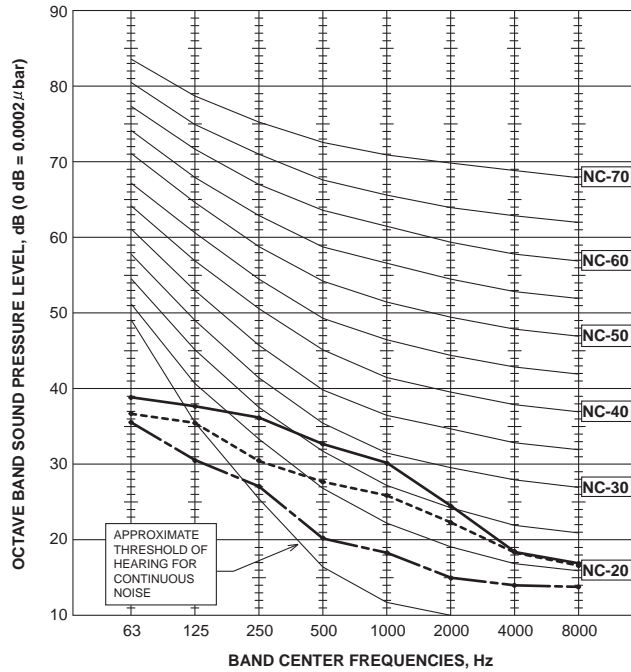


NOTE: The sound level is measured in an anechoic room where echoes are few, when compressor stops. The sound may be bigger than indicated level in actual use due to surrounding echoes. The sound level can be higher by about 2 dB than the indicated level during cooling and heating operation.

SEZ-KD50VA(L)

External static pressure: 5Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 36 | ———— |
| Middle | 33 | ----- |
| Low | 29 | - - - - |

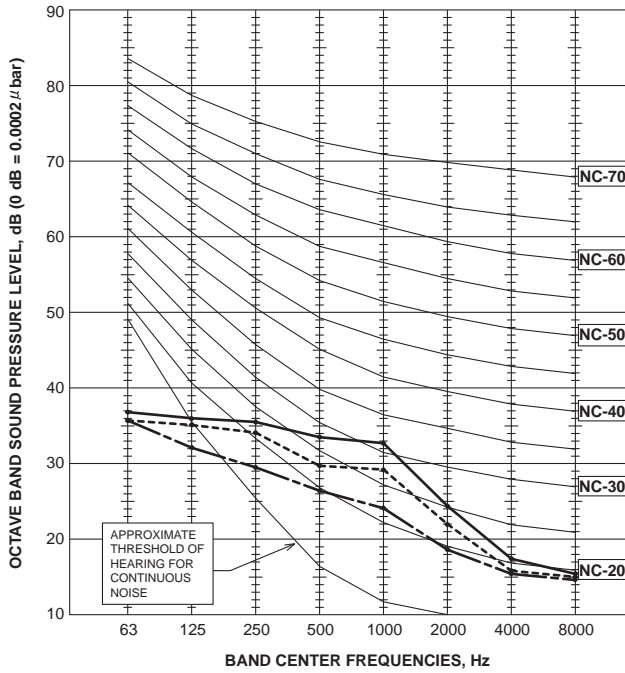

SEZ-KD50VA(L)

External static pressure: 15Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 37 | ———— |
| Middle | 34 | ----- |
| Low | 30 | - - - - |

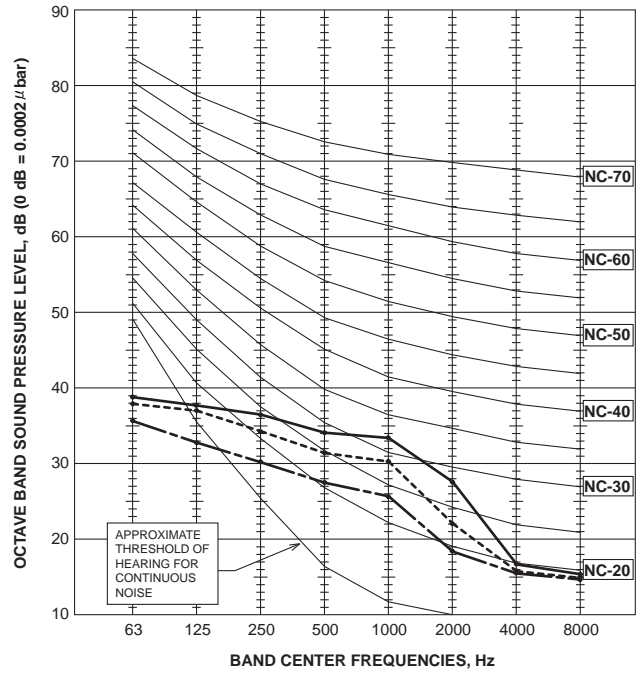

SEZ-KD50VA(L)

External static pressure: 35Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 38 | ———— |
| Middle | 35 | ----- |
| Low | 31 | - - - - |

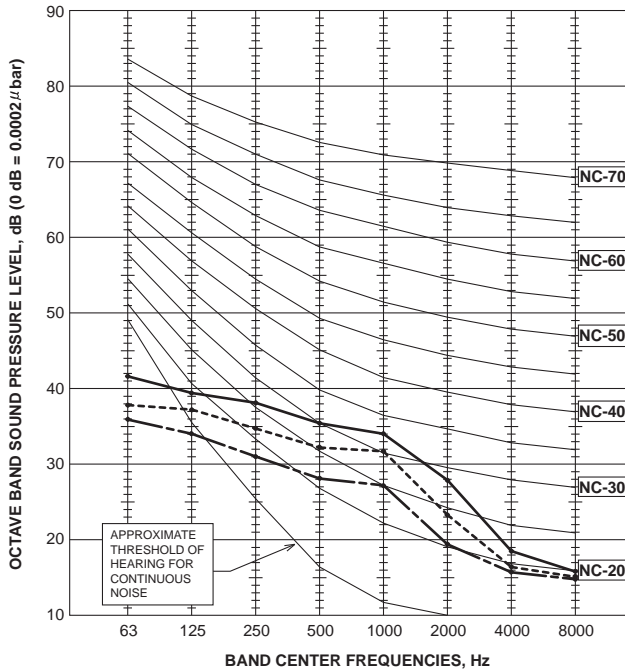

SEZ-KD50VA(L)

External static pressure: 50Pa

| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 39 | ———— |
| Middle | 36 | ----- |
| Low | 32 | - - - - |

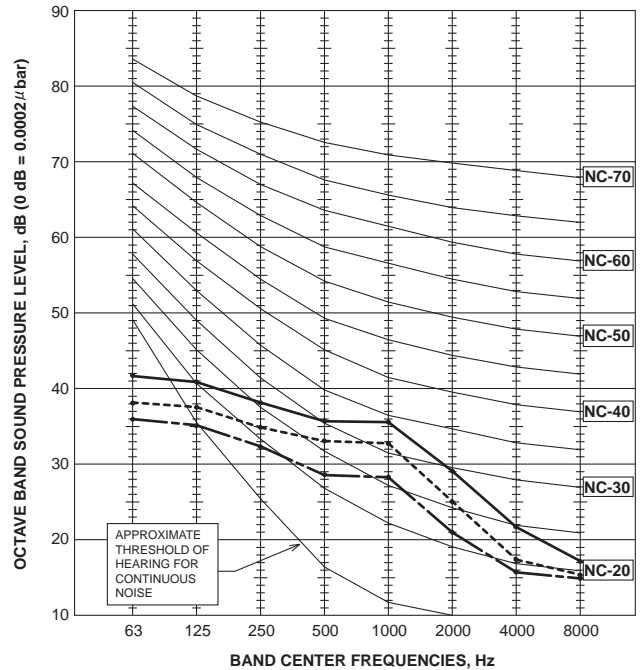


NOTE: The sound level is measured in an anechoic room where echoes are few, when compressor stops. The sound may be bigger than the indicated level in actual use due to surrounding echoes. The sound level can be higher by about 2 dB than the indicated level during cooling and heating operation.

SEZ-KD60VA(L)

External static pressure: 5Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 37 | ———— |
| Middle | 33 | ----- |
| Low | 29 | - - - - |

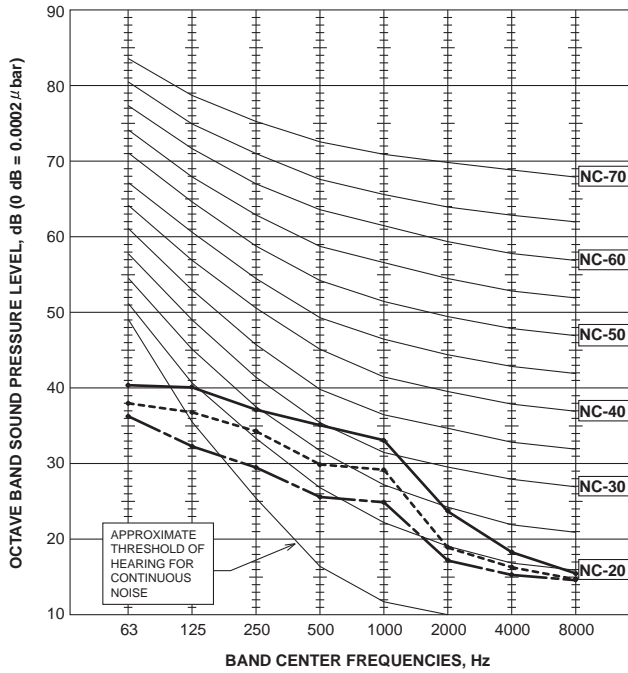

SEZ-KD60VA(L)

External static pressure: 15Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 38 | ———— |
| Middle | 34 | ----- |
| Low | 30 | - - - - |

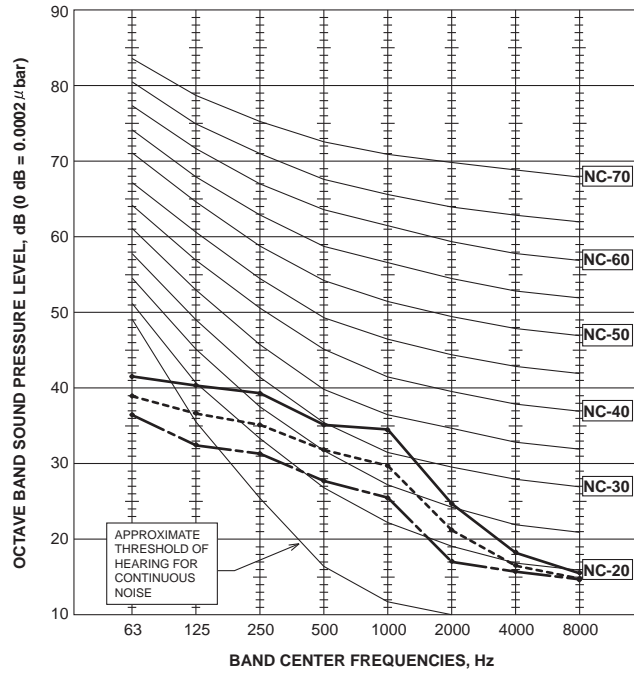

SEZ-KD60VA(L)

External static pressure: 35Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 39 | ———— |
| Middle | 35 | ----- |
| Low | 31 | - - - - |

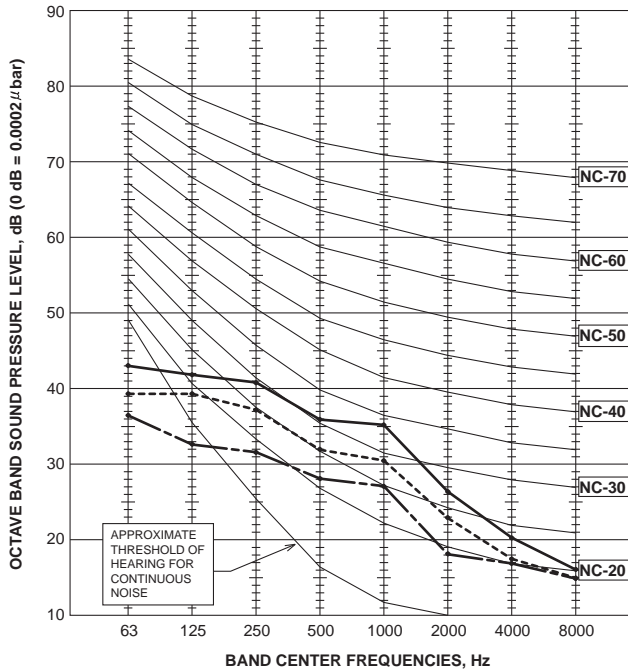

SEZ-KD60VA(L)

External static pressure: 50Pa

| NOTCH | SPL(dB) | LINE |
|--------|---------|---------|
| High | 39 | ———— |
| Middle | 36 | ----- |
| Low | 32 | - - - - |

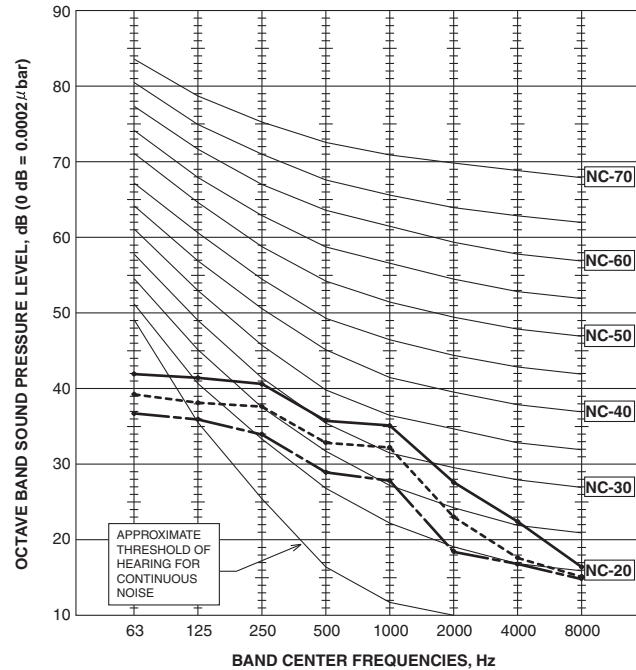


NOTE: The sound level is measured in an anechoic room where echoes are few, when compressor stops. The sound may be bigger than the indicated level in actual use due to surrounding echoes. The sound level can be higher by about 2 dB than the indicated level during cooling and heating operation.

SEZ-KD71VA(L)

External static pressure: 5Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|-----------|
| High | 39 | ————— |
| Middle | 34 | - - - - - |
| Low | 29 | - · - · - |

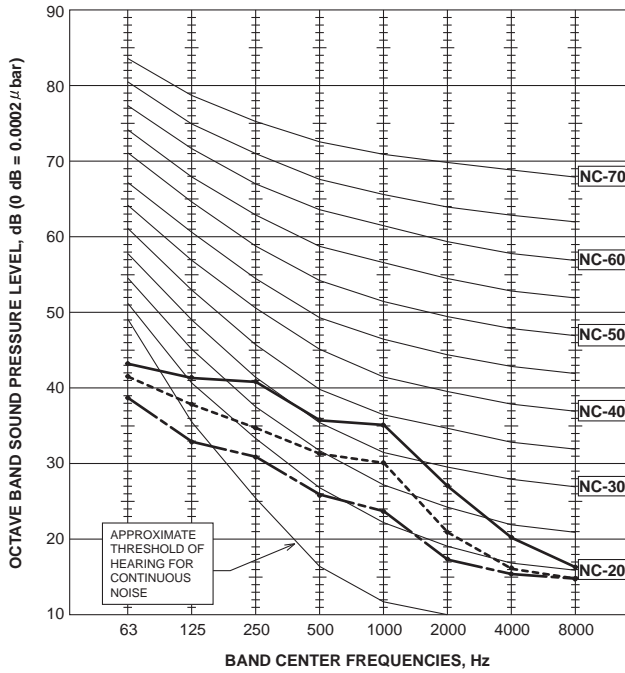

SEZ-KD71VA(L)

External static pressure: 15Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|-----------|
| High | 40 | ————— |
| Middle | 35 | - - - - - |
| Low | 30 | - · - · - |

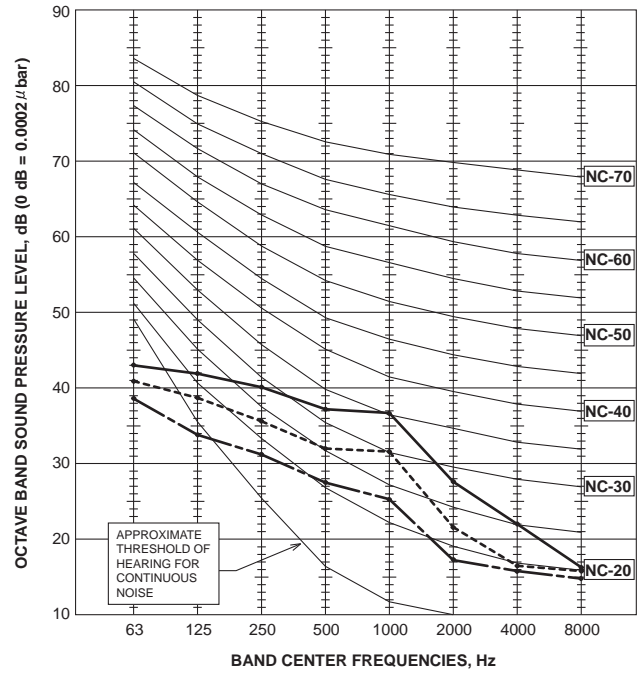

SEZ-KD71VA(L)

External static pressure: 35Pa


| NOTCH | SPL(dB) | LINE |
|--------|---------|-----------|
| High | 41 | ————— |
| Middle | 36 | - - - - - |
| Low | 31 | - · - · - |

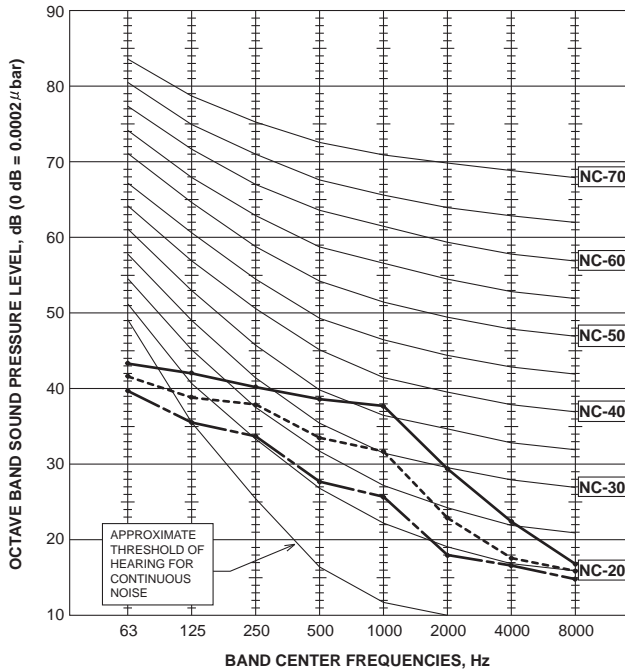


SEZ-KD71VA(L)

External static pressure: 50Pa

| NOTCH | SPL(dB) | LINE |
|--------|---------|-----------|
| High | 42 | ————— |
| Middle | 37 | - - - - - |
| Low | 32 | - · - · - |

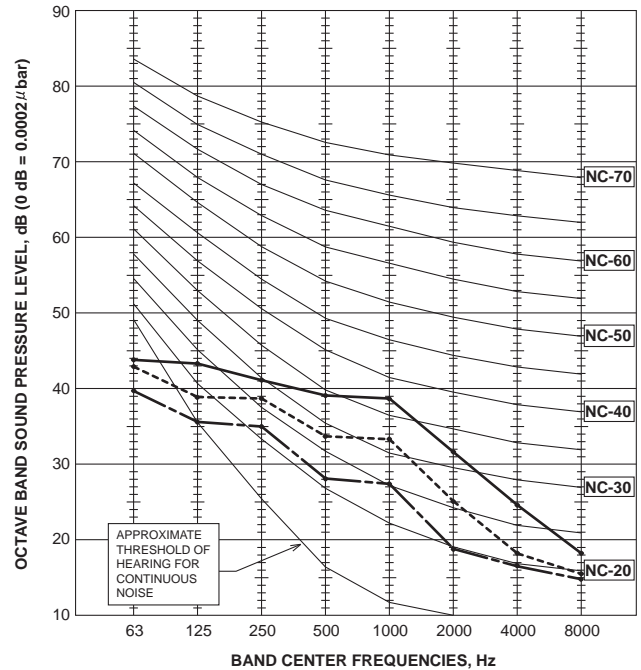



NOTE: The sound level is measured in an anechoic room where echoes are few, when compressor stops. The sound may be bigger than the indicated level in actual use due to surrounding echoes. The sound level can be higher by about 2 dB than the indicated level during cooling and heating operation.

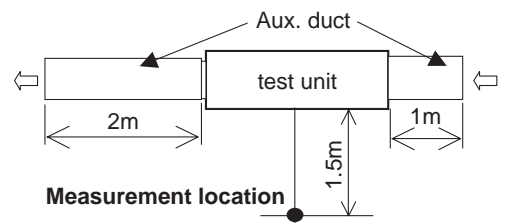

SEZ-KC25VA

<50Hz>

| NOTCH | SPL(dB) |
|-------|---------|
| High | 36 |
| Low | 25 |

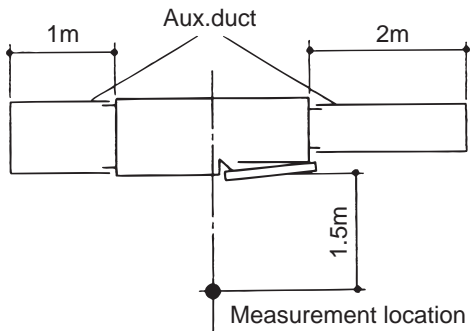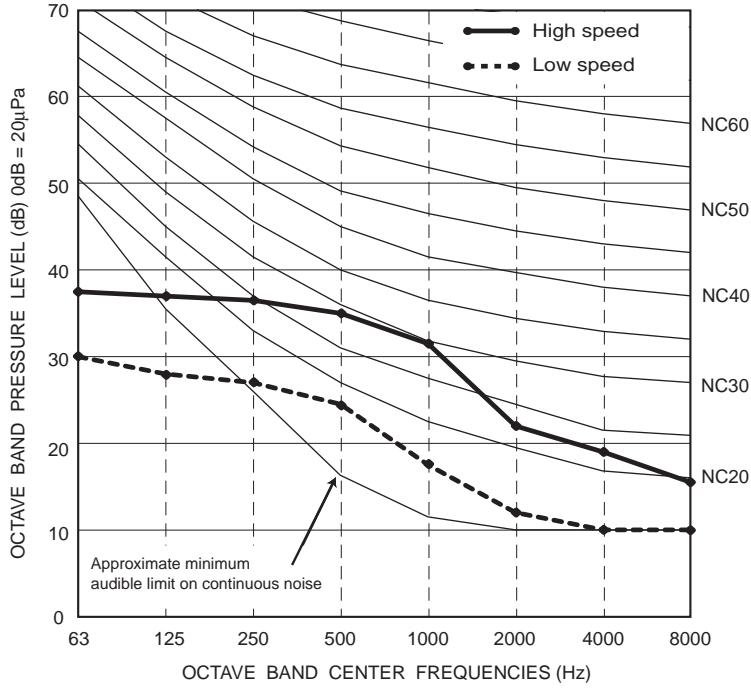


NOTE: The sound level is measured in an anechoic room where echoes are few, when compressor stops. The sound may be bigger than the indicated level in actual use due to surrounding echoes. The sound level can be higher by about 2 dB than the indicated level during cooling and heating operation.

SEZ-KA35VA

<50Hz>


| NOTCH | SPL(dB) | LINE |
|-------|---------|------|
| High | 35 | ○—○ |
| Low | 30 | ●—● |

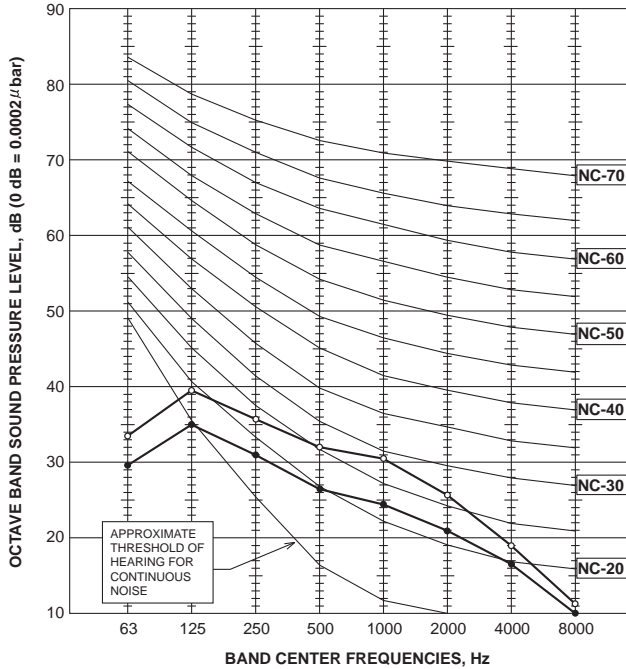

SEZ-KA50VA

<50Hz>



| NOTCH | SPL(dB) | LINE |
|-------|---------|------|
| High | 39 | ○—○ |
| Low | 31 | ●—● |

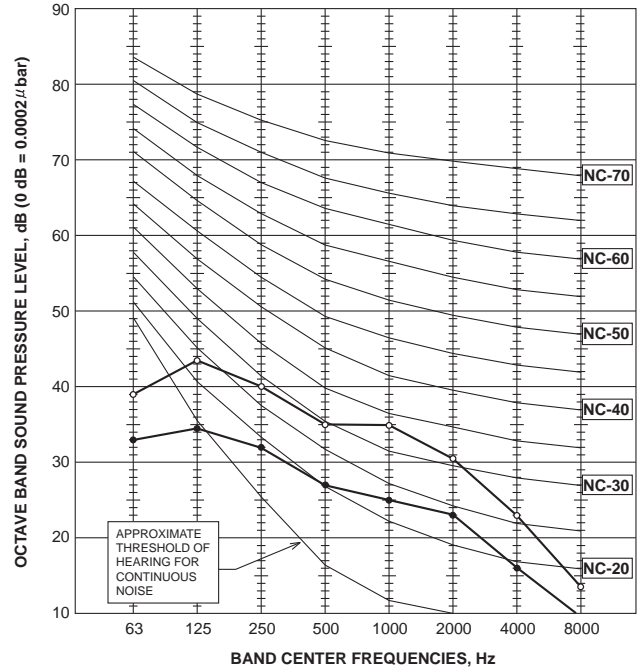

SEZ-KA60VA SEZ-KA71VA

<50Hz>


| NOTCH | SPL(dB) | LINE |
|-------|---------|------|
| High | 43 | ○—○ |
| Low | 32 | ●—● |

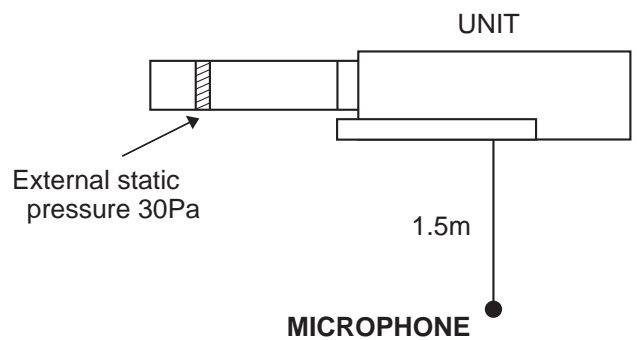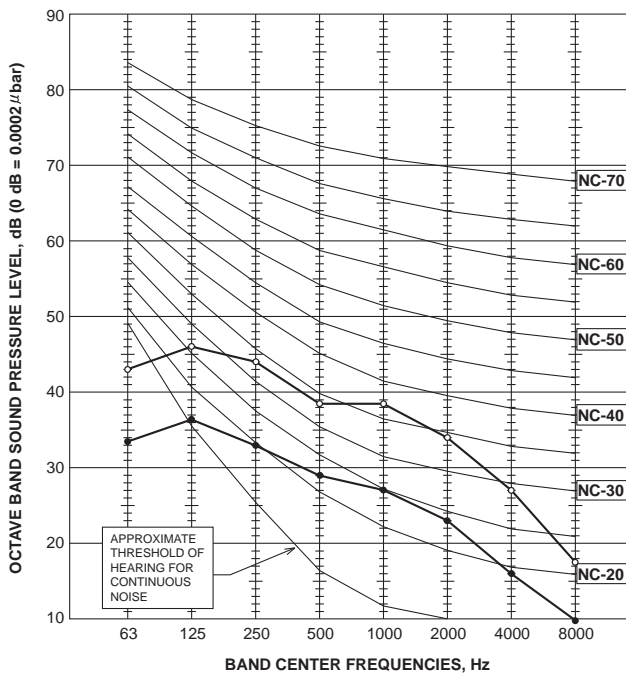

NOTE: The sound level is measured in an anechoic room where echoes are few, when compressor stops. The sound may be bigger than the indicated level in actual use due to surrounding echoes. The sound level can be higher by about 2 dB than the indicated level during cooling and heating operation.


PLA-RP35BA

| NOTCH | SPL(dB) | LINE |
|---------|---------|------|
| High | 31 | ○—○ |
| Medium1 | 29 | ●—● |
| Medium2 | 28 | △—△ |
| Low | 27 | ▲—▲ |

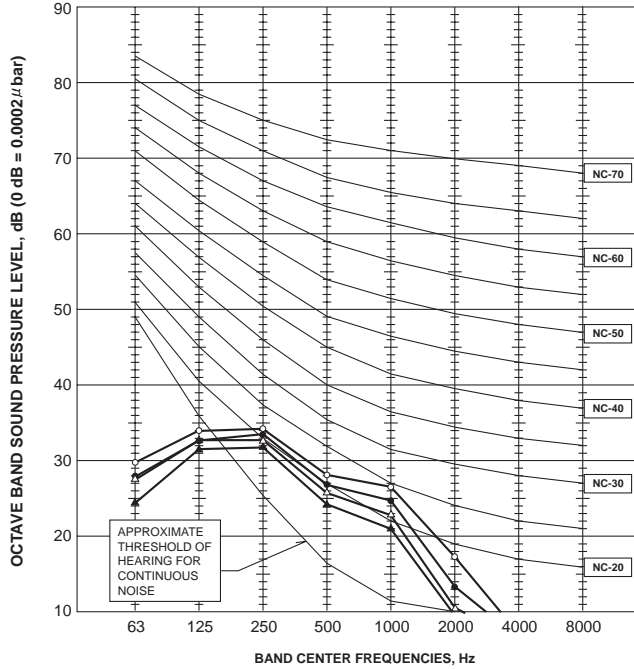


PLA-RP50BA

| NOTCH | SPL(dB) | LINE |
|---------|---------|------|
| High | 32 | ○—○ |
| Medium1 | 31 | ●—● |
| Medium2 | 29 | △—△ |
| Low | 28 | ▲—▲ |

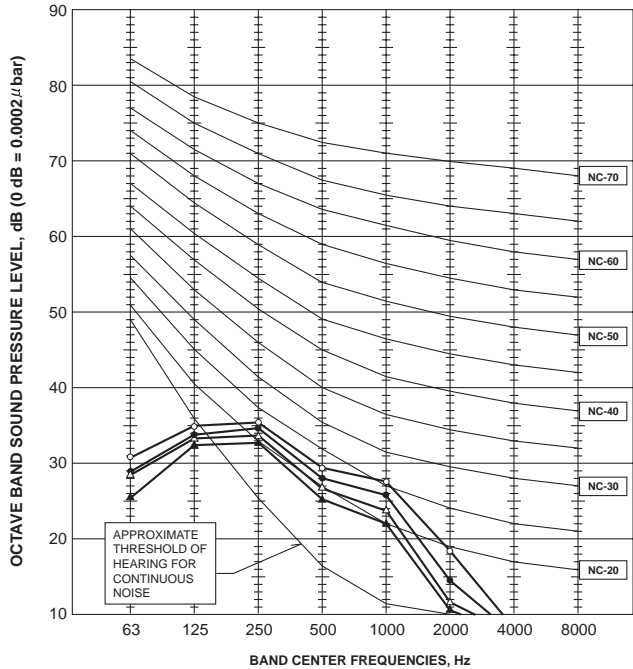


PLA-RP60BA

| NOTCH | SPL(dB) | LINE |
|---------|---------|------|
| High | 32 | ○—○ |
| Medium1 | 31 | ●—● |
| Medium2 | 29 | △—△ |
| Low | 28 | ▲—▲ |

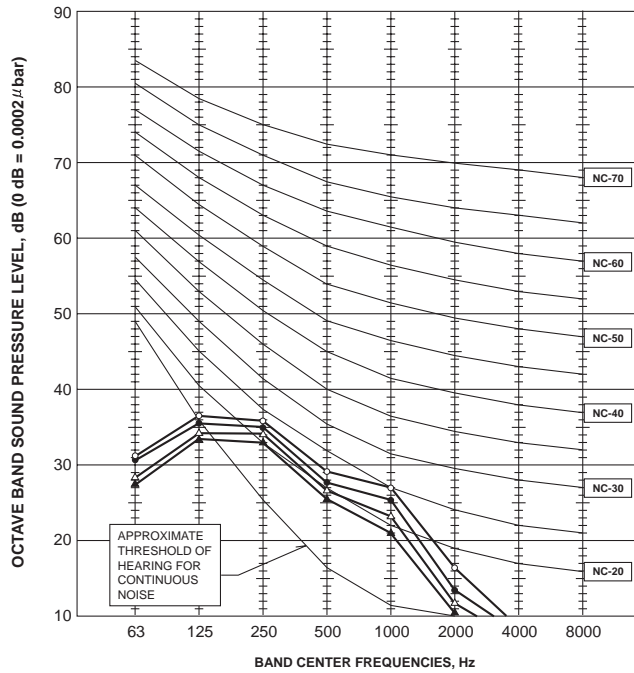


PLA-RP71BA

| NOTCH | SPL(dB) | LINE |
|---------|---------|------|
| High | 34 | ○—○ |
| Medium1 | 32 | ●—● |
| Medium2 | 30 | △—△ |
| Low | 28 | ▲—▲ |

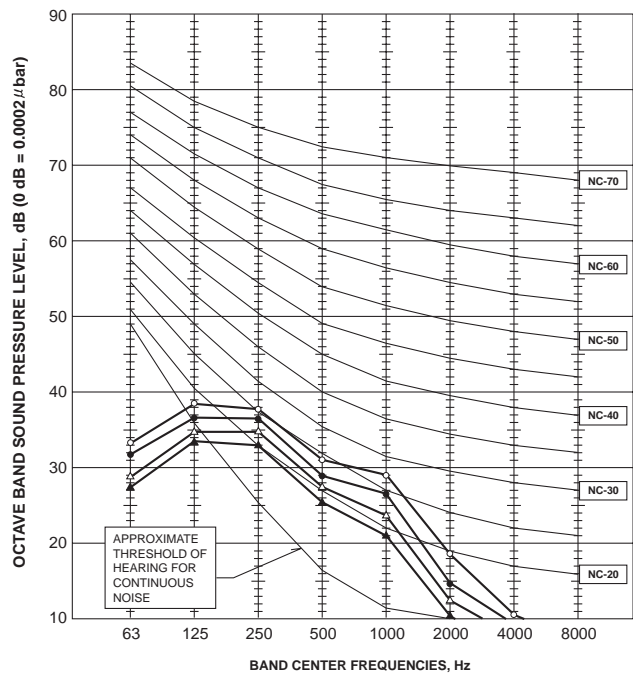


PLA-RP35AA

| NOTCH | SPL(dB) | LINE |
|---------|---------|------|
| High | 31 | ○—○ |
| Medium1 | 29 | △—△ |
| Medium2 | 28 | ●—● |
| Low | 27 | ▲—▲ |

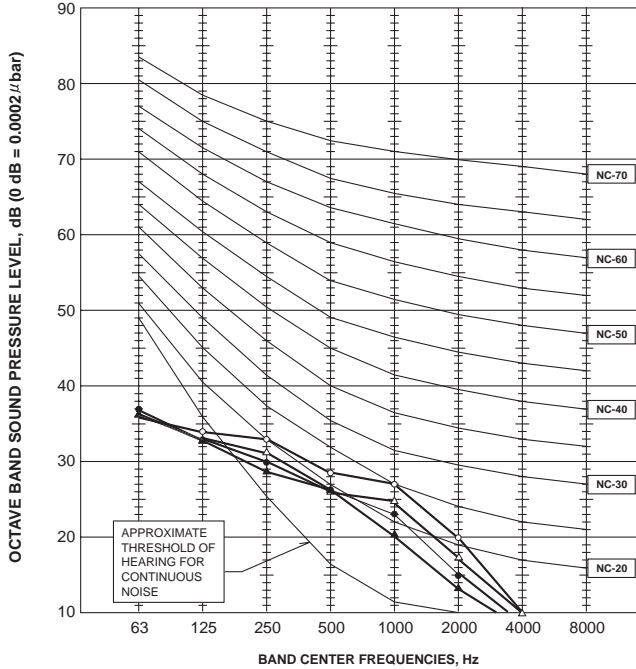



PLA-RP50AA PLA-RP60AA

| NOTCH | SPL(dB) | LINE |
|---------|---------|------|
| High | 33 | ○—○ |
| Medium1 | 31 | △—△ |
| Medium2 | 29 | ●—● |
| Low | 28 | ▲—▲ |

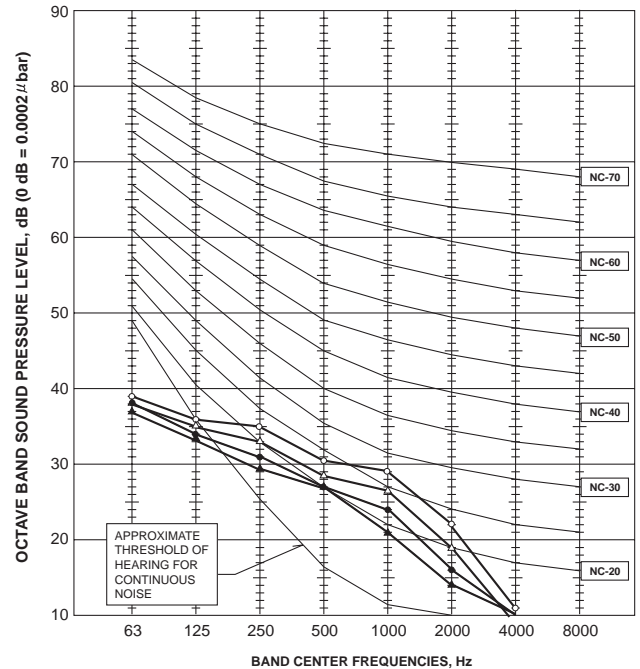


PLA-RP71AA

| NOTCH | SPL(dB) | LINE |
|---------|---------|------|
| High | 34 | ○—○ |
| Medium1 | 32 | △—△ |
| Medium2 | 30 | ●—● |
| Low | 28 | ▲—▲ |

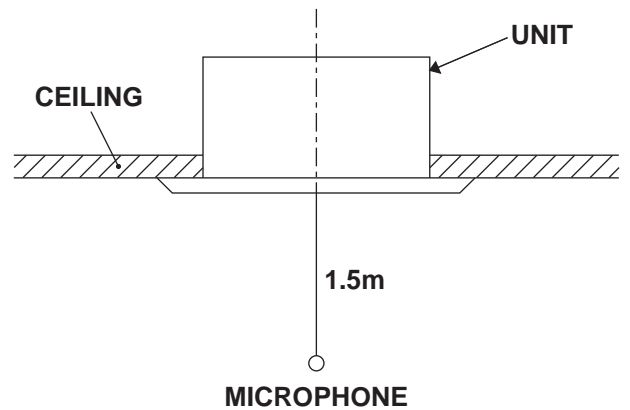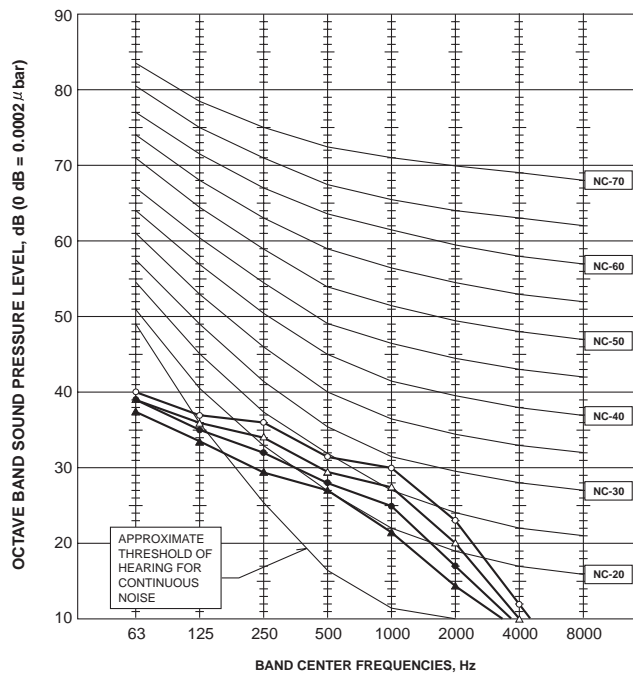







Ceiling concealed

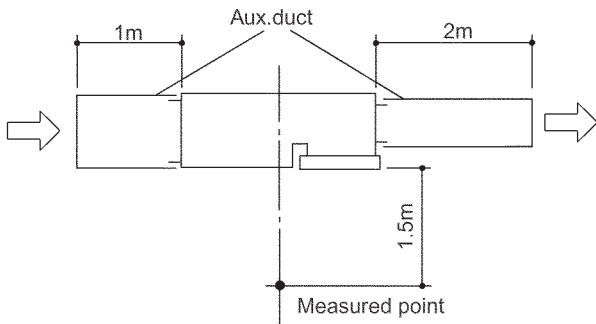


Noise level at an echoic room (Low-High) Unit : dB(A)

| Model | External static pressure | | |
|--------------|--------------------------|--------|--------|
| | 30Pa | 70Pa | 130Pa |
| PEAD-RP35EA2 | 36-40 | 38-44* | - |
| PEAD-RP50EA | 36-40 | 38-44* | - |
| PEAD-RP60EA | 37-41 | 39-46* | - |
| PEAD-RP71EA | - | 37-41 | 40-45* |

* Optional motor

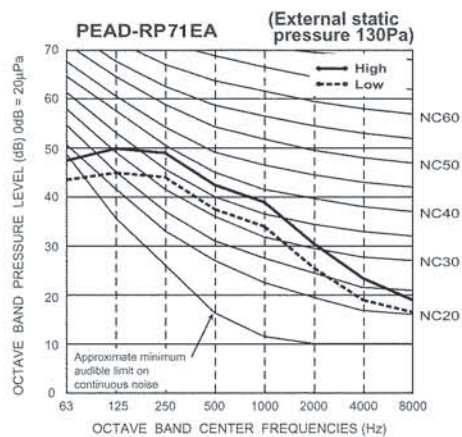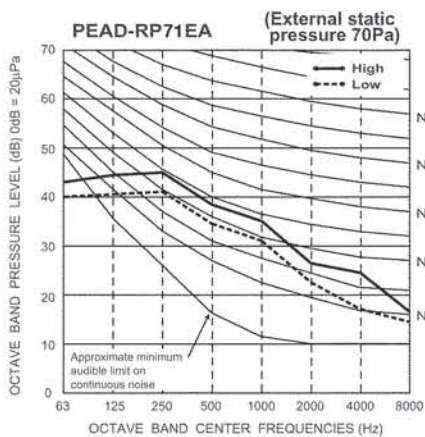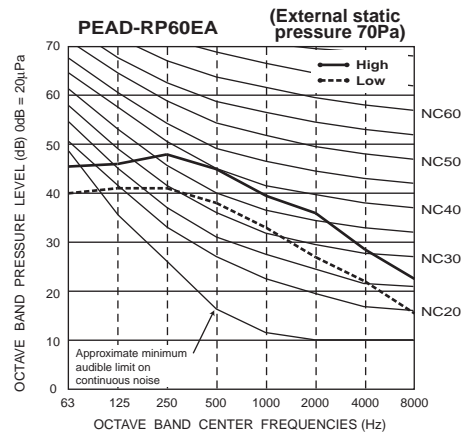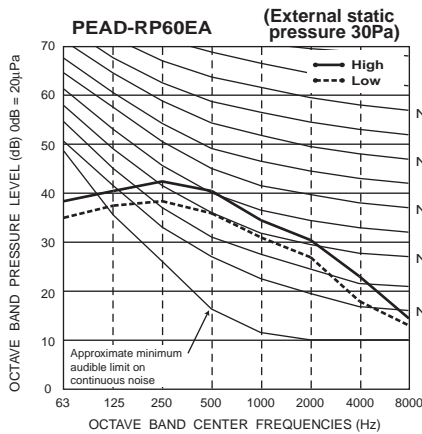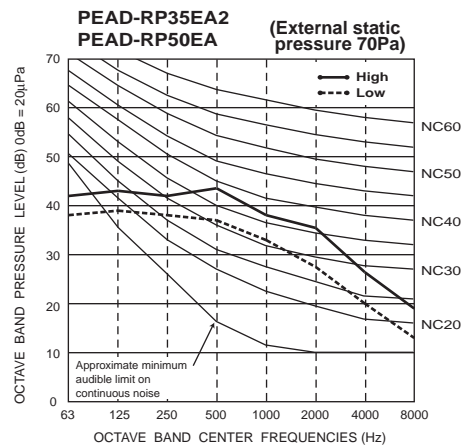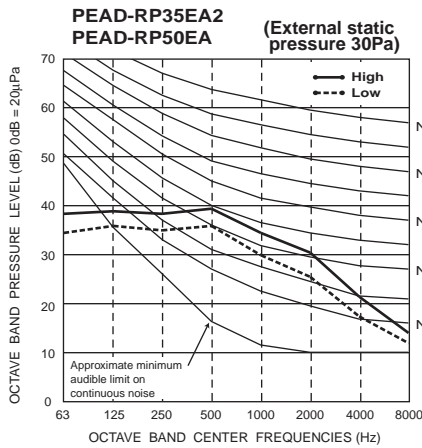


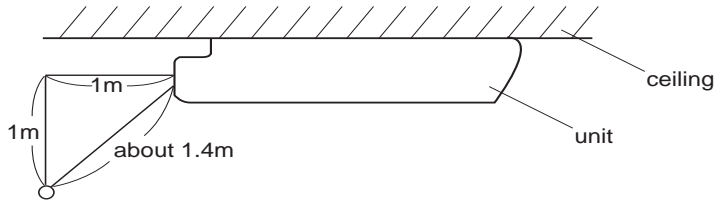


**MICROPHONE
PCA-RP50GA**

| NOTCH | SPL(dB) | LINE |
|---------|---------|------|
| High | 42 | ○—○ |
| Medium1 | 40 | △—△ |
| Medium2 | 38 | ●—● |
| Low | 37 | ▲—▲ |



**PCA-RP50GA2
PCA-RP60GA
PCA-RP71GA**

| NOTCH | SPL(dB) | LINE |
|---------|---------|------|
| High | 43 | ○—○ |
| Medium1 | 41 | △—△ |
| Medium2 | 39 | ●—● |
| Low | 37 | ▲—▲ |

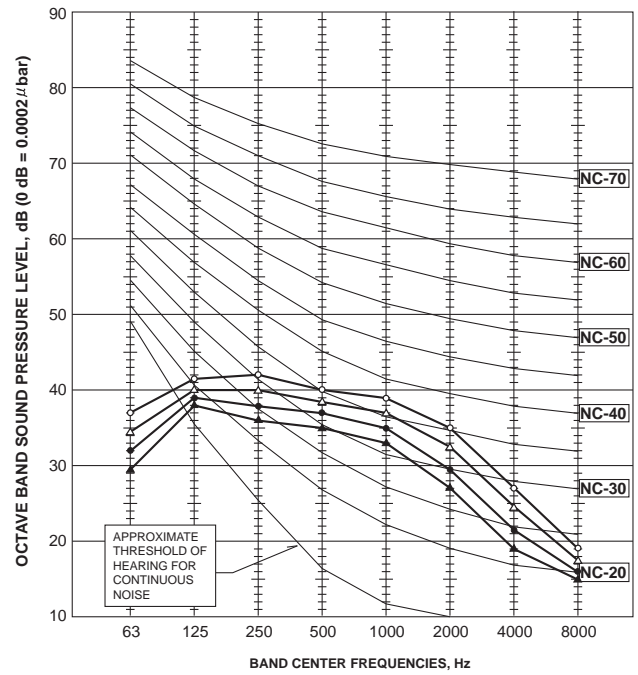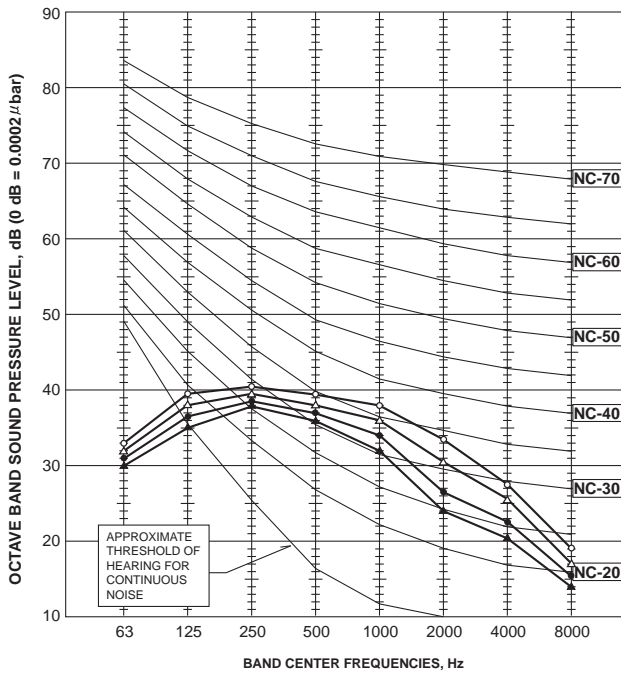

PEA-RP71EA

| NOTCH | SPL(dB) | LINE |
|-------|---------|------|
| High | 55 | ○—○ |
| Low | 52 | ●—● |

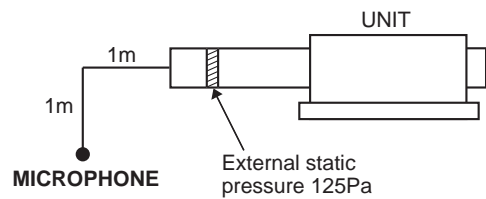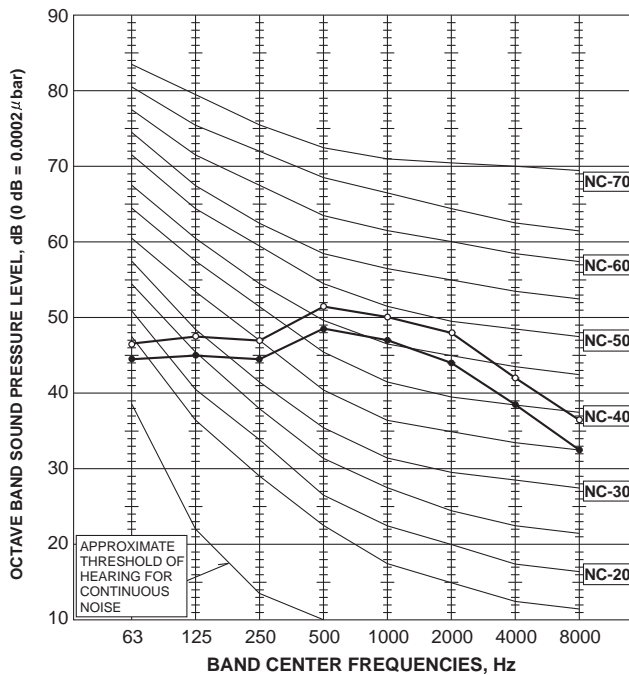


SUZ-KA25VA
SUZ-KA25VAH

| FAN SPEED | FUNCTION | SPL(dB(A)) | LINE |
|--------------|----------|------------|------|
| High Med. | COOLING | 46 | ●—● |
| | HEATING | 46 | ○—○ |

Test conditions,

Cooling : Dry-bulb temperature 35°C Wet-bulb temperature (24°C)
Heating : Dry-bulb temperature 7°C Wet-bulb temperature 6°C

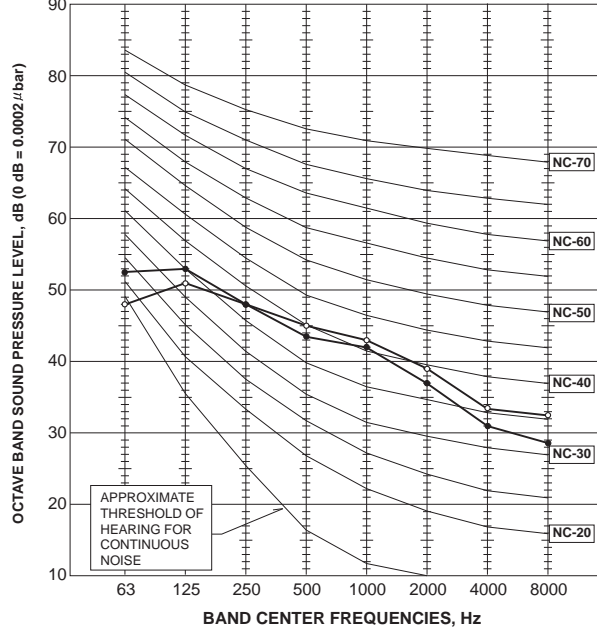


SUZ-KA35VA
SUZ-KA35VAH

| FAN SPEED | FUNCTION | SPL(dB(A)) | LINE |
|--------------|----------|------------|------|
| High Med. | COOLING | 47 | ●—● |
| | HEATING | 48 | ○—○ |

Test conditions,

Cooling : Dry-bulb temperature 35°C Wet-bulb temperature (24°C)
Heating : Dry-bulb temperature 7°C Wet-bulb temperature 6°C


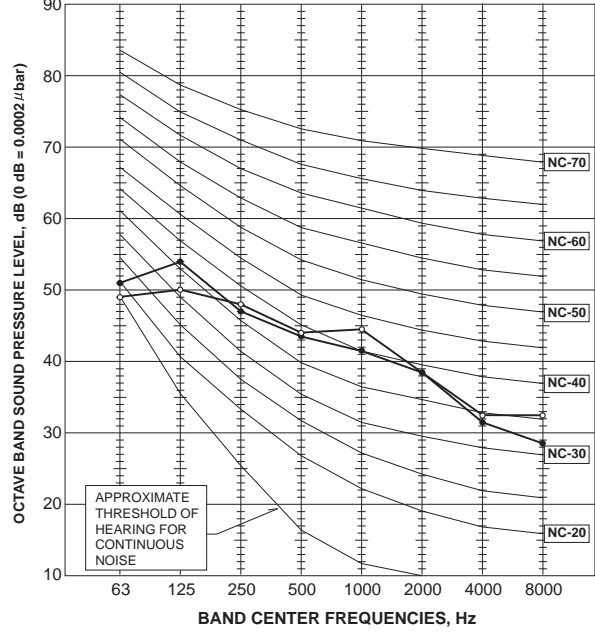


SUZ-KA50VA
SUZ-KA60VA
SUZ-KA71VA

| FAN SPEED | FUNCTION | SPL(dB(A)) | LINE |
|-----------|----------|------------|------|
| High | COOLING | 53 | ●—● |
| | HEATING | 55 | ○—○ |

Test conditions,

Cooling : Dry-bulb temperature 35°C Wet-bulb temperature (24°C)
Heating : Dry-bulb temperature 7°C Wet-bulb temperature 6°C

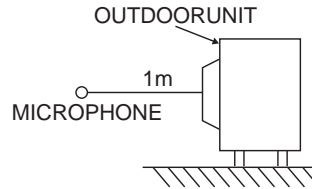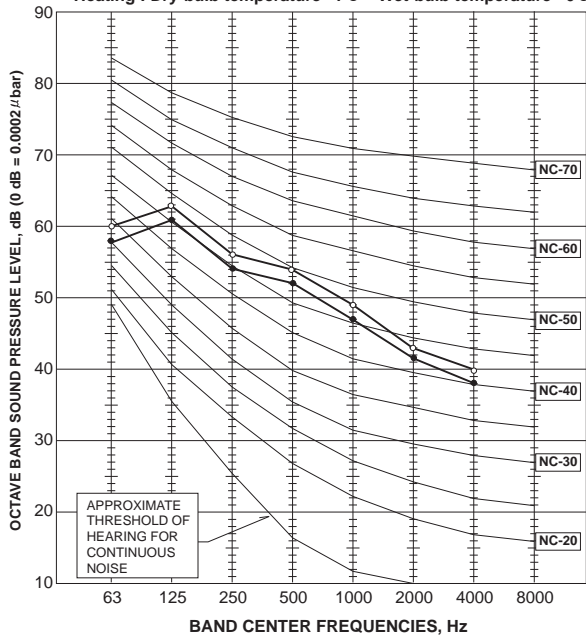

10-1. INDOOR UNIT

| Part Name | Model Name | Applicable model | |
|---|--------------------|--------------------------------|-----------|
| Remote sensor | PAC-SE41TS-E | All models except MFZ-KA·VA | |
| Remote operation adapter | PAC-SF40RM-E | | |
| Multiple remote controller adapter | PAC-SA88HA-E(1pc.) | | |
| | PAC-725AD(10pcs.) | | |
| Remote on/off adapter | PAC-SE55RA-E | | |
| MA & contact terminal interface | MAC-397IF-E | All models | |
| Anti-allergy enzyme filter(Air cleaning filter) | MAC-415FT-E | MFZ-KA·VA | |
| Drain lift up mechanism | PAC-KE07DM-E | SEZ-KD·VA(L) | |
| Wireless remote controller | PAR-SL9CA-E | SEZ-KC25VA | |
| Signal receiver unit | PAR-SA9CA-E | SEZ-KA35/50/60/71VA | |
| Air filter | PAC-1000FT | SEZ-KA·VA | |
| Decoration panel | PLP-6BA | PLA-RP·BA | |
| Decoration panel with wireless remote controller | PLP-6BALM | | |
| Decoration panel with wired remote controller | PLP-6BAM | | |
| Automatic filter elevation panel | PLP-6BAJ | | |
| i-see sensor corner panel | PAC-SA1ME-E | | |
| Wireless signal receiver | PAR-SA9FA-E | | |
| Space panel | PAC-SH48AS-E | | |
| Air outlet shutter plate | PAC-SH51SP-E | | |
| Multi-function casement | PAC-SH53TM-E | | |
| Flange for fresh air intake | PAC-SH65OF-E | | |
| High-efficiency filter element (PAC-SH53TM-E is needed.) | PAC-SH59KF-E | | |
| Multi-functional casement | PAC-SG03TM-E | | PLA-RP·AA |
| High-efficiency filter element (PAC-SG03TM-E is needed.) | PAC-SG01KF | | |
| Grille + Wireless remote controller | PLP-6AALM | | |
| Grille + Wired remote controller | PLP-6AAMD | | |
| Air outlet shutter plate (20 set, 2pcs/set) | PAC-SG06SP-E | | |
| Wireless remote controller kit | PAR-SL99B-E | PCA-RP·GA(2) | |
| Drain lift up mechanism | PAC-SH20DM-E | PCA-RP50,60GA(2) | |
| | PAC-SH21DM-E | PCA-RP71GA | |
| High-efficiency filter | PAC-SE80KF-E | PCA-RP50GA(2) | |
| | PAC-SE81KF-E | PCA-RP60,71GA | |
| Motor (for high external static pressure) | PAC-SK005MT-F | PEAD-RP71EA | |
| Drain lift up mechanism | PAC-KE03DM-F | PEAD-RP·EA, EA2 | |
| Insulation kit | PAC-SK010DK | PEAD-RP·GA | |

10-2. OUTDOOR UNIT

| Part Name | Model Name | Applicable model |
|-----------------------|------------|------------------|
| Drain socket | MAC-851DS | SUZ-KA25,35VA |
| Drain socket assembly | MAC-811DS | SUZ-KA50,60,71VA |

Mr. SLIM™

 **MITSUBISHI ELECTRIC CORPORATION**

HEAD OFFICE : TOKYO BLDG., 2-7-3, MARUNOUCHI, CHIYODA-KU, TOKYO 100-8310, JAPAN